

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1252504

Luminaire Tested: P3AS17R609030DE010 E3D1LI

Issue Date: 1/29/2026

Test Information

Test Method: LM-79-2019
Report Number: P1252504
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2501-338-15)
Test Lab: INNOVATION CENTER
Issue Date: 1/29/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: IRiS
Catalog Number: P3AS17R609030DE010 E3D1LI
Description: 3in Adjustable LED luminaire with, R60 optic, 3000K CCT AND, 90CRI , E3D1LI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1543.0 lumens
Efficiency: N/A
Efficacy: 72.8 lumens/watt
Spacing Criteria (0/90/45): 0.94 / 0.94 / 0.88
Luminous Opening: Circular (Dia: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 21.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1252504
CATALOG NUMBER: P3AS17R609030DE010 E3D1LI

Luminous Intensity Polar Plot

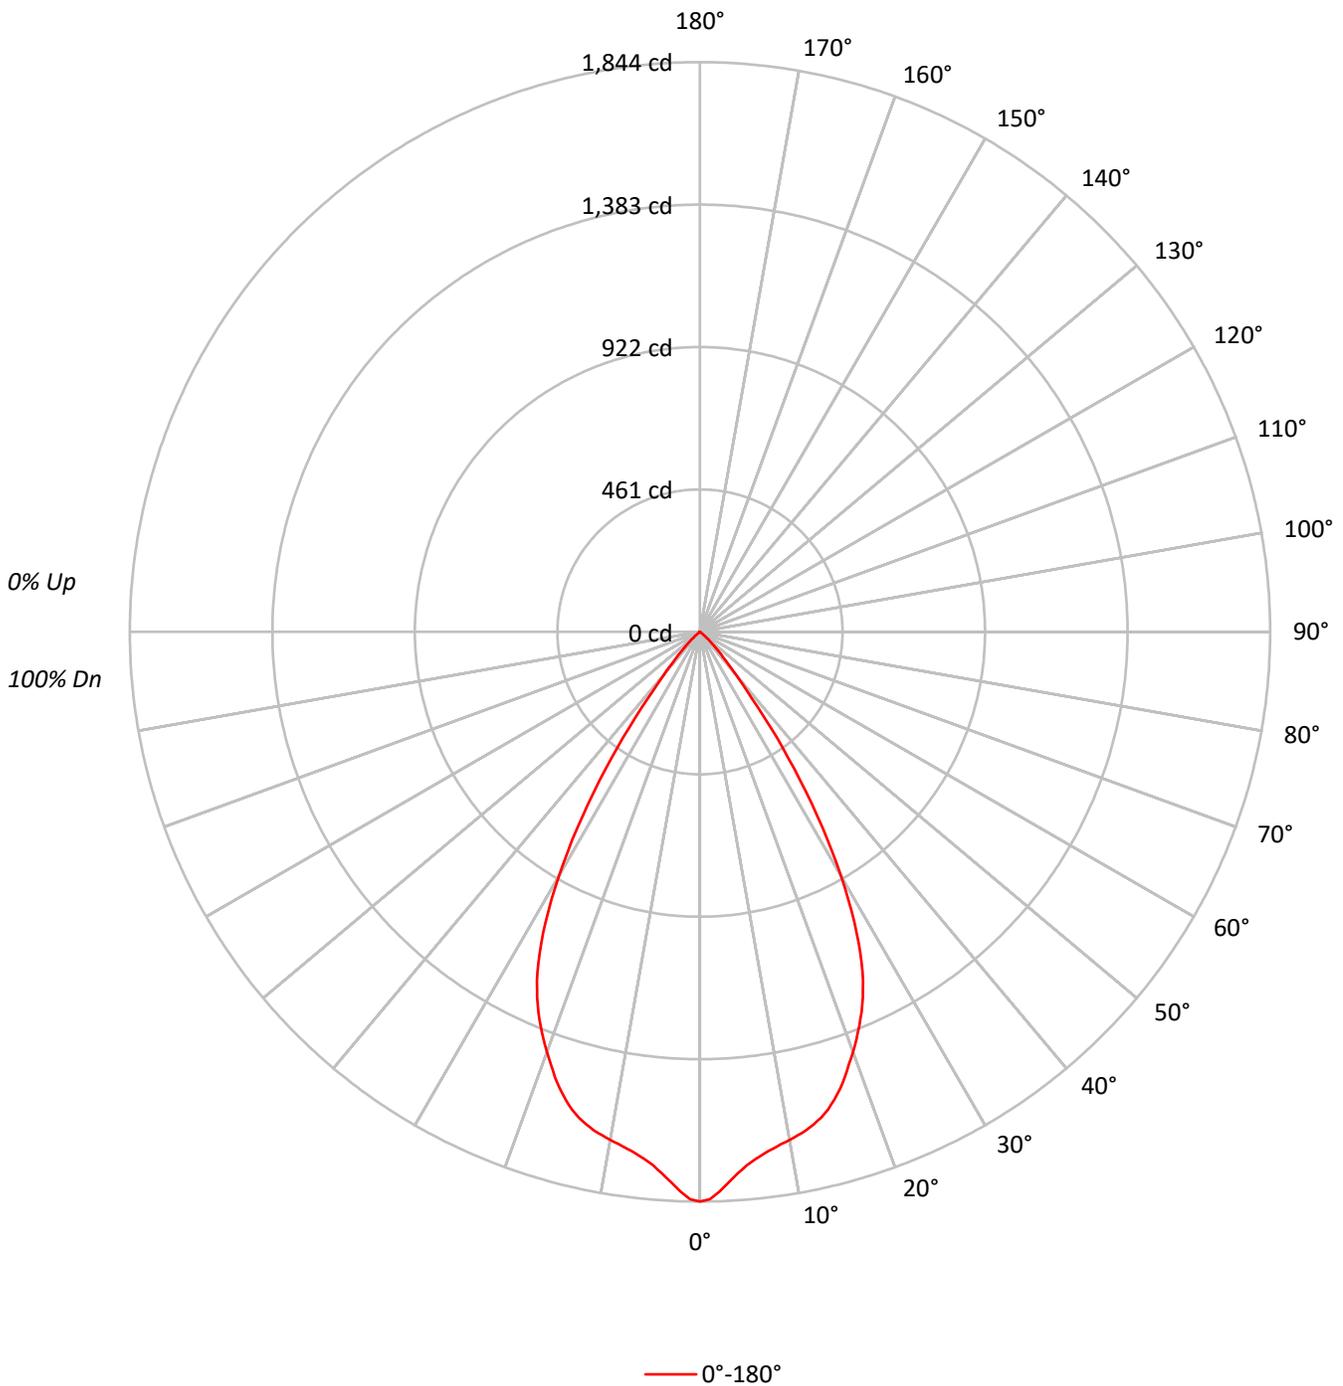



TEST NUMBER: P1252504

CATALOG NUMBER: P3AS17R609030DE010 E3D1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | | | 0 | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | 100 | 100 | 100 |
| 1 | 114 | 111 | 109 | 106 | 111 | 109 | 107 | 105 | 105 | 103 | 102 | 101 | 100 | 99 | 98 | 97 | 96 | 94 | 94 | 94 | 94 |
| 2 | 108 | 104 | 100 | 96 | 106 | 102 | 98 | 95 | 99 | 96 | 93 | 96 | 93 | 91 | 93 | 91 | 89 | 88 | 88 | 88 | 88 |
| 3 | 103 | 97 | 92 | 88 | 101 | 96 | 91 | 88 | 93 | 89 | 86 | 91 | 87 | 85 | 88 | 86 | 84 | 82 | 82 | 82 | 82 |
| 4 | 98 | 91 | 85 | 81 | 96 | 90 | 85 | 81 | 88 | 83 | 80 | 86 | 82 | 79 | 84 | 81 | 78 | 77 | 77 | 77 | 77 |
| 5 | 93 | 85 | 80 | 75 | 92 | 84 | 79 | 75 | 83 | 78 | 74 | 81 | 77 | 74 | 79 | 76 | 73 | 72 | 72 | 72 | 72 |
| 6 | 89 | 80 | 74 | 70 | 87 | 79 | 74 | 70 | 78 | 73 | 70 | 77 | 72 | 69 | 75 | 72 | 69 | 67 | 67 | 67 | 67 |
| 7 | 85 | 76 | 70 | 66 | 83 | 75 | 69 | 65 | 74 | 69 | 65 | 72 | 68 | 65 | 71 | 67 | 64 | 63 | 63 | 63 | 63 |
| 8 | 81 | 71 | 65 | 61 | 79 | 71 | 65 | 61 | 70 | 65 | 61 | 69 | 64 | 61 | 68 | 64 | 61 | 59 | 59 | 59 | 59 |
| 9 | 77 | 67 | 62 | 58 | 76 | 67 | 61 | 58 | 66 | 61 | 57 | 65 | 61 | 57 | 64 | 60 | 57 | 56 | 56 | 56 | 56 |
| 10 | 73 | 64 | 58 | 54 | 72 | 63 | 58 | 54 | 63 | 58 | 54 | 62 | 57 | 54 | 61 | 57 | 54 | 53 | 53 | 53 | 53 |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|--------|
| | 0° |
| 0° | 404288 |
| 5° | 381663 |
| 10° | 371737 |
| 15° | 363248 |
| 20° | 337733 |
| 25° | 301929 |
| 30° | 230618 |
| 35° | 133150 |
| 40° | 51668 |
| 45° | 21522 |
| 50° | 4742 |
| 55° | 726 |
| 60° | 570 |
| 65° | 311 |
| 70° | 385 |
| 75° | 0 |
| 80° | 0 |
| 85° | 0 |

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 21522 cd/sqm



TEST NUMBER: P1252504

CATALOG NUMBER: P3AS17R609030DE010 E3D1LI

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 163.7 | 10.6 |
| 10°-20° | 445.7 | 28.9 |
| 20°-30° | 558.2 | 36.2 |
| 30°-40° | 312.1 | 20.2 |
| 40°-50° | 59.3 | 3.8 |
| 50°-60° | 3.1 | 0.2 |
| 60°-70° | 0.7 | 0.0 |
| 70°-80° | 0.2 | 0.0 |
| 80°-90° | 0.0 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 1167.6 | 75.7 |
| 0°-40° | 1479.7 | 95.9 |
| 0°-60° | 1542.1 | 99.9 |
| 0°-90° | 1543.0 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 1543.0 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 1844 | |
| 5° | 1734 | 164 |
| 15° | 1600 | 446 |
| 25° | 1248 | 558 |
| 35° | 497 | 312 |
| 45° | 69 | 59 |
| 55° | 2 | 3 |
| 65° | 1 | 1 |
| 75° | 0 | 0 |
| 85° | 0 | 0 |
| 90° | 0 | |



TEST NUMBER: P1252504
CATALOG NUMBER: P3AS17R609030DE010 E3D1LI

CANDELA DISTRIBUTION (FULL):

| 0° | |
|-------|--------|
| 0° | 1843.7 |
| 1° | 1836.1 |
| 2° | 1812.1 |
| 3° | 1783.7 |
| 4° | 1757.2 |
| 5° | 1733.9 |
| 6° | 1716.2 |
| 7° | 1701.1 |
| 8° | 1689.7 |
| 9° | 1679.0 |
| 10° | 1669.5 |
| 11° | 1660.0 |
| 12° | 1649.3 |
| 13° | 1636.0 |
| 14° | 1620.3 |
| 15° | 1600.1 |
| 16° | 1575.4 |
| 17° | 1547.7 |
| 18° | 1516.1 |
| 19° | 1480.1 |
| 20° | 1447.3 |
| 21° | 1412.0 |
| 22° | 1375.4 |
| 23° | 1336.9 |
| 24° | 1294.6 |
| 25° | 1247.9 |
| 26° | 1192.9 |
| 27° | 1131.7 |
| 28° | 1062.9 |
| 29° | 989.7 |
| 30° | 910.8 |
| 31° | 831.3 |
| 32° | 749.2 |
| 32.5° | 704.4 |
| 33° | 664.0 |
| 34° | 580.1 |
| 35° | 497.4 |
| 36° | 422.9 |
| 37° | 344.0 |
| 37.5° | 308.0 |
| 38° | 272.7 |
| 39° | 219.7 |
| 40° | 180.5 |
| 42.5° | 109.8 |
| 45° | 69.4 |



TEST NUMBER: P1252504
CATALOG NUMBER: P3AS17R609030DE010 E3D1LI

CANDELA DISTRIBUTION (continued):

| | 0° |
|-------|------|
| 47.5° | 38.5 |
| 50° | 13.9 |
| 52.5° | 3.2 |
| 55° | 1.9 |
| 57.5° | 1.3 |
| 60° | 1.3 |
| 62.5° | 0.6 |
| 65° | 0.6 |
| 67.5° | 0.6 |
| 70° | 0.6 |
| 72.5° | 0.6 |
| 75° | 0.0 |
| 77.5° | 0.0 |
| 80° | 0.0 |
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |

(END OF REPORT)