

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1252644

Luminaire Tested: P3AS20R259030D010 E3D1B

Issue Date: 1/29/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1252644  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2501-338-9)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/29/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3AS20R259030D010 E3D1B  
Description: 3in Adjustable LED luminaire with, R25 optic, 3000K CCT AND, 90CRI , E3D1B TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 2284.0 lumens  
Efficiency: N/A  
Efficacy: 79.3 lumens/watt  
Spacing Criteria (0/90/45): 0.44 / 0.44 / 0.4  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct

Input Watts (W): 28.8  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1252644

CATALOG NUMBER: P3AS20R259030D010 E3D1B

### Luminous Intensity Polar Plot

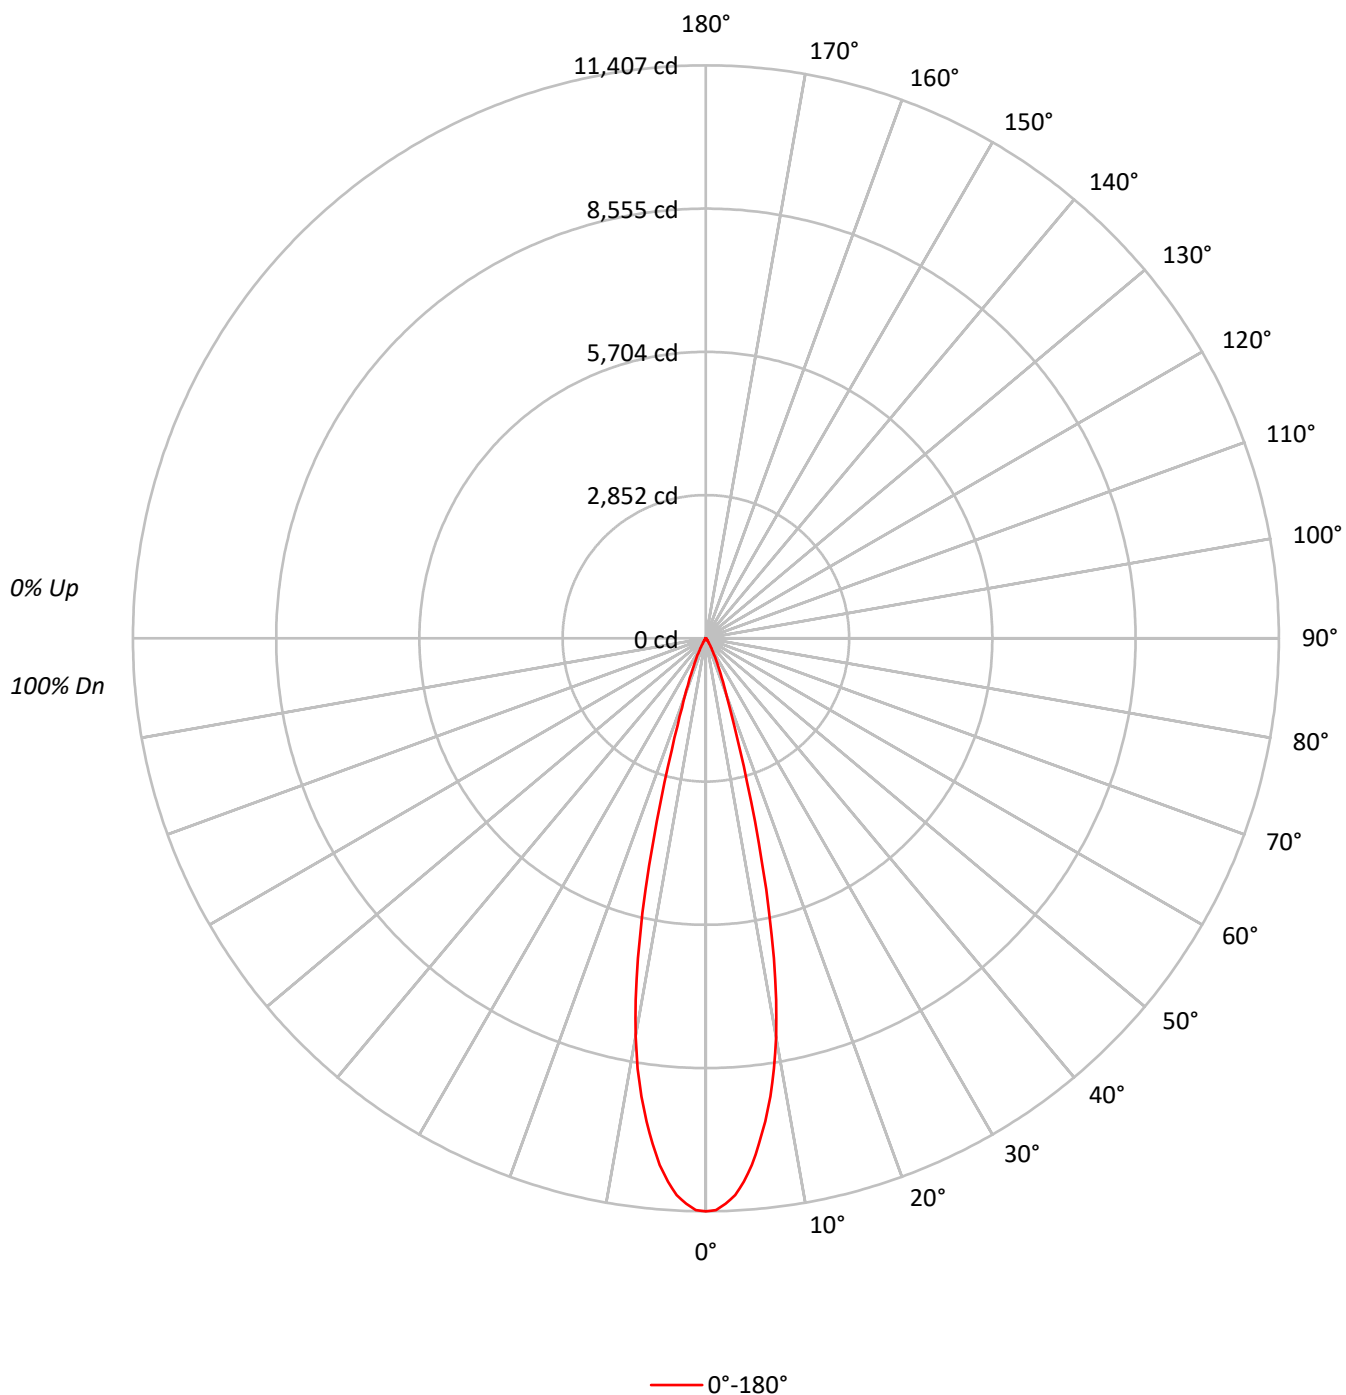

TEST NUMBER: P1252644

CATALOG NUMBER: P3AS20R259030D010 E3D1B

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|
| RF  | 20  |     |     |     | 20  |     |     |     |     | 20  |     |     |     |     | 20  |     |     |     |    | 20 |
| RC  | 80  |     |     |     | 70  |     |     |     |     | 50  |     |     |     |     | 30  |     |     |     |    | 10 |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30 | 10 |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | 99 | 99 |
| 1   | 115 | 113 | 111 | 110 | 113 | 111 | 110 | 108 | 107 | 106 | 105 | 104 | 103 | 102 | 100 | 99  | 99  | 97  | 97 | 97 |
| 2   | 112 | 108 | 106 | 103 | 110 | 107 | 104 | 102 | 104 | 102 | 100 | 101 | 99  | 98  | 98  | 97  | 96  | 94  | 94 | 94 |
| 3   | 109 | 104 | 101 | 98  | 107 | 103 | 100 | 97  | 100 | 98  | 96  | 98  | 96  | 94  | 96  | 94  | 93  | 92  | 92 | 92 |
| 4   | 106 | 101 | 97  | 94  | 104 | 100 | 96  | 94  | 98  | 95  | 92  | 96  | 93  | 91  | 94  | 92  | 90  | 89  | 89 | 89 |
| 5   | 103 | 97  | 93  | 91  | 101 | 96  | 93  | 90  | 95  | 92  | 90  | 93  | 91  | 89  | 92  | 90  | 88  | 87  | 87 | 87 |
| 6   | 100 | 94  | 90  | 88  | 99  | 94  | 90  | 87  | 92  | 89  | 87  | 91  | 88  | 86  | 90  | 88  | 86  | 85  | 85 | 85 |
| 7   | 98  | 92  | 88  | 85  | 97  | 91  | 87  | 85  | 90  | 87  | 84  | 89  | 86  | 84  | 88  | 86  | 84  | 83  | 83 | 83 |
| 8   | 95  | 89  | 85  | 83  | 94  | 89  | 85  | 83  | 88  | 85  | 82  | 87  | 84  | 82  | 86  | 84  | 82  | 81  | 81 | 81 |
| 9   | 93  | 87  | 83  | 81  | 92  | 86  | 83  | 80  | 86  | 83  | 80  | 85  | 82  | 80  | 84  | 82  | 80  | 79  | 79 | 79 |
| 10  | 91  | 85  | 81  | 79  | 90  | 84  | 81  | 79  | 84  | 81  | 78  | 83  | 80  | 78  | 83  | 80  | 78  | 77  | 77 | 77 |

**AVERAGE LUMINANCE (cd/sqm):**

|     |         |
|-----|---------|
|     | 0°      |
| 0°  | 2501400 |
| 5°  | 2317185 |
| 10° | 1792841 |
| 15° | 856327  |
| 20° | 282335  |
| 25° | 119015  |
| 30° | 46134   |
| 35° | 19943   |
| 40° | 6641    |
| 45° | 3070    |
| 50° | 1126    |
| 55° | 650     |
| 60° | 351     |
| 65° | 415     |
| 70° | 0       |
| 75° | 0       |
| 80° | 0       |
| 85° | 0       |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
Vertical Angle: 45°  
Luminance: 3070 cd/sqm

TEST NUMBER: P1252644

CATALOG NUMBER: P3AS20R259030D010 E3D1B

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 925.3  | 40.5      |
| 10°-20°   | 1052.4 | 46.1      |
| 20°-30°   | 244.6  | 10.7      |
| 30°-40°   | 51.3   | 2.2       |
| 40°-50°   | 8.3    | 0.4       |
| 50°-60°   | 1.4    | 0.1       |
| 60°-70°   | 0.7    | 0.0       |
| 70°-80°   | 0.0    | 0.0       |
| 80°-90°   | 0.0    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| <hr/>     |        |           |
| 0°-30°    | 2222.3 | 97.3      |
| 0°-40°    | 2273.6 | 99.5      |
| 0°-60°    | 2283.3 | 100.0     |
| 0°-90°    | 2284.0 | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 2284.0 | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°    | Flux |
|-----|-------|------|
| 0°  | 11407 |      |
| 5°  | 10527 | 925  |
| 15° | 3772  | 1052 |
| 25° | 492   | 245  |
| 35° | 74    | 51   |
| 45° | 10    | 8    |
| 55° | 2     | 1    |
| 65° | 1     | 1    |
| 75° | 0     | 0    |
| 85° | 0     | 0    |
| 90° | 0     |      |

TEST NUMBER: P1252644

CATALOG NUMBER: P3AS20R259030D010 E3D1B

**CANDELA DISTRIBUTION (FULL):**

| 0°    |         |
|-------|---------|
| 0°    | 11407.3 |
| 1°    | 11384.1 |
| 2°    | 11265.7 |
| 3°    | 11099.3 |
| 4°    | 10845.0 |
| 5°    | 10527.0 |
| 6°    | 10118.8 |
| 7°    | 9691.5  |
| 8°    | 9212.0  |
| 9°    | 8671.2  |
| 10°   | 8051.8  |
| 11°   | 7333.8  |
| 12°   | 6509.8  |
| 13°   | 5607.2  |
| 14°   | 4663.1  |
| 15°   | 3772.1  |
| 16°   | 2983.7  |
| 17°   | 2324.5  |
| 18°   | 1828.5  |
| 19°   | 1462.5  |
| 20°   | 1209.9  |
| 21°   | 1011.1  |
| 22°   | 848.8   |
| 23°   | 708.9   |
| 24°   | 592.9   |
| 25°   | 491.9   |
| 27.5° | 291.5   |
| 30°   | 182.2   |
| 32.5° | 116.8   |
| 35°   | 74.5    |
| 37.5° | 44.7    |
| 40°   | 23.2    |
| 42.5° | 14.9    |
| 45°   | 9.9     |
| 47.5° | 5.8     |
| 50°   | 3.3     |
| 52.5° | 1.7     |
| 55°   | 1.7     |
| 57.5° | 0.8     |
| 60°   | 0.8     |
| 62.5° | 0.8     |
| 65°   | 0.8     |
| 67.5° | 0.8     |
| 70°   | 0.0     |
| 72.5° | 0.0     |

TEST NUMBER: P1252644

CATALOG NUMBER: P3AS20R259030D010 E3D1B

**CANDELA DISTRIBUTION (continued):**

|       | 0°  |
|-------|-----|
| 75°   | 0.0 |
| 77.5° | 0.0 |
| 80°   | 0.0 |
| 82.5° | 0.0 |
| 85°   | 0.0 |
| 87.5° | 0.0 |
| 90°   | 0.0 |

(END OF REPORT)