

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1252936

Luminaire Tested: P3AS24R159030D010 E3DL1GPH

Issue Date: 1/30/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1252936  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-3)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3AS24R159030D010 E3DL1GPH  
Description: 3in Adjustable LED luminaire with, R15 optic, 3000K CCT AND, 90CRI , E3DL1GPH TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 971.0 lumens  
Efficiency: N/A  
Efficacy: 33.7 lumens/watt  
Spacing Criteria (0/90/45): 0.4 / 0.4 / 0.43  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct

Input Watts (W): 28.8  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1252936

CATALOG NUMBER: P3AS24R159030D010 E3DL1GPH

### Luminous Intensity Polar Plot

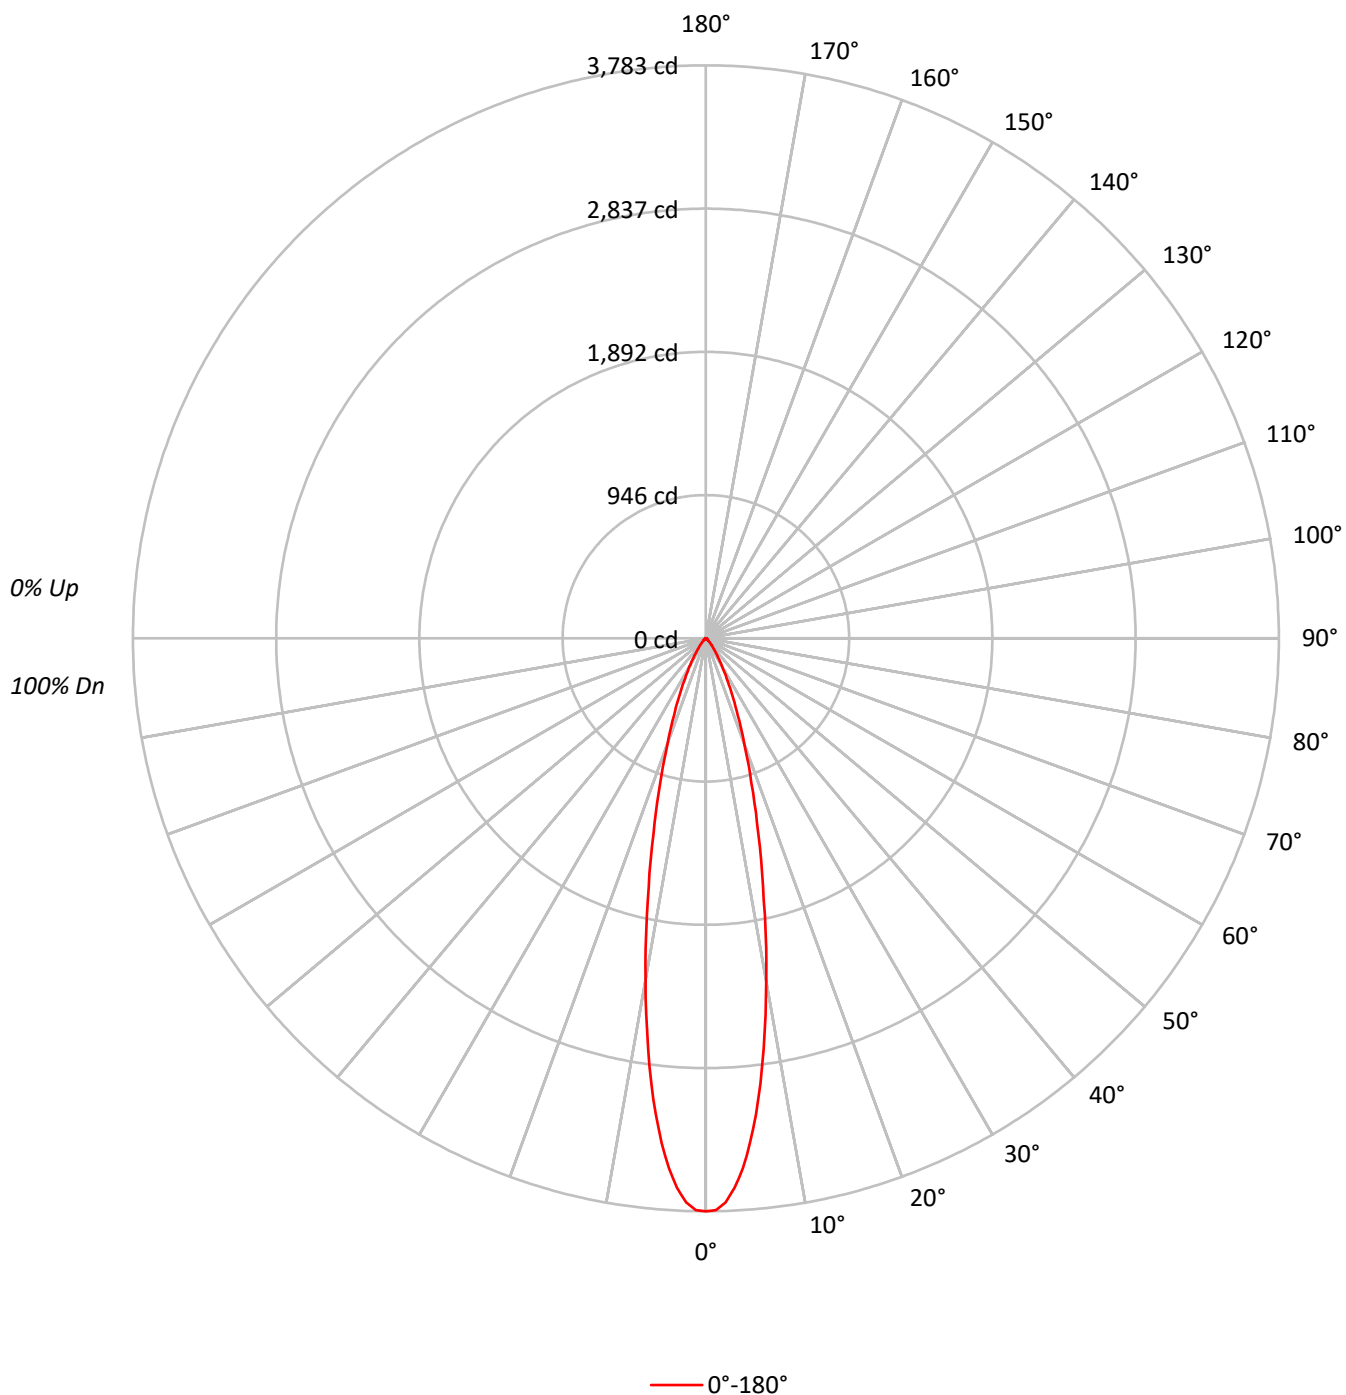

TEST NUMBER: P1252936

CATALOG NUMBER: P3AS24R159030D010 E3DL1GPH

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |     |     |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|-----|-----|-----|--|-----|-----|-----|-----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |  | 20  |     |     |  | 20  |     |     |     |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |  | 30  |     |     |  | 10  |     |     | 0   |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  |  | 50  | 30  | 10  |  | 50  | 30  | 10  | 0   |
| RCR |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |     |     |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 |  | 106 | 106 | 106 |  | 102 | 102 | 102 | 100 |
| 1   | 114 | 112 | 110 | 108 | 112 | 110 | 108 | 106 | 106 | 104 | 103 |  | 102 | 101 | 100 |  | 99  | 98  | 97  | 95  |
| 2   | 110 | 106 | 103 | 100 | 108 | 104 | 101 | 99  | 101 | 99  | 97  |  | 98  | 96  | 95  |  | 96  | 94  | 93  | 91  |
| 3   | 106 | 101 | 97  | 93  | 104 | 99  | 96  | 93  | 97  | 94  | 91  |  | 94  | 92  | 90  |  | 92  | 90  | 88  | 87  |
| 4   | 102 | 96  | 92  | 88  | 100 | 95  | 91  | 88  | 93  | 89  | 87  |  | 91  | 88  | 86  |  | 89  | 87  | 85  | 83  |
| 5   | 98  | 92  | 87  | 84  | 97  | 91  | 87  | 83  | 89  | 85  | 83  |  | 88  | 84  | 82  |  | 86  | 83  | 81  | 80  |
| 6   | 95  | 88  | 83  | 80  | 94  | 87  | 83  | 80  | 86  | 82  | 79  |  | 85  | 81  | 79  |  | 83  | 80  | 78  | 77  |
| 7   | 92  | 85  | 80  | 77  | 91  | 84  | 80  | 76  | 83  | 79  | 76  |  | 82  | 78  | 76  |  | 81  | 78  | 75  | 74  |
| 8   | 89  | 81  | 77  | 74  | 88  | 81  | 77  | 73  | 80  | 76  | 73  |  | 79  | 75  | 73  |  | 78  | 75  | 73  | 72  |
| 9   | 86  | 79  | 74  | 71  | 85  | 78  | 74  | 71  | 77  | 73  | 71  |  | 77  | 73  | 70  |  | 76  | 73  | 70  | 69  |
| 10  | 84  | 76  | 71  | 68  | 83  | 76  | 71  | 68  | 75  | 71  | 68  |  | 74  | 71  | 68  |  | 74  | 70  | 68  | 67  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |        |
|-----|--------|
|     | 0°     |
| 0°  | 829495 |
| 5°  | 736296 |
| 10° | 511324 |
| 15° | 302385 |
| 20° | 172215 |
| 25° | 98449  |
| 30° | 54464  |
| 35° | 29045  |
| 40° | 16059  |
| 45° | 8714   |
| 50° | 5424   |
| 55° | 4282   |
| 60° | 3684   |
| 65° | 3373   |
| 70° | 3013   |
| 75° | 3135   |
| 80° | 2399   |
| 85° | 2264   |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
Vertical Angle: 45°  
Luminance: 8714 cd/sqm

TEST NUMBER: P1252936

CATALOG NUMBER: P3AS24R159030D010 E3DL1GPH

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 284.4  | 29.3      |
| 10°-20°   | 375.4  | 38.7      |
| 20°-30°   | 193.3  | 19.9      |
| 30°-40°   | 72.6   | 7.5       |
| 40°-50°   | 23.8   | 2.4       |
| 50°-60°   | 10.2   | 1.1       |
| 60°-70°   | 6.5    | 0.7       |
| 70°-80°   | 3.8    | 0.4       |
| 80°-90°   | 1.0    | 0.1       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| <hr/>     |        |           |
| 0°-30°    | 853.1  | 87.9      |
| 0°-40°    | 925.7  | 95.3      |
| 0°-60°    | 959.7  | 98.8      |
| 0°-90°    | 971.0  | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 971.0  | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 3783 |      |
| 5°  | 3345 | 284  |
| 15° | 1332 | 375  |
| 25° | 407  | 193  |
| 35° | 108  | 73   |
| 45° | 28   | 24   |
| 55° | 11   | 10   |
| 65° | 6    | 6    |
| 75° | 4    | 4    |
| 85° | 1    | 1    |
| 90° | 0    |      |

TEST NUMBER: P1252936

CATALOG NUMBER: P3AS24R159030D010 E3DL1GPH

**CANDELA DISTRIBUTION (FULL):**

| 0°    |        |
|-------|--------|
| 0°    | 3782.8 |
| 1°    | 3775.3 |
| 2°    | 3725.7 |
| 3°    | 3631.2 |
| 4°    | 3506.8 |
| 5°    | 3345.0 |
| 6°    | 3161.7 |
| 7°    | 2960.6 |
| 8°    | 2737.0 |
| 9°    | 2516.2 |
| 10°   | 2296.4 |
| 12.5° | 1767.0 |
| 15°   | 1332.0 |
| 17.5° | 997.1  |
| 20°   | 738.0  |
| 22.5° | 551.0  |
| 25°   | 406.9  |
| 27.5° | 296.5  |
| 30°   | 215.1  |
| 32.5° | 152.5  |
| 35°   | 108.5  |
| 37.5° | 77.6   |
| 40°   | 56.1   |
| 42.5° | 40.2   |
| 45°   | 28.1   |
| 47.5° | 20.6   |
| 50°   | 15.9   |
| 52.5° | 13.1   |
| 55°   | 11.2   |
| 57.5° | 9.4    |
| 60°   | 8.4    |
| 62.5° | 7.5    |
| 65°   | 6.5    |
| 67.5° | 5.6    |
| 70°   | 4.7    |
| 72.5° | 4.7    |
| 75°   | 3.7    |
| 77.5° | 2.8    |
| 80°   | 1.9    |
| 82.5° | 1.9    |
| 85°   | 0.9    |
| 87.5° | 0.0    |
| 90°   | 0.0    |

(END OF REPORT)