

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1253883

Luminaire Tested: P3AS05R309035DE010 E3D1WMH

Issue Date: 1/29/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1253883  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2501-338-10)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/29/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3AS05R309035DE010 E3D1WMH  
Description: 3in Adjustable LED luminaire with, R30 optic, 3500K CCT AND, 90CRI , E3D1WMH TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 650.1 lumens  
Efficiency: N/A  
Efficacy: 90.3 lumens/watt  
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.47  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct

Input Watts (W): 7.2  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1253883

CATALOG NUMBER: P3AS05R309035DE010 E3D1WMH

### Luminous Intensity Polar Plot

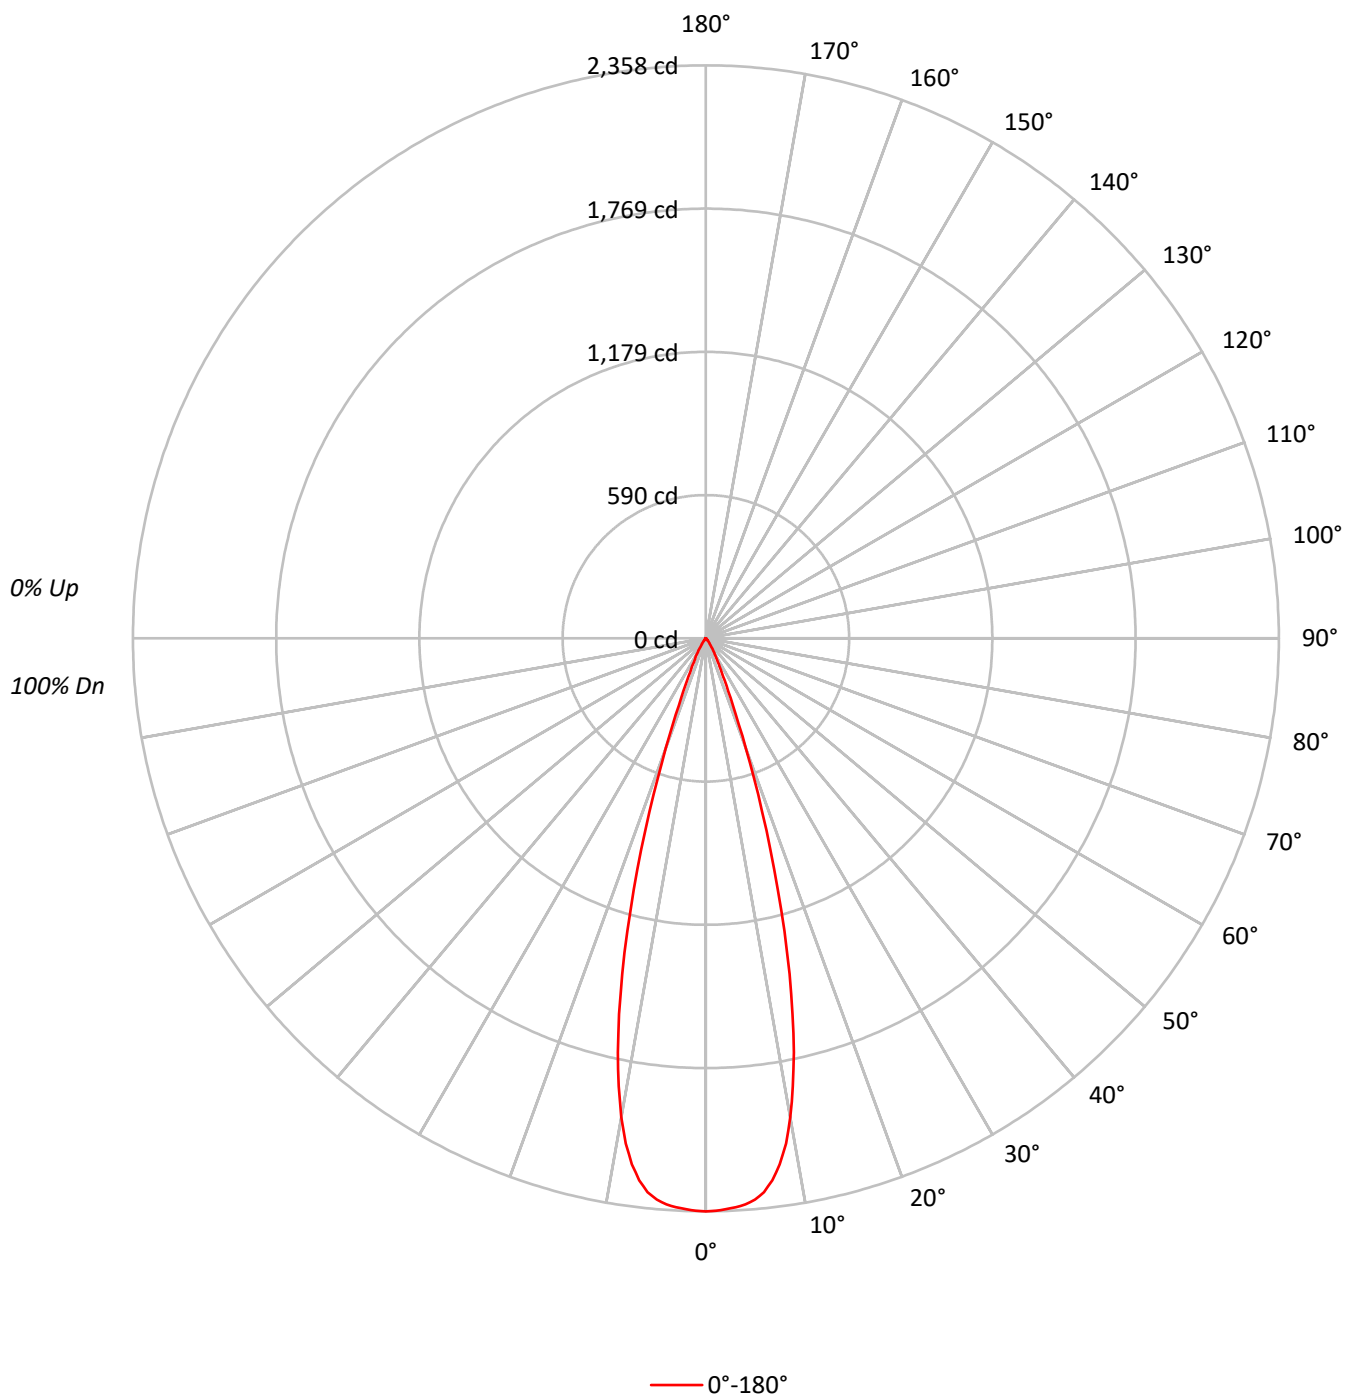

TEST NUMBER: P1253883

CATALOG NUMBER: P3AS05R309035DE010 E3D1WMH

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|-----|-----|-----|--|-----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |  | 20  |     |     |  | 20  |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |  | 30  |     |     |  | 10  |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  |  | 50  | 30  | 10  |  | 50  |
| RCR |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 |  | 106 | 106 | 106 |  | 102 |
| 1   | 115 | 113 | 111 | 109 | 113 | 111 | 109 | 108 | 107 | 106 | 104 |  | 103 | 102 | 101 |  | 100 |
| 2   | 111 | 108 | 105 | 102 | 109 | 106 | 103 | 101 | 103 | 101 | 99  |  | 100 | 98  | 97  |  | 97  |
| 3   | 108 | 103 | 100 | 97  | 106 | 102 | 99  | 96  | 99  | 97  | 95  |  | 97  | 95  | 93  |  | 95  |
| 4   | 105 | 99  | 95  | 92  | 103 | 98  | 95  | 92  | 96  | 93  | 91  |  | 94  | 92  | 90  |  | 93  |
| 5   | 101 | 96  | 92  | 89  | 100 | 95  | 91  | 88  | 93  | 90  | 87  |  | 92  | 89  | 87  |  | 90  |
| 6   | 99  | 92  | 88  | 85  | 97  | 92  | 88  | 85  | 90  | 87  | 84  |  | 89  | 86  | 84  |  | 88  |
| 7   | 96  | 89  | 85  | 82  | 95  | 89  | 85  | 82  | 88  | 84  | 82  |  | 87  | 84  | 81  |  | 86  |
| 8   | 93  | 87  | 83  | 80  | 92  | 86  | 82  | 80  | 85  | 82  | 79  |  | 84  | 81  | 79  |  | 84  |
| 9   | 91  | 84  | 80  | 77  | 90  | 84  | 80  | 77  | 83  | 79  | 77  |  | 82  | 79  | 77  |  | 81  |
| 10  | 88  | 82  | 78  | 75  | 88  | 81  | 78  | 75  | 81  | 77  | 75  |  | 80  | 77  | 75  |  | 79  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |        |
|-----|--------|
|     | 0°     |
| 0°  | 517152 |
| 5°  | 510410 |
| 10° | 445639 |
| 15° | 283248 |
| 20° | 112220 |
| 25° | 37478  |
| 30° | 17446  |
| 35° | 7897   |
| 40° | 3034   |
| 45° | 1489   |
| 50° | 443    |
| 55° | 191    |
| 60° | 132    |
| 65° | 156    |
| 70° | 0      |
| 75° | 0      |
| 80° | 0      |
| 85° | 0      |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1489 cd/sqm

TEST NUMBER: P1253883

CATALOG NUMBER: P3AS05R309035DE010 E3D1WMH

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 212.0  | 32.6      |
| 10°-20°   | 328.8  | 50.6      |
| 20°-30°   | 84.8   | 13.0      |
| 30°-40°   | 19.9   | 3.1       |
| 40°-50°   | 3.9    | 0.6       |
| 50°-60°   | 0.5    | 0.1       |
| 60°-70°   | 0.3    | 0.0       |
| 70°-80°   | 0.0    | 0.0       |
| 80°-90°   | 0.0    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| <hr/>     |        |           |
| 0°-30°    | 625.5  | 96.2      |
| 0°-40°    | 645.4  | 99.3      |
| 0°-60°    | 649.8  | 100.0     |
| 0°-90°    | 650.1  | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 650.1  | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 2358 |      |
| 5°  | 2319 | 212  |
| 15° | 1248 | 329  |
| 25° | 155  | 85   |
| 35° | 30   | 20   |
| 45° | 5    | 4    |
| 55° | 0    | 0    |
| 65° | 0    | 0    |
| 75° | 0    | 0    |
| 85° | 0    | 0    |
| 90° | 0    |      |

TEST NUMBER: P1253883

CATALOG NUMBER: P3AS05R309035DE010 E3D1WMH

**CANDELA DISTRIBUTION (FULL):**

| 0°    |        |
|-------|--------|
| 0°    | 2358.4 |
| 1°    | 2356.7 |
| 2°    | 2351.1 |
| 3°    | 2344.8 |
| 4°    | 2335.5 |
| 5°    | 2318.8 |
| 6°    | 2291.8 |
| 7°    | 2246.9 |
| 8°    | 2185.6 |
| 9°    | 2105.6 |
| 10°   | 2001.4 |
| 11°   | 1877.5 |
| 12°   | 1742.3 |
| 13°   | 1586.6 |
| 14°   | 1423.6 |
| 15°   | 1247.7 |
| 16°   | 1075.4 |
| 17°   | 909.4  |
| 18°   | 750.1  |
| 19°   | 604.1  |
| 20°   | 480.9  |
| 21°   | 378.5  |
| 22°   | 297.7  |
| 23°   | 235.7  |
| 24°   | 188.7  |
| 25°   | 154.9  |
| 26°   | 129.2  |
| 27°   | 109.8  |
| 28°   | 94.9   |
| 29°   | 81.2   |
| 30°   | 68.9   |
| 32.5° | 43.4   |
| 35°   | 29.5   |
| 37.5° | 18.4   |
| 40°   | 10.6   |
| 42.5° | 7.1    |
| 45°   | 4.8    |
| 47.5° | 2.8    |
| 50°   | 1.3    |
| 52.5° | 0.5    |
| 55°   | 0.5    |
| 57.5° | 0.3    |
| 60°   | 0.3    |
| 62.5° | 0.3    |
| 65°   | 0.3    |

TEST NUMBER: P1253883

CATALOG NUMBER: P3AS05R309035DE010 E3D1WMH

**CANDELA DISTRIBUTION (continued):**

|       | 0°  |
|-------|-----|
| 67.5° | 0.3 |
| 70°   | 0.0 |
| 72.5° | 0.0 |
| 75°   | 0.0 |
| 77.5° | 0.0 |
| 80°   | 0.0 |
| 82.5° | 0.0 |
| 85°   | 0.0 |
| 87.5° | 0.0 |
| 90°   | 0.0 |

(END OF REPORT)