Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: IRiS

Report Number: P1257457

Luminaire Tested: P3AS13R459040DE010 E3CD1MW

Issue Date: 1/30/2026

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-2019
Report Number:	P1257457
	TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-28)
Test Lab:	INNOVATION CENTER
Issue Date:	1/30/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	IRiS
Catalog Number:	P3AS13R459040DE010 E3CD1MW
Description:	3in Adjustable LED luminaire with, R45 optic, 4000K CCT AND, 90CRI , E3CD1MW TRIM
Light Source:	-
Ballast/Driver:	-

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	1402.0 lumens
Efficiency:	N/A
Efficacy:	96.0 lumens/watt
Spacing Criteria (0/90/45):	0.72 / 0.72 / 0.66
Luminous Opening:	Circular (Dia: 0.25' x H: 0')
CIE Type:	Direct

Input Watts (W):	14.6
Input Voltage (V):	NR
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	NR
Total Harmonic Distortion (THDi):	NR
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	24 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1257457
CATALOG NUMBER: P3AS13R459040DE010 E3CD1MW

Luminous Intensity Polar Plot

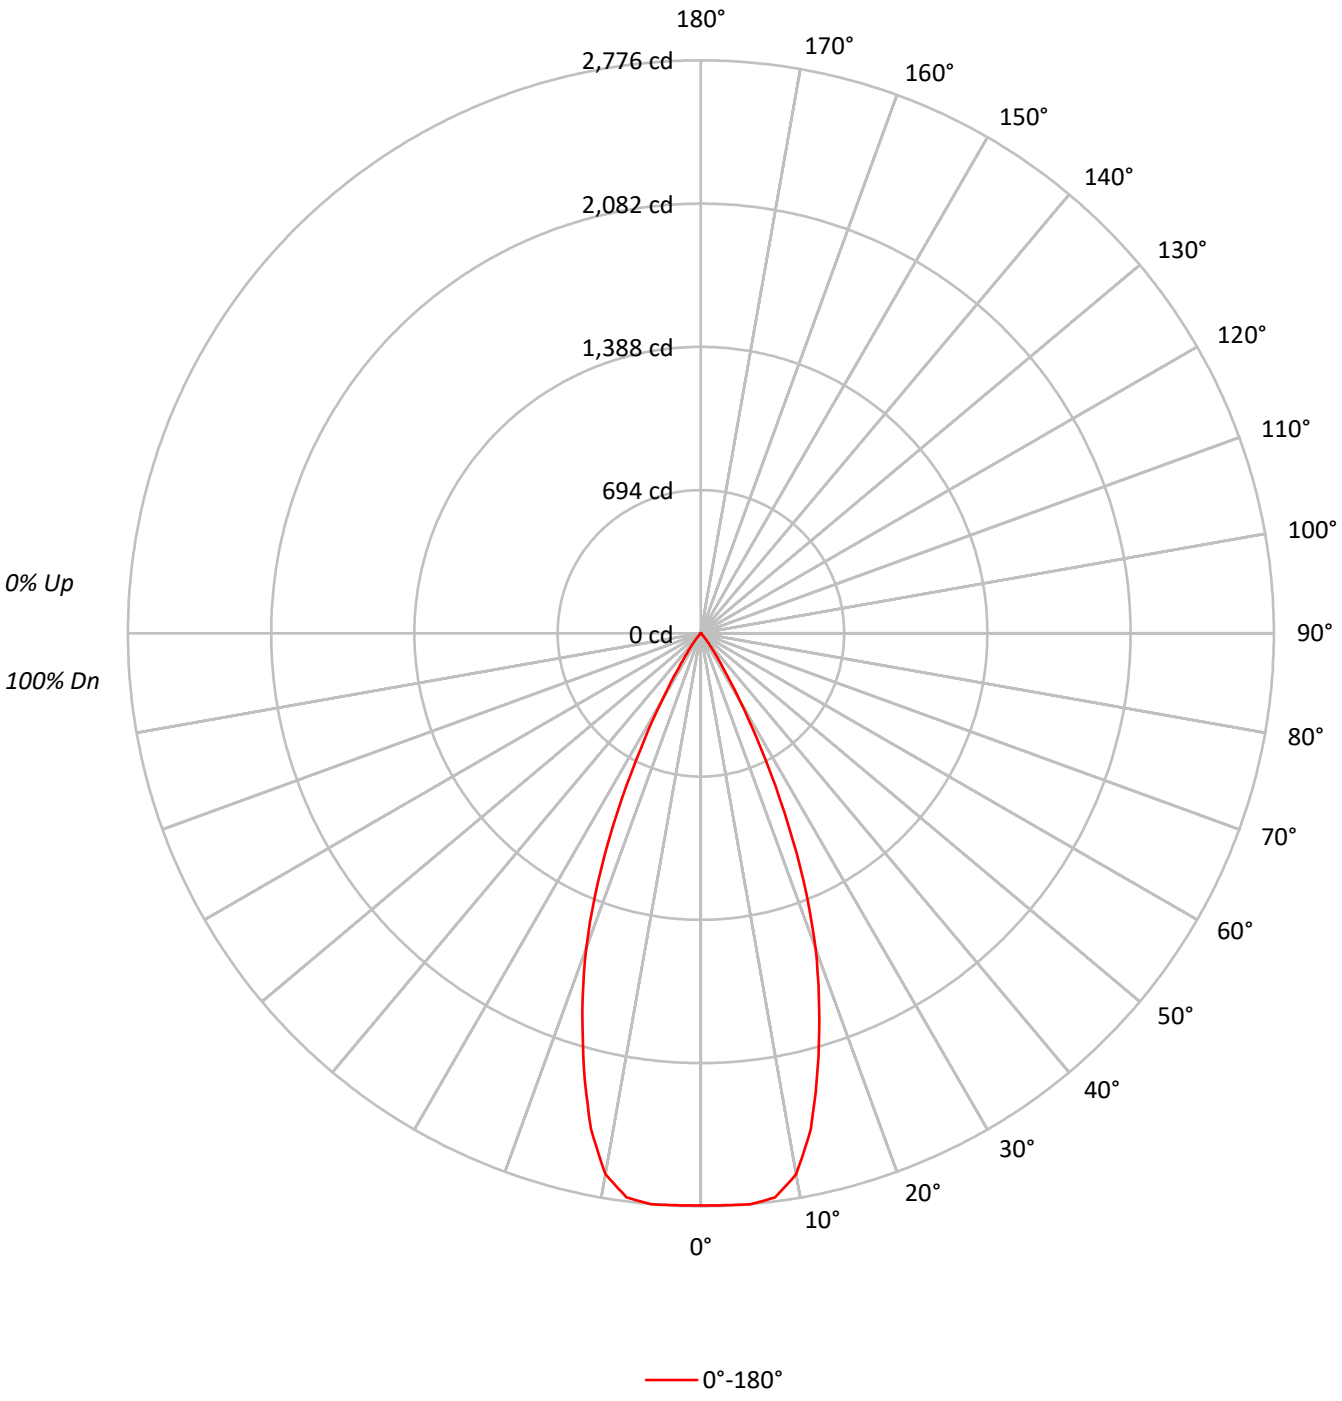

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1257457
CATALOG NUMBER: P3AS13R459040DE010 E3CD1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20			20			20			20
RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	99	98	97	95
2	110	106	102	100	108	104	101	98	101	98	96	98	96	94	95	94	92	91
3	106	100	96	93	104	99	95	92	96	93	91	94	91	89	92	90	88	87
4	102	95	91	87	100	94	90	87	92	89	86	90	87	85	88	86	84	83
5	98	91	86	82	96	90	85	82	88	84	81	87	83	81	85	82	80	79
6	94	87	82	78	93	86	81	78	85	80	77	83	80	77	82	79	76	75
7	90	83	78	74	89	82	78	74	81	77	74	80	76	74	79	76	73	72
8	87	79	74	71	86	79	74	71	78	74	71	77	73	70	76	73	70	69
9	84	76	71	68	83	76	71	68	75	71	68	74	70	67	73	70	67	66
10	81	73	68	65	80	73	68	65	72	68	65	71	67	65	71	67	65	64

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	607846
5°	611092
10°	592307
15°	496348
20°	379433
25°	230989
30°	96116
35°	30785
40°	9589
45°	1954
50°	1433
55°	1606
60°	1360
65°	1608
70°	1346
75°	1779
80°	1263
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1954 cd/sqm

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1257457
CATALOG NUMBER: P3AS13R459040DE010 E3CD1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	261.8	18.7
10°-20°	600.9	42.9
20°-30°	432.7	30.9
30°-40°	90.0	6.4
40°-50°	8.2	0.6
50°-60°	3.4	0.2
60°-70°	2.7	0.2
70°-80°	1.8	0.1
80°-90°	0.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1295.4	92.4
0°-40°	1385.5	98.8
0°-60°	1397.1	99.7
0°-90°	1402.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1402.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2772	
5°	2776	262
15°	2186	601
25°	955	433
35°	115	90
45°	6	8
55°	4	3
65°	3	3
75°	2	2
85°	0	0
90°	0	

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1257457
CATALOG NUMBER: P3AS13R459040DE010 E3CD1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	2772.0
2.5°	2773.0
5°	2776.2
7.5°	2756.3
10°	2660.1
12.5°	2459.3
15°	2186.4
17.5°	1907.2
20°	1626.0
22.5°	1302.9
25°	954.7
27.5°	629.5
30°	379.6
32.5°	212.3
35°	115.0
37.5°	64.8
40°	33.5
42.5°	14.6
45°	6.3
47.5°	4.2
50°	4.2
52.5°	4.2
55°	4.2
57.5°	3.1
60°	3.1
62.5°	3.1
65°	3.1
67.5°	2.1
70°	2.1
72.5°	2.1
75°	2.1
77.5°	1.0
80°	1.0
82.5°	1.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)