Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: IRiS

Report Number: P1259968

Luminaire Tested: P3AS13R309050DE010 E3D1MW

Issue Date: 1/30/2026

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-2019
Report Number:	P1259968
	TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-16)
Test Lab:	INNOVATION CENTER
Issue Date:	1/30/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	IRiS
Catalog Number:	P3AS13R309050DE010 E3D1MW
Description:	3in Adjustable LED luminaire with, R30 optic, 5000K CCT AND, 90CRI , E3D1MW TRIM
Light Source:	-
Ballast/Driver:	-

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	1351.0 lumens
Efficiency:	N/A
Efficacy:	92.5 lumens/watt
Spacing Criteria (0/90/45):	0.53 / 0.53 / 0.47
Luminous Opening:	Circular (Dia: 0.25' x H: 0')
CIE Type:	Direct

Input Watts (W):	14.6
Input Voltage (V):	NR
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	NR
Total Harmonic Distortion (THDi):	NR
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	24 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1259968
CATALOG NUMBER: P3AS13R309050DE010 E3D1MW

Luminous Intensity Polar Plot

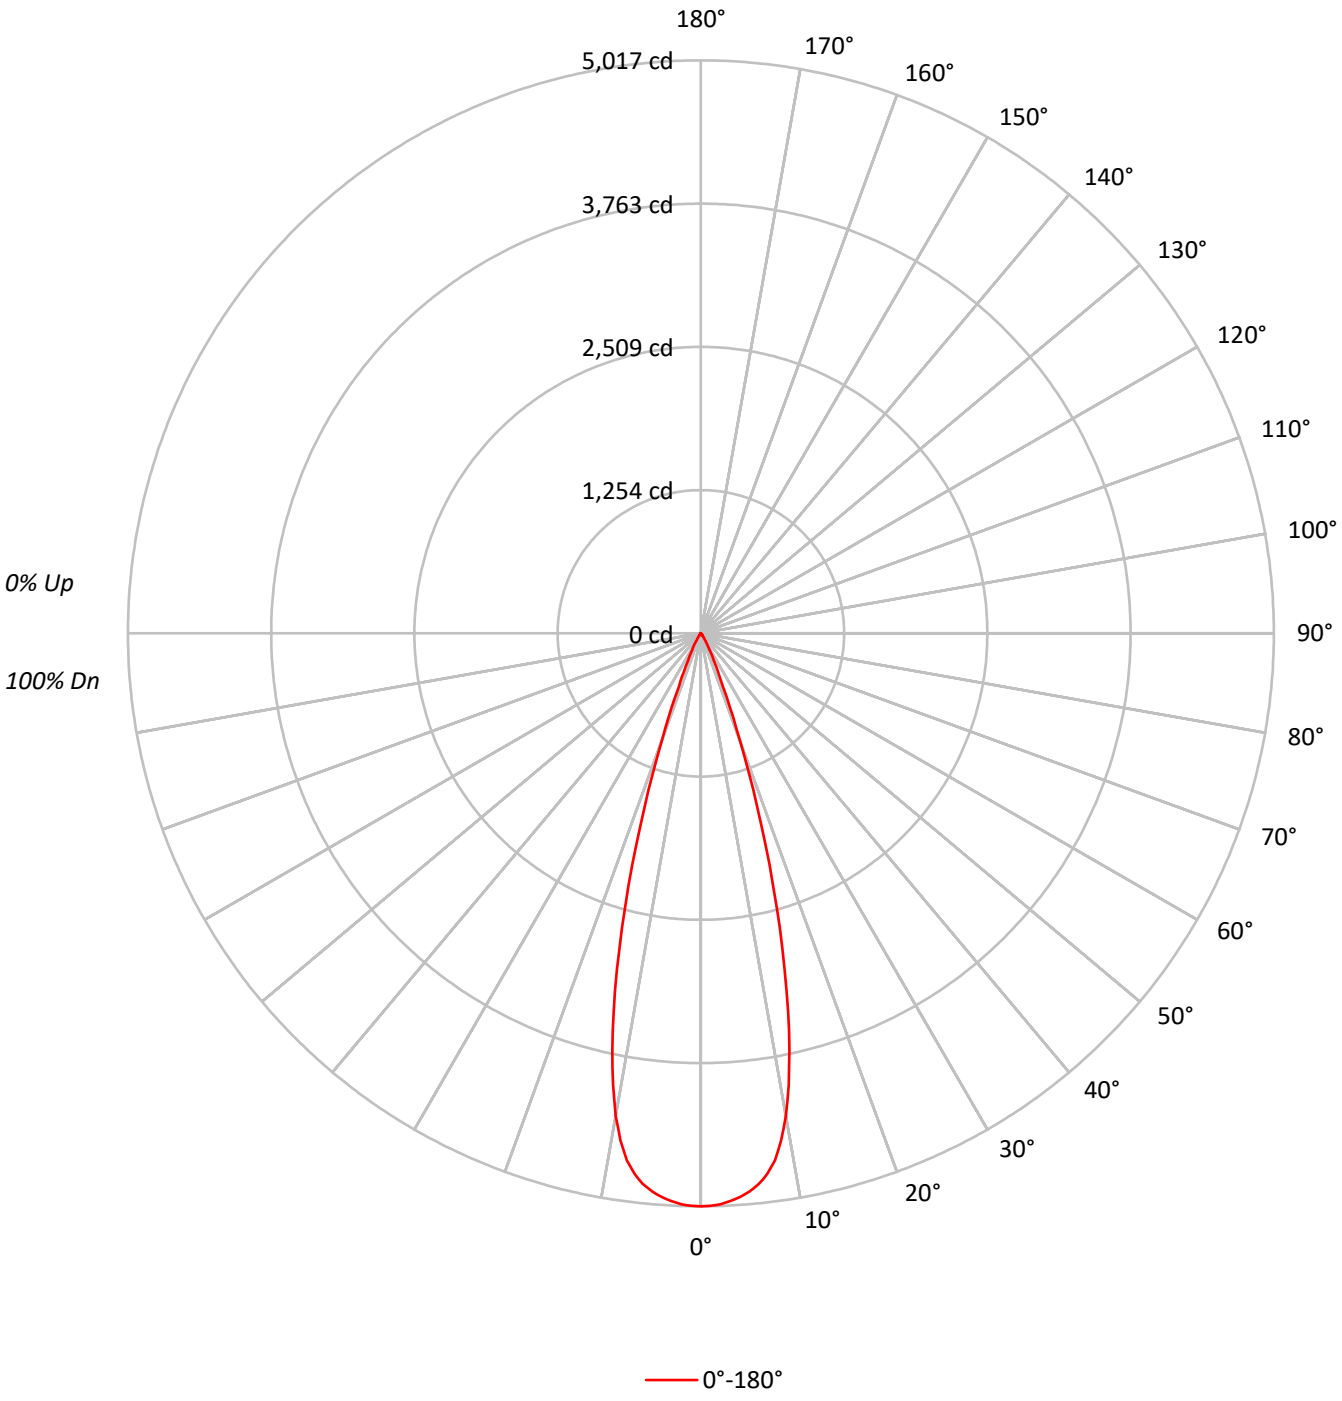

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1259968
CATALOG NUMBER: P3AS13R309050DE010 E3D1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20			20			20			20
RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	94
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	94	92	91
4	105	100	96	93	103	99	95	92	97	94	91	95	92	90	93	91	89	88
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	87	85
6	99	93	89	86	98	92	88	86	91	88	85	90	87	85	89	86	84	83
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	81
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	79
9	91	85	81	78	90	84	81	78	84	80	78	83	80	78	82	79	77	77
10	89	83	79	76	88	82	78	76	82	78	76	81	78	76	80	77	75	75

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1100175
5°	1079372
10°	955516
15°	605384
20°	229807
25°	68036
30°	26865
35°	8245
40°	3635
45°	1302
50°	1092
55°	803
60°	921
65°	1090
70°	705
75°	932
80°	1389
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 80°
Luminance: 1389 cd/sqm

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1259968
CATALOG NUMBER: P3AS13R309050DE010 E3D1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	450.8	33.4
10°-20°	702.5	52.0
20°-30°	163.1	12.1
30°-40°	25.3	1.9
40°-50°	4.3	0.3
50°-60°	2.0	0.1
60°-70°	1.7	0.1
70°-80°	1.2	0.1
80°-90°	0.1	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1316.4	97.4
0°-40°	1341.7	99.3
0°-60°	1348.0	99.8
0°-90°	1351.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1351.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	5017	
5°	4904	451
15°	2667	703
25°	281	163
35°	31	25
45°	4	4
55°	2	2
65°	2	2
75°	1	1
85°	0	0
90°	0	

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1259968
CATALOG NUMBER: P3AS13R309050DE010 E3D1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	5017.2
1°	5014.0
2°	5000.2
3°	4976.8
4°	4947.1
5°	4903.6
6°	4849.5
7°	4768.9
8°	4658.5
9°	4496.1
10°	4291.3
11°	4027.1
12°	3728.9
13°	3397.8
14°	3033.9
15°	2666.7
17.5°	1744.6
20°	984.8
22.5°	503.0
25°	281.2
27.5°	173.0
30°	106.1
32.5°	57.3
35°	30.8
37.5°	20.2
40°	12.7
42.5°	7.4
45°	4.2
47.5°	3.2
50°	3.2
52.5°	2.1
55°	2.1
57.5°	2.1
60°	2.1
62.5°	2.1
65°	2.1
67.5°	1.1
70°	1.1
72.5°	1.1
75°	1.1
77.5°	1.1
80°	1.1
82.5°	0.0
85°	0.0
87.5°	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1259968
CATALOG NUMBER: P3AS13R309050DE010 E3D1MW

CANDELA DISTRIBUTION (continued):

	0°
90°	*0.0*

(END OF REPORT)