

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1260630

Luminaire Tested: P3AS20R209050D010 E3D1LI

Issue Date: 1/29/2026

Test Information

Test Method: LM-79-2019
Report Number: P1260630
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2501-338-8)
Test Lab: INNOVATION CENTER
Issue Date: 1/29/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: IRiS
Catalog Number: P3AS20R209050D010 E3D1LI
Description: 3in Adjustable LED luminaire with, R20 optic, 5000K CCT AND, 90CRI , E3D1LI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 2315.0 lumens
Efficiency: N/A
Efficacy: 80.4 lumens/watt
Spacing Criteria (0/90/45): 0.35 / 0.35 / 0.34
Luminous Opening: Circular (Dia: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 28.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1260630
CATALOG NUMBER: P3AS20R209050D010 E3D1LI

Luminous Intensity Polar Plot

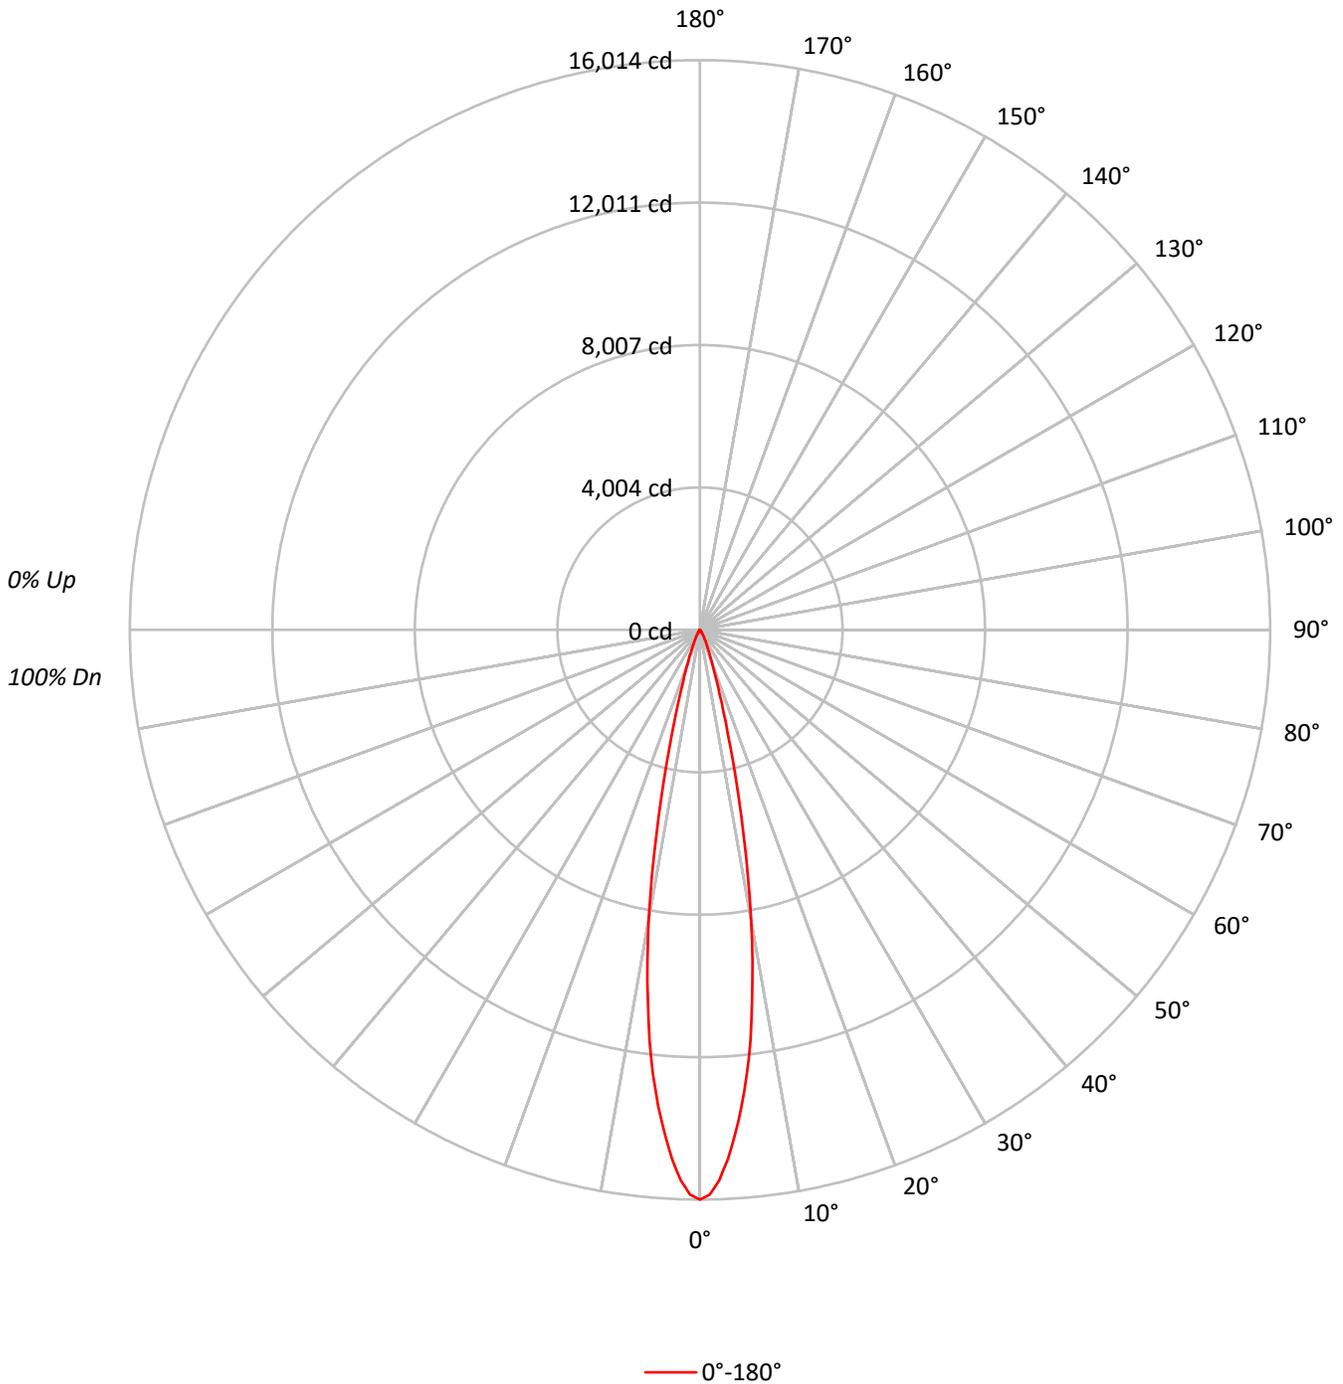



TEST NUMBER: P1260630
 CATALOG NUMBER: P3AS20R209050D010 E3D1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	99	100
1	115	114	112	110	113	111	110	108	107	106	105	104	103	102	100	100	99	97	97	97	97
2	112	109	106	104	110	107	105	103	104	102	101	101	100	98	99	98	96	95	95	95	95
3	109	105	102	99	107	104	101	98	101	99	97	99	97	95	97	95	94	93	93	93	93
4	106	101	98	95	105	100	97	95	99	96	94	97	95	93	95	93	92	91	91	91	91
5	104	98	95	92	102	98	94	92	96	93	91	95	92	90	93	91	90	89	89	89	89
6	101	96	92	89	100	95	92	89	94	91	89	93	90	88	92	89	88	87	87	87	87
7	99	93	90	87	98	93	89	87	92	89	86	91	88	86	90	87	86	85	85	85	85
8	97	91	87	85	96	91	87	85	90	87	85	89	86	84	88	86	84	83	83	83	83
9	95	89	85	83	94	89	85	83	88	85	83	87	84	83	87	84	82	81	81	81	81
10	93	87	84	81	92	87	83	81	86	83	81	86	83	81	85	83	81	80	80	80	80

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	3511670
5°	2956651
10°	1846704
15°	690401
20°	236994
25°	98764
30°	46513
35°	20826
40°	9847
45°	5055
50°	1842
55°	344
60°	395
65°	467
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 5055 cd/sqm



TEST NUMBER: P1260630
 CATALOG NUMBER: P3AS20R209050D010 E3D1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1117.0	48.3
10°-20°	920.1	39.7
20°-30°	209.1	9.0
30°-40°	53.2	2.3
40°-50°	13.4	0.6
50°-60°	1.7	0.1
60°-70°	0.6	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2246.1	97.0
0°-40°	2299.4	99.3
0°-60°	2314.4	100.0
0°-90°	2315.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2315.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	16014	
5°	13432	###
15°	3041	920
25°	408	209
35°	78	53
45°	16	13
55°	1	2
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P1260630
CATALOG NUMBER: P3AS20R209050D010 E3D1LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	16014.5
1°	15878.7
2°	15478.6
3°	14904.8
4°	14200.6
5°	13432.1
6°	12575.9
7°	11630.9
8°	10528.5
9°	9436.0
10°	8293.7
11°	7078.1
12°	5864.3
13°	4836.1
14°	3853.1
15°	3041.2
16°	2400.4
17°	1893.5
18°	1521.5
19°	1237.3
20°	1015.6
21°	849.0
22°	708.7
23°	589.2
24°	491.5
25°	408.2
27.5°	267.0
30°	183.7
32.5°	113.1
35°	77.8
37.5°	49.8
40°	34.4
42.5°	23.5
45°	16.3
47.5°	10.9
50°	5.4
52.5°	2.7
55°	0.9
57.5°	0.9
60°	0.9
62.5°	0.9
65°	0.9
67.5°	0.0
70°	0.0
72.5°	0.0



TEST NUMBER: P1260630
CATALOG NUMBER: P3AS20R209050D010 E3D1LI

CANDELA DISTRIBUTION (continued):

	0°
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)