

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1261001

Luminaire Tested: P3AS24R259050D010 E3D1LI

Issue Date: 1/29/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1261001  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2501-338-9)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/29/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3AS24R259050D010 E3D1LI  
Description: 3in Adjustable LED luminaire with, R25 optic, 5000K CCT AND, 90CRI , E3D1LI TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 2789.9 lumens  
Efficiency: N/A  
Efficacy: 96.9 lumens/watt  
Spacing Criteria (0/90/45): 0.44 / 0.44 / 0.4  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct

Input Watts (W): 28.8  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1261001

CATALOG NUMBER: P3AS24R259050D010 E3D1LI

### Luminous Intensity Polar Plot

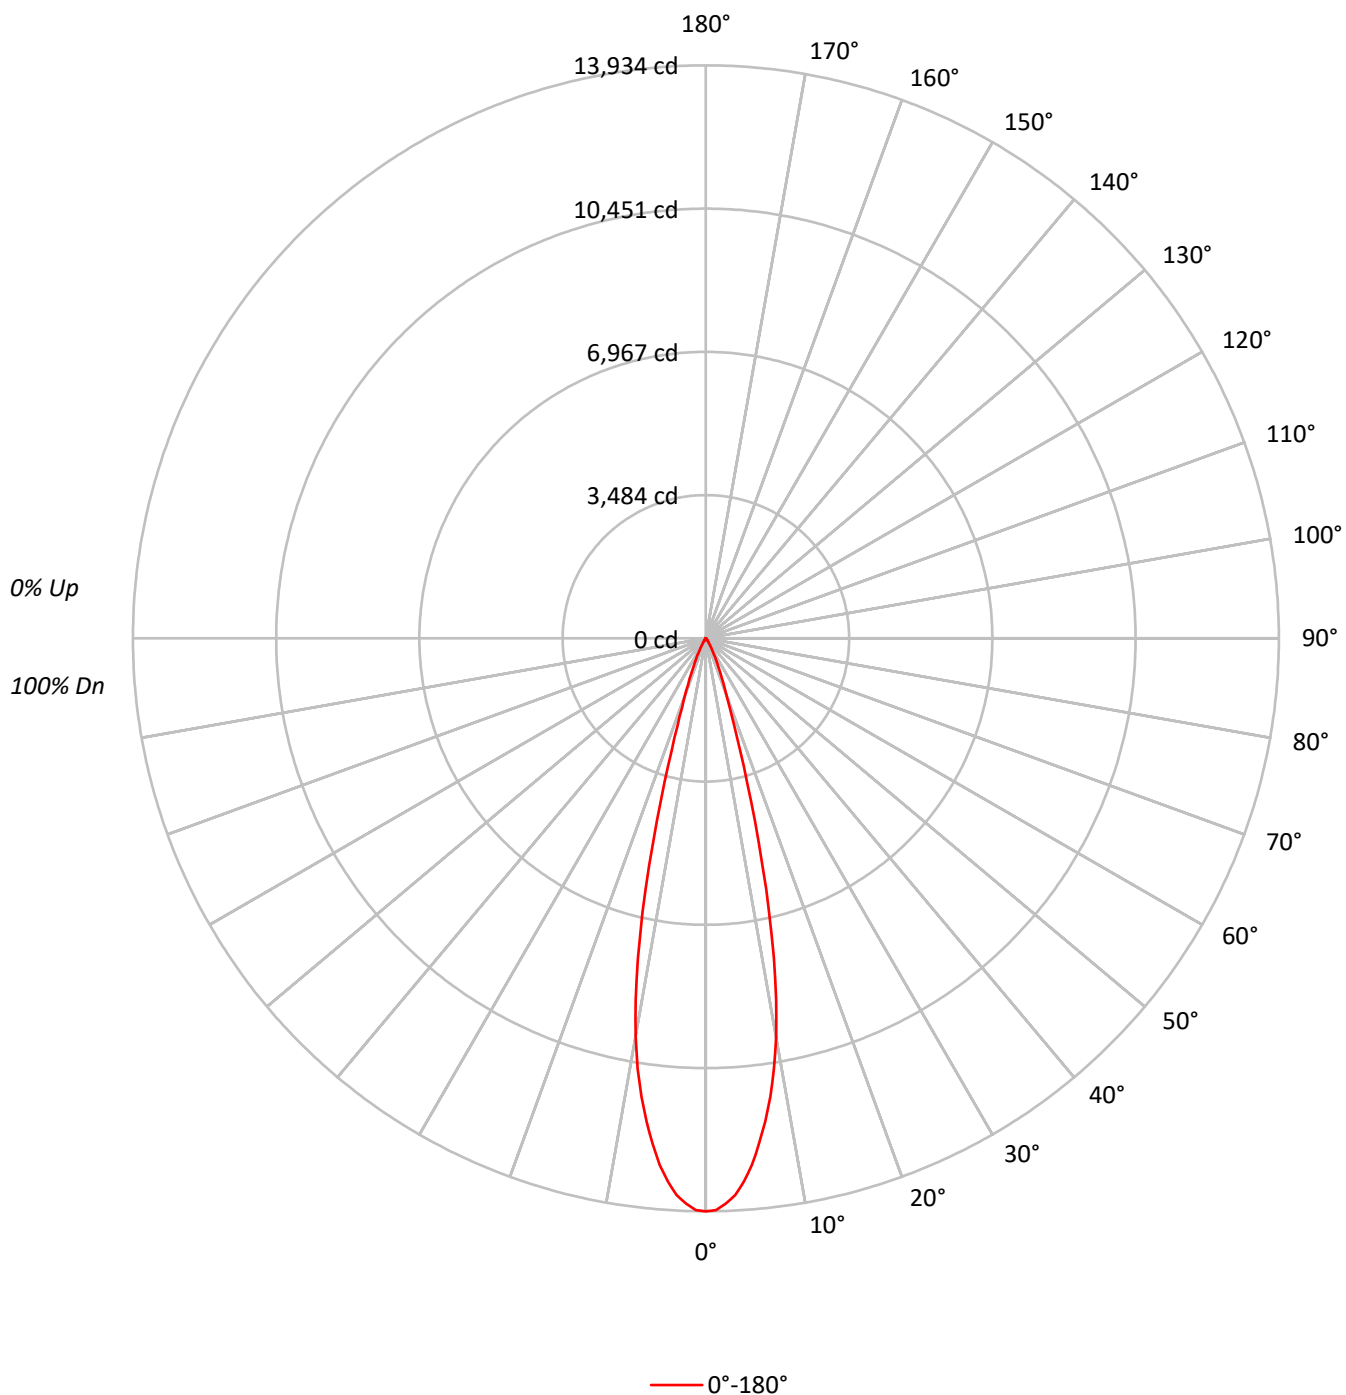

TEST NUMBER: P1261001

CATALOG NUMBER: P3AS24R259050D010 E3D1LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|-----|-----|-----|--|-----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |  | 20  |     |     |  | 20  |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |  | 30  |     |     |  | 10  |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  |  | 50  | 30  | 10  |  | 50  |
| RCR |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 |  | 106 | 106 | 106 |  | 102 |
| 1   | 115 | 113 | 111 | 110 | 113 | 111 | 110 | 108 | 107 | 106 | 105 |  | 104 | 103 | 102 |  | 100 |
| 2   | 112 | 108 | 106 | 103 | 110 | 107 | 104 | 102 | 104 | 102 | 100 |  | 101 | 99  | 98  |  | 98  |
| 3   | 109 | 104 | 101 | 98  | 107 | 103 | 100 | 97  | 100 | 98  | 96  |  | 98  | 96  | 94  |  | 96  |
| 4   | 106 | 101 | 97  | 94  | 104 | 100 | 96  | 94  | 98  | 95  | 92  |  | 96  | 93  | 91  |  | 94  |
| 5   | 103 | 97  | 93  | 91  | 101 | 96  | 93  | 90  | 95  | 92  | 90  |  | 93  | 91  | 89  |  | 92  |
| 6   | 100 | 94  | 90  | 88  | 99  | 94  | 90  | 87  | 92  | 89  | 87  |  | 91  | 88  | 86  |  | 90  |
| 7   | 98  | 92  | 88  | 85  | 97  | 91  | 87  | 85  | 90  | 87  | 84  |  | 89  | 86  | 84  |  | 88  |
| 8   | 95  | 89  | 85  | 83  | 94  | 89  | 85  | 83  | 88  | 85  | 82  |  | 87  | 84  | 82  |  | 86  |
| 9   | 93  | 87  | 83  | 81  | 92  | 86  | 83  | 80  | 86  | 83  | 80  |  | 85  | 82  | 80  |  | 84  |
| 10  | 91  | 85  | 81  | 79  | 90  | 84  | 81  | 79  | 84  | 81  | 78  |  | 83  | 80  | 78  |  | 83  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |         |
|-----|---------|
|     | 0°      |
| 0°  | 3055567 |
| 5°  | 2830545 |
| 10° | 2190028 |
| 15° | 1046022 |
| 20° | 344873  |
| 25° | 145387  |
| 30° | 56338   |
| 35° | 24360   |
| 40° | 8101    |
| 45° | 3752    |
| 50° | 1365    |
| 55° | 765     |
| 60° | 439     |
| 65° | 519     |
| 70° | 0       |
| 75° | 0       |
| 80° | 0       |
| 85° | 0       |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3752 cd/sqm

TEST NUMBER: P1261001

CATALOG NUMBER: P3AS24R259050D010 E3D1LI

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 1130.3 | 40.5      |
| 10°-20°   | 1285.6 | 46.1      |
| 20°-30°   | 298.7  | 10.7      |
| 30°-40°   | 62.7   | 2.2       |
| 40°-50°   | 10.1   | 0.4       |
| 50°-60°   | 1.7    | 0.1       |
| 60°-70°   | 0.9    | 0.0       |
| 70°-80°   | 0.0    | 0.0       |
| 80°-90°   | 0.0    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| <hr/>     |        |           |
| 0°-30°    | 2714.6 | 97.3      |
| 0°-40°    | 2777.3 | 99.5      |
| 0°-60°    | 2789.1 | 100.0     |
| 0°-90°    | 2789.9 | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 2789.9 | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°    | Flux |
|-----|-------|------|
| 0°  | 13934 |      |
| 5°  | 12859 | ###  |
| 15° | 4608  | 1286 |
| 25° | 601   | 299  |
| 35° | 91    | 63   |
| 45° | 12    | 10   |
| 55° | 2     | 2    |
| 65° | 1     | 1    |
| 75° | 0     | 0    |
| 85° | 0     | 0    |
| 90° | 0     |      |

TEST NUMBER: P1261001

CATALOG NUMBER: P3AS24R259050D010 E3D1LI

**CANDELA DISTRIBUTION (FULL):**

| 0°    |         |
|-------|---------|
| 0°    | 13934.5 |
| 1°    | 13906.2 |
| 2°    | 13761.5 |
| 3°    | 13558.2 |
| 4°    | 13247.7 |
| 5°    | 12859.2 |
| 6°    | 12360.5 |
| 7°    | 11838.5 |
| 8°    | 11252.8 |
| 9°    | 10592.3 |
| 10°   | 9835.6  |
| 11°   | 8958.6  |
| 12°   | 7952.0  |
| 13°   | 6849.4  |
| 14°   | 5696.2  |
| 15°   | 4607.7  |
| 16°   | 3644.7  |
| 17°   | 2839.5  |
| 18°   | 2233.6  |
| 19°   | 1786.5  |
| 20°   | 1477.9  |
| 21°   | 1235.1  |
| 22°   | 1036.9  |
| 23°   | 865.9   |
| 24°   | 724.3   |
| 25°   | 600.9   |
| 27.5° | 356.1   |
| 30°   | 222.5   |
| 32.5° | 142.6   |
| 35°   | 91.0    |
| 37.5° | 54.6    |
| 40°   | 28.3    |
| 42.5° | 18.2    |
| 45°   | 12.1    |
| 47.5° | 7.1     |
| 50°   | 4.0     |
| 52.5° | 2.0     |
| 55°   | 2.0     |
| 57.5° | 1.0     |
| 60°   | 1.0     |
| 62.5° | 1.0     |
| 65°   | 1.0     |
| 67.5° | 1.0     |
| 70°   | 0.0     |
| 72.5° | 0.0     |

TEST NUMBER: P1261001  
CATALOG NUMBER: P3AS24R259050D010 E3D1LI

**CANDELA DISTRIBUTION (continued):**

|       | 0°  |
|-------|-----|
| 75°   | 0.0 |
| 77.5° | 0.0 |
| 80°   | 0.0 |
| 82.5° | 0.0 |
| 85°   | 0.0 |
| 87.5° | 0.0 |
| 90°   | 0.0 |

(END OF REPORT)