

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1247573

Luminaire Tested: P3AS20R259024D010 E3CD1MMS

Issue Date: 1/30/2026

**Test Information**


Test Method: LM-79-2019  
Report Number: P1247573  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-12)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3AS20R259024D010 E3CD1MMS  
Description: 3in Adjustable LED luminaire with, R25 optic, 2400K CCT AND, 90CRI , E3CD1MMS TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1898.1 lumens  
Efficiency: N/A  
Efficacy: 65.9 lumens/watt  
Spacing Criteria (0/90/45): 0.45 / 0.45 / 0.41  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 28.8  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1247573  
CATALOG NUMBER: P3AS20R259024D010 E3CD1MMS

### Luminous Intensity Polar Plot

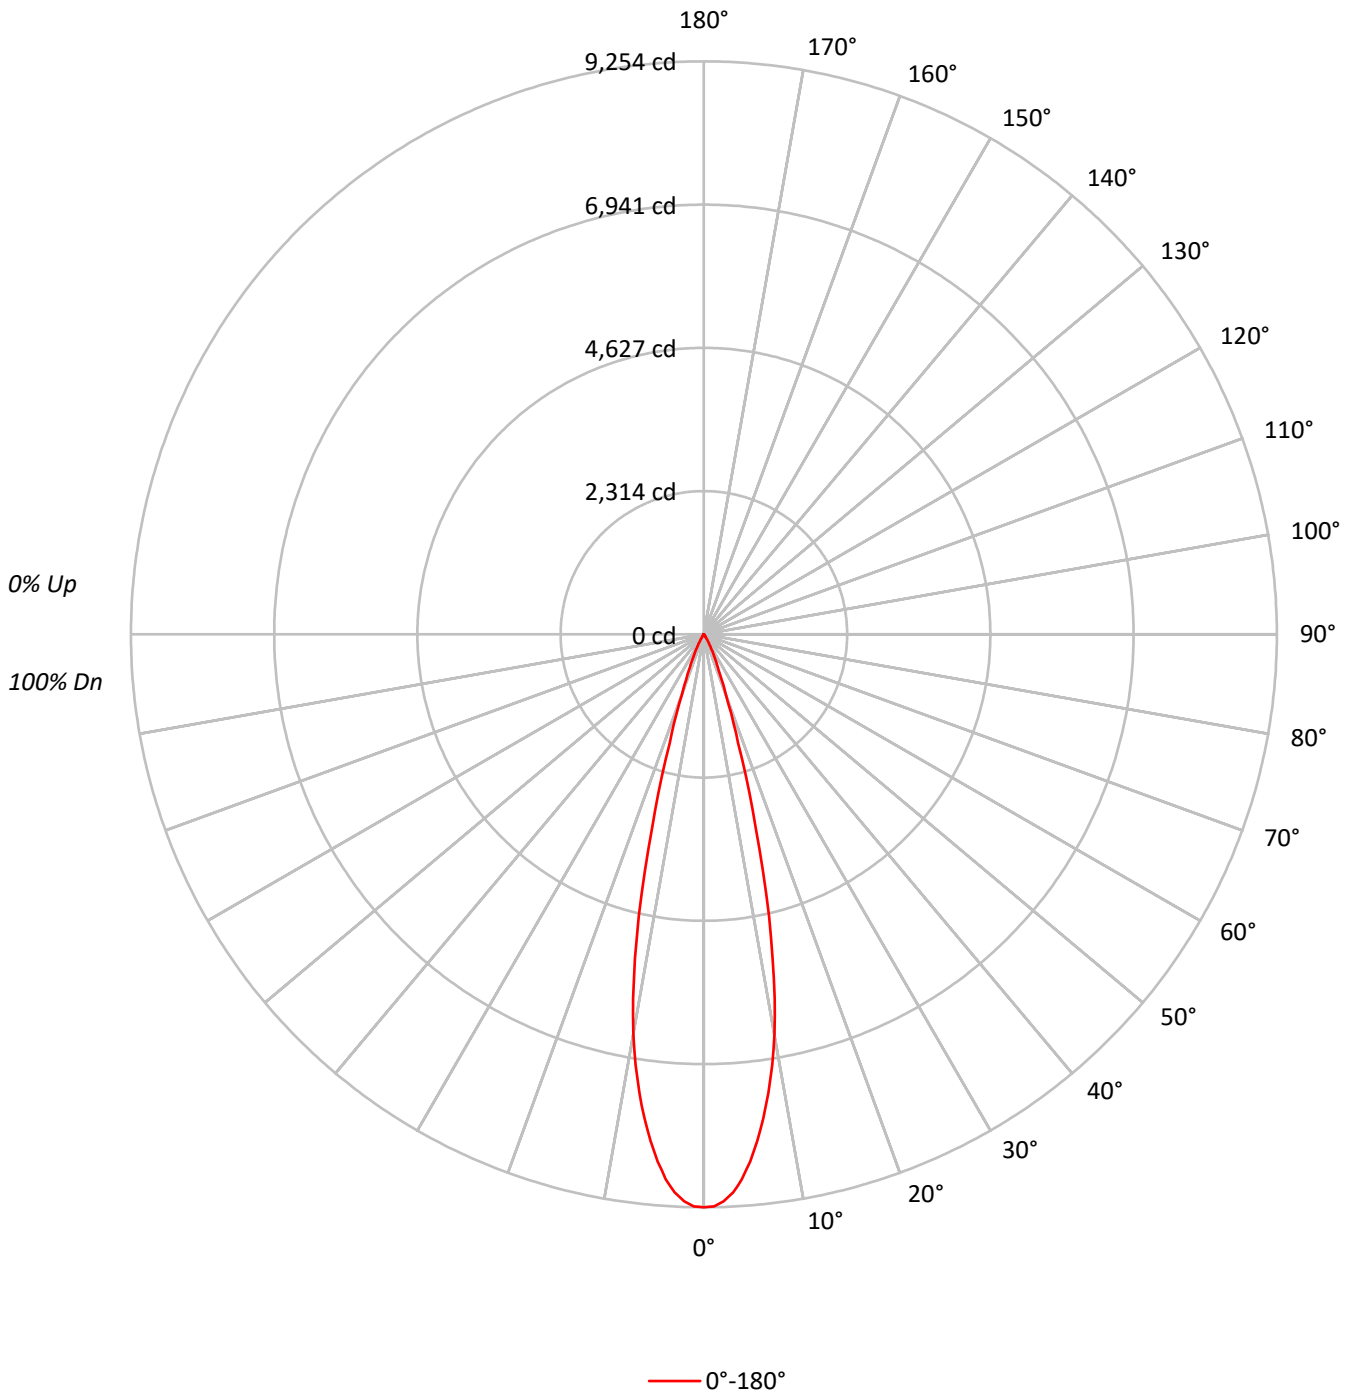



TEST NUMBER: P1247573  
 CATALOG NUMBER: P3AS20R259024D010 E3CD1MMS

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|-----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |    |    |     |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |     | 30  |     |     |     | 10  |     |    | 0  |     |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30 | 10 | 0   |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | 99 | 99 | 100 |
| 1   | 115 | 113 | 111 | 110 | 113 | 111 | 109 | 108 | 107 | 106 | 105 | 103 | 103 | 102 | 100 | 99  | 99  | 97  | 97 | 97 | 97  |
| 2   | 112 | 108 | 105 | 103 | 110 | 107 | 104 | 102 | 104 | 102 | 100 | 101 | 99  | 98  | 98  | 97  | 96  | 96  | 96 | 96 | 94  |
| 3   | 108 | 104 | 101 | 98  | 107 | 103 | 100 | 97  | 100 | 98  | 96  | 98  | 96  | 94  | 96  | 94  | 93  | 96  | 94 | 93 | 92  |
| 4   | 105 | 100 | 97  | 94  | 104 | 99  | 96  | 93  | 97  | 95  | 92  | 96  | 93  | 91  | 94  | 92  | 90  | 94  | 92 | 90 | 89  |
| 5   | 103 | 97  | 93  | 90  | 101 | 96  | 93  | 90  | 95  | 92  | 89  | 93  | 91  | 89  | 92  | 90  | 88  | 92  | 90 | 88 | 87  |
| 6   | 100 | 94  | 90  | 87  | 99  | 93  | 90  | 87  | 92  | 89  | 87  | 91  | 88  | 86  | 90  | 87  | 86  | 90  | 87 | 86 | 85  |
| 7   | 97  | 91  | 88  | 85  | 96  | 91  | 87  | 85  | 90  | 87  | 84  | 89  | 86  | 84  | 88  | 85  | 83  | 88  | 85 | 83 | 83  |
| 8   | 95  | 89  | 85  | 83  | 94  | 89  | 85  | 82  | 88  | 84  | 82  | 87  | 84  | 82  | 86  | 83  | 81  | 86  | 83 | 81 | 81  |
| 9   | 93  | 87  | 83  | 80  | 92  | 86  | 83  | 80  | 86  | 82  | 80  | 85  | 82  | 80  | 84  | 82  | 80  | 84  | 82 | 80 | 79  |
| 10  | 91  | 85  | 81  | 78  | 90  | 84  | 81  | 78  | 84  | 80  | 78  | 83  | 80  | 78  | 82  | 80  | 78  | 82  | 80 | 78 | 77  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |         |
|-----|---------|
|     | 0°      |
| 0°  | 2029245 |
| 5°  | 1882055 |
| 10° | 1459581 |
| 15° | 731877  |
| 20° | 240448  |
| 25° | 95618   |
| 30° | 35879   |
| 35° | 10386   |
| 40° | 4695    |
| 45° | 1861    |
| 50° | 1535    |
| 55° | 1147    |
| 60° | 1316    |
| 65° | 1557    |
| 70° | 962     |
| 75° | 1271    |
| 80° | 1894    |
| 85° | 0       |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 80°  
 Luminance: 1894 cd/sqm



TEST NUMBER: P1247573  
 CATALOG NUMBER: P3AS20R259024D010 E3CD1MMS

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 752.1  | 39.6      |
| 10°-20°   | 897.2  | 47.3      |
| 20°-30°   | 202.3  | 10.7      |
| 30°-40°   | 32.8   | 1.7       |
| 40°-50°   | 5.9    | 0.3       |
| 50°-60°   | 3.2    | 0.2       |
| 60°-70°   | 2.8    | 0.1       |
| 70°-80°   | 1.6    | 0.1       |
| 80°-90°   | 0.2    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 1851.6 | 97.6      |
| 0°-40°    | 1884.4 | 99.3      |
| 0°-60°    | 1893.5 | 99.8      |
| 0°-90°    | 1898.1 | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 1898.1 | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 9254 |      |
| 5°  | 8550 | 752  |
| 15° | 3224 | 897  |
| 25° | 395  | 202  |
| 35° | 39   | 33   |
| 45° | 6    | 6    |
| 55° | 3    | 3    |
| 65° | 3    | 3    |
| 75° | 2    | 2    |
| 85° | 0    | 0    |
| 90° | 0    |      |



TEST NUMBER: P1247573  
CATALOG NUMBER: P3AS20R259024D010 E3CD1MMS

**CANDELA DISTRIBUTION (FULL):**

| 0°    |        |
|-------|--------|
| 0°    | 9254.1 |
| 1°    | 9239.2 |
| 2°    | 9164.6 |
| 3°    | 9027.4 |
| 4°    | 8820.1 |
| 5°    | 8550.2 |
| 6°    | 8228.2 |
| 7°    | 7879.2 |
| 8°    | 7479.6 |
| 9°    | 7042.7 |
| 10°   | 6555.1 |
| 11°   | 5992.9 |
| 12°   | 5345.8 |
| 13°   | 4668.8 |
| 14°   | 3942.6 |
| 15°   | 3223.9 |
| 17.5° | 1837.1 |
| 20°   | 1030.4 |
| 22.5° | 621.8  |
| 25°   | 395.2  |
| 27.5° | 243.1  |
| 30°   | 141.7  |
| 32.5° | 74.6   |
| 35°   | 38.8   |
| 37.5° | 25.3   |
| 40°   | 16.4   |
| 42.5° | 10.4   |
| 45°   | 6.0    |
| 47.5° | 4.5    |
| 50°   | 4.5    |
| 52.5° | 4.5    |
| 55°   | 3.0    |
| 57.5° | 3.0    |
| 60°   | 3.0    |
| 62.5° | 3.0    |
| 65°   | 3.0    |
| 67.5° | 3.0    |
| 70°   | 1.5    |
| 72.5° | 1.5    |
| 75°   | 1.5    |
| 77.5° | 1.5    |
| 80°   | 1.5    |
| 82.5° | 0.0    |
| 85°   | 0.0    |
| 87.5° | 0.0    |



TEST NUMBER: P1247573  
CATALOG NUMBER: P3AS20R259024D010 E3CD1MMS

CANDELA DISTRIBUTION (continued):

0°  
90° | 0.0

(END OF REPORT)