

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1261482

Luminaire Tested: P3AS02R309727DE010 E3DL1H

Issue Date: 1/30/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1261482  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-15)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3AS02R309727DE010 E3DL1H  
Description: 3in Adjustable LED luminaire with, R30 optic, 2700K CCT AND, 97CRI , E3DL1H TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 215.9 lumens  
Efficiency: N/A  
Efficacy: 60.0 lumens/watt  
Spacing Criteria (0/90/45): 0.54 / 0.54 / 0.54  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct

Input Watts (W): 3.6  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1261482

CATALOG NUMBER: P3AS02R309727DE010 E3DL1H

### Luminous Intensity Polar Plot

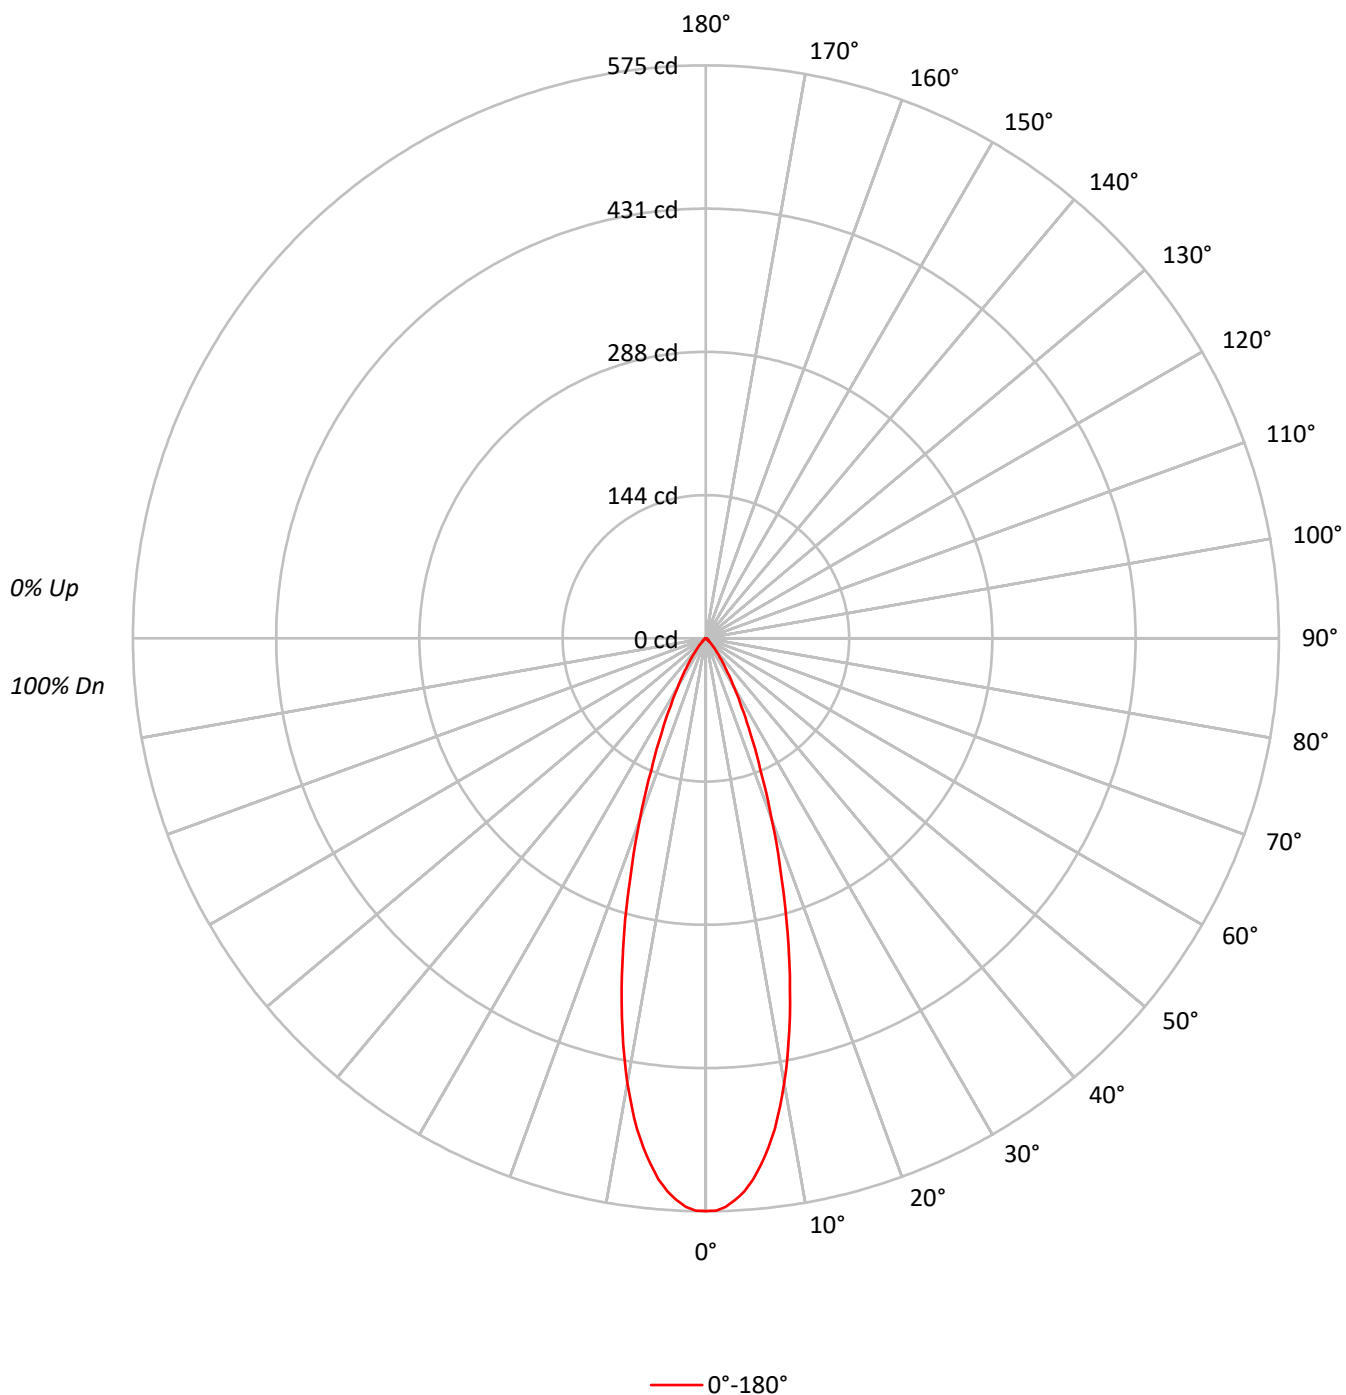

TEST NUMBER: P1261482

CATALOG NUMBER: P3AS02R309727DE010 E3DL1H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| RF  | 20  |     |     |     | 20  |     |     |     |     | 20  |     |     |     |     | 20  |     |     |     |     | 20  |
| RC  | 80  |     |     |     | 70  |     |     |     |     | 50  |     |     |     |     | 30  |     |     |     |     | 10  |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | 100 | 100 |
| 1   | 114 | 112 | 110 | 108 | 112 | 110 | 108 | 106 | 106 | 104 | 103 | 102 | 101 | 100 | 99  | 98  | 97  | 95  | 95  | 95  |
| 2   | 110 | 105 | 102 | 99  | 108 | 104 | 101 | 98  | 101 | 98  | 96  | 98  | 96  | 94  | 95  | 93  | 92  | 90  | 90  | 90  |
| 3   | 105 | 100 | 96  | 92  | 103 | 98  | 95  | 91  | 96  | 93  | 90  | 94  | 91  | 89  | 91  | 89  | 87  | 86  | 86  | 86  |
| 4   | 101 | 95  | 90  | 87  | 99  | 94  | 89  | 86  | 92  | 88  | 85  | 90  | 87  | 84  | 88  | 85  | 83  | 82  | 82  | 82  |
| 5   | 97  | 90  | 85  | 82  | 96  | 89  | 85  | 81  | 88  | 84  | 81  | 86  | 83  | 80  | 85  | 82  | 79  | 78  | 78  | 78  |
| 6   | 94  | 86  | 81  | 78  | 92  | 85  | 81  | 77  | 84  | 80  | 77  | 83  | 79  | 76  | 81  | 78  | 76  | 75  | 75  | 75  |
| 7   | 90  | 82  | 77  | 74  | 89  | 82  | 77  | 74  | 81  | 76  | 73  | 80  | 76  | 73  | 79  | 75  | 73  | 72  | 72  | 72  |
| 8   | 87  | 79  | 74  | 71  | 86  | 79  | 74  | 71  | 78  | 73  | 70  | 77  | 73  | 70  | 76  | 72  | 70  | 69  | 69  | 69  |
| 9   | 84  | 76  | 71  | 68  | 83  | 75  | 71  | 68  | 75  | 70  | 67  | 74  | 70  | 67  | 73  | 70  | 67  | 66  | 66  | 66  |
| 10  | 81  | 73  | 68  | 65  | 80  | 73  | 68  | 65  | 72  | 68  | 65  | 71  | 67  | 65  | 71  | 67  | 65  | 63  | 63  | 63  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |        |
|-----|--------|
|     | 0°     |
| 0°  | 126043 |
| 5°  | 119964 |
| 10° | 100911 |
| 15° | 72781  |
| 20° | 45131  |
| 25° | 25671  |
| 30° | 14255  |
| 35° | 7763   |
| 40° | 4093   |
| 45° | 2202   |
| 50° | 1194   |
| 55° | 765    |
| 60° | 702    |
| 65° | 726    |
| 70° | 641    |
| 75° | 508    |
| 80° | 505    |
| 85° | 503    |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2202 cd/sqm

TEST NUMBER: P1261482

CATALOG NUMBER: P3AS02R309727DE010 E3DL1H

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 49.1   | 22.7      |
| 10°-20°   | 87.2   | 40.4      |
| 20°-30°   | 50.4   | 23.3      |
| 30°-40°   | 19.1   | 8.9       |
| 40°-50°   | 5.9    | 2.7       |
| 50°-60°   | 1.9    | 0.9       |
| 60°-70°   | 1.3    | 0.6       |
| 70°-80°   | 0.7    | 0.3       |
| 80°-90°   | 0.2    | 0.1       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| <hr/>     |        |           |
| 0°-30°    | 186.7  | 86.5      |
| 0°-40°    | 205.9  | 95.3      |
| 0°-60°    | 213.7  | 99.0      |
| 0°-90°    | 215.9  | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 215.9  | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°  | Flux |
|-----|-----|------|
| 0°  | 575 |      |
| 5°  | 545 | 49   |
| 15° | 321 | 87   |
| 25° | 106 | 50   |
| 35° | 29  | 19   |
| 45° | 7   | 6    |
| 55° | 2   | 2    |
| 65° | 1   | 1    |
| 75° | 1   | 1    |
| 85° | 0   | 0    |
| 90° | 0   |      |

TEST NUMBER: P1261482

CATALOG NUMBER: P3AS02R309727DE010 E3DL1H

**CANDELA DISTRIBUTION (FULL):**

| 0°    |       |
|-------|-------|
| 0°    | 574.8 |
| 1°    | 574.4 |
| 2°    | 570.9 |
| 3°    | 564.4 |
| 4°    | 556.2 |
| 5°    | 545.0 |
| 6°    | 530.7 |
| 7°    | 514.8 |
| 8°    | 497.1 |
| 9°    | 475.8 |
| 10°   | 453.2 |
| 11°   | 428.7 |
| 12°   | 402.8 |
| 13°   | 375.7 |
| 14°   | 348.1 |
| 15°   | 320.6 |
| 17.5° | 252.8 |
| 20°   | 193.4 |
| 22.5° | 143.4 |
| 25°   | 106.1 |
| 27.5° | 77.1  |
| 30°   | 56.3  |
| 32.5° | 40.6  |
| 35°   | 29.0  |
| 37.5° | 20.2  |
| 40°   | 14.3  |
| 42.5° | 10.0  |
| 45°   | 7.1   |
| 47.5° | 4.9   |
| 50°   | 3.5   |
| 52.5° | 2.4   |
| 55°   | 2.0   |
| 57.5° | 1.8   |
| 60°   | 1.6   |
| 62.5° | 1.4   |
| 65°   | 1.4   |
| 67.5° | 1.2   |
| 70°   | 1.0   |
| 72.5° | 0.8   |
| 75°   | 0.6   |
| 77.5° | 0.6   |
| 80°   | 0.4   |
| 82.5° | 0.4   |
| 85°   | 0.2   |
| 87.5° | 0.0   |



TEST NUMBER: P1261482  
CATALOG NUMBER: P3AS02R309727DE010 E3DL1H

CANDELA DISTRIBUTION (continued):

0°  
90° | 0.0

(END OF REPORT)