

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1269432

Luminaire Tested: P3AS09R359740DE010 E3CD1MMS

Issue Date: 1/30/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1269432  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-20)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3AS09R359740DE010 E3CD1MMS  
Description: 3in Adjustable LED luminaire with, R35 optic, 4000K CCT AND, 97CRI , E3CD1MMS TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 899.9 lumens  
Efficiency: N/A  
Efficacy: 81.1 lumens/watt  
Spacing Criteria (0/90/45): 0.58 / 0.58 / 0.52  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct

Input Watts (W): 11.1  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1269432

CATALOG NUMBER: P3AS09R359740DE010 E3CD1MMS

### Luminous Intensity Polar Plot

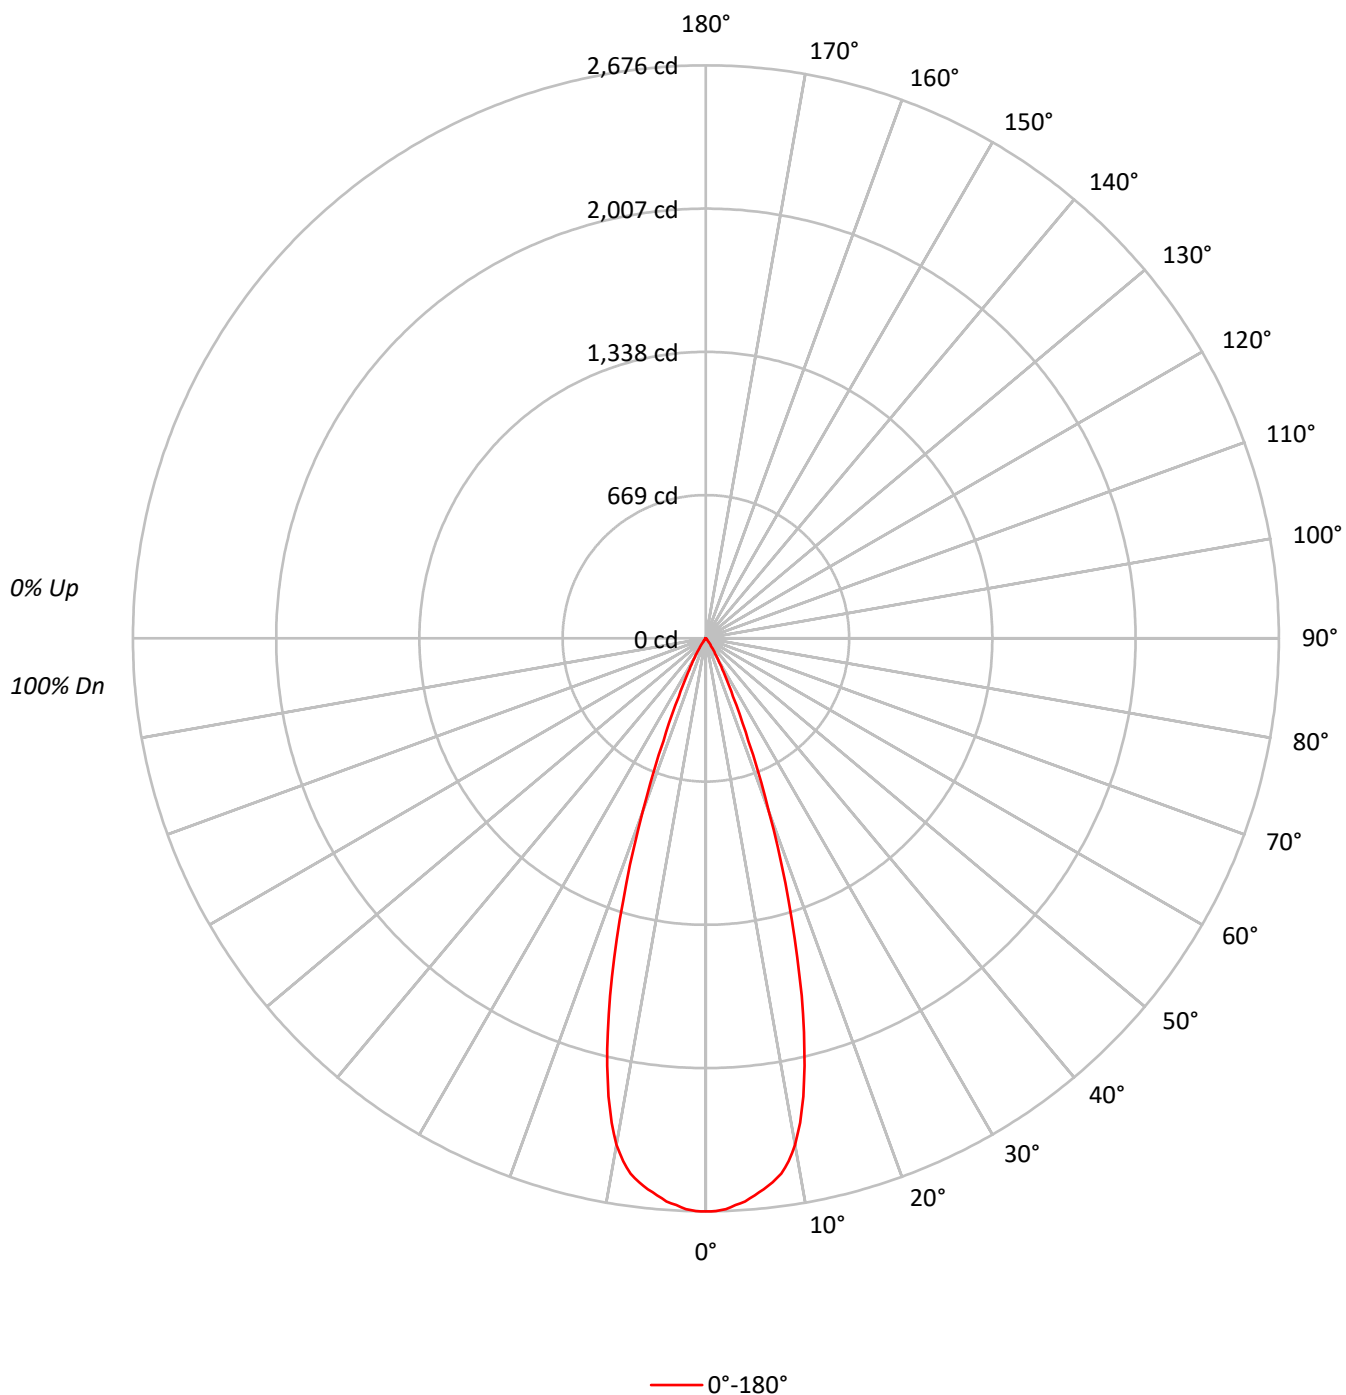

TEST NUMBER: P1269432

CATALOG NUMBER: P3AS09R359740DE010 E3CD1MMS

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|-----|-----|-----|--|-----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |  | 20  |     |     |  | 20  |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |  | 30  |     |     |  | 10  |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  |  | 50  | 30  | 10  |  | 50  |
| RCR |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 |  | 106 | 106 | 106 |  | 102 |
| 1   | 115 | 113 | 111 | 109 | 112 | 110 | 109 | 107 | 106 | 105 | 104 |  | 103 | 102 | 101 |  | 99  |
| 2   | 111 | 107 | 104 | 101 | 109 | 105 | 103 | 100 | 102 | 100 | 98  |  | 99  | 98  | 96  |  | 97  |
| 3   | 107 | 102 | 98  | 95  | 105 | 101 | 98  | 95  | 98  | 96  | 93  |  | 96  | 94  | 92  |  | 94  |
| 4   | 104 | 98  | 94  | 91  | 102 | 97  | 93  | 90  | 95  | 92  | 89  |  | 93  | 90  | 88  |  | 91  |
| 5   | 100 | 94  | 90  | 87  | 99  | 93  | 89  | 86  | 92  | 88  | 86  |  | 90  | 87  | 85  |  | 89  |
| 6   | 97  | 91  | 86  | 83  | 96  | 90  | 86  | 83  | 89  | 85  | 82  |  | 87  | 84  | 82  |  | 86  |
| 7   | 94  | 87  | 83  | 80  | 93  | 87  | 83  | 80  | 86  | 82  | 79  |  | 85  | 81  | 79  |  | 84  |
| 8   | 91  | 84  | 80  | 77  | 90  | 84  | 80  | 77  | 83  | 79  | 77  |  | 82  | 79  | 76  |  | 81  |
| 9   | 89  | 82  | 77  | 74  | 88  | 81  | 77  | 74  | 80  | 77  | 74  |  | 80  | 76  | 74  |  | 79  |
| 10  | 86  | 79  | 75  | 72  | 85  | 79  | 75  | 72  | 78  | 74  | 72  |  | 77  | 74  | 72  |  | 77  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |        |
|-----|--------|
|     | 0°     |
| 0°  | 586861 |
| 5°  | 574905 |
| 10° | 534838 |
| 15° | 392125 |
| 20° | 200777 |
| 25° | 72367  |
| 30° | 28182  |
| 35° | 9878   |
| 40° | 4065   |
| 45° | 1085   |
| 50° | 955    |
| 55° | 1070   |
| 60° | 921    |
| 65° | 726    |
| 70° | 898    |
| 75° | 1186   |
| 80° | 884    |
| 85° | 0      |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle: 75°

Luminance: 1186 cd/sqm

TEST NUMBER: P1269432

CATALOG NUMBER: P3AS09R359740DE010 E3CD1MMS

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 243.5  | 27.1      |
| 10°-20°   | 456.8  | 50.8      |
| 20°-30°   | 161.7  | 18.0      |
| 30°-40°   | 28.3   | 3.1       |
| 40°-50°   | 4.1    | 0.5       |
| 50°-60°   | 2.3    | 0.3       |
| 60°-70°   | 1.6    | 0.2       |
| 70°-80°   | 1.2    | 0.1       |
| 80°-90°   | 0.3    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| <hr/>     |        |           |
| 0°-30°    | 862.1  | 95.8      |
| 0°-40°    | 890.4  | 98.9      |
| 0°-60°    | 896.8  | 99.7      |
| 0°-90°    | 899.9  | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 899.9  | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 2676 |      |
| 5°  | 2612 | 243  |
| 15° | 1727 | 457  |
| 25° | 299  | 162  |
| 35° | 37   | 28   |
| 45° | 4    | 4    |
| 55° | 3    | 2    |
| 65° | 1    | 2    |
| 75° | 1    | 1    |
| 85° | 0    | 0    |
| 90° | 0    |      |

TEST NUMBER: P1269432

CATALOG NUMBER: P3AS09R359740DE010 E3CD1MMS

**CANDELA DISTRIBUTION (FULL):**

| 0°    |        |
|-------|--------|
| 0°    | 2676.3 |
| 1°    | 2675.6 |
| 2°    | 2667.1 |
| 3°    | 2650.8 |
| 4°    | 2635.9 |
| 5°    | 2611.8 |
| 6°    | 2587.0 |
| 7°    | 2559.3 |
| 8°    | 2525.3 |
| 9°    | 2472.2 |
| 10°   | 2402.0 |
| 11°   | 2304.9 |
| 12°   | 2188.0 |
| 13°   | 2049.0 |
| 14°   | 1895.9 |
| 15°   | 1727.3 |
| 17.5° | 1286.4 |
| 20°   | 860.4  |
| 22.5° | 518.8  |
| 25°   | 299.1  |
| 27.5° | 178.6  |
| 30°   | 111.3  |
| 32.5° | 64.5   |
| 35°   | 36.9   |
| 37.5° | 23.4   |
| 40°   | 14.2   |
| 42.5° | 7.1    |
| 45°   | 3.5    |
| 47.5° | 2.8    |
| 50°   | 2.8    |
| 52.5° | 2.8    |
| 55°   | 2.8    |
| 57.5° | 2.1    |
| 60°   | 2.1    |
| 62.5° | 2.1    |
| 65°   | 1.4    |
| 67.5° | 1.4    |
| 70°   | 1.4    |
| 72.5° | 1.4    |
| 75°   | 1.4    |
| 77.5° | 0.7    |
| 80°   | 0.7    |
| 82.5° | 0.7    |
| 85°   | 0.0    |
| 87.5° | 0.0    |



TEST NUMBER: P1269432  
CATALOG NUMBER: P3AS09R359740DE010 E3CD1MMS

CANDELA DISTRIBUTION (continued):

0°  
90° | 0.0

(END OF REPORT)