

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1269712

Luminaire Tested: P3AS13R129740DE010 E3DLP1MW

Issue Date: 1/30/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1269712  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-1)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3AS13R129740DE010 E3DLP1MW  
Description: 3in Adjustable LED luminaire with, R12 optic, 4000K CCT AND, 97CRI , E3DLP1MW TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 526.0 lumens  
Efficiency: N/A  
Efficacy: 33.9 lumens/watt  
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.61  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct

Input Watts (W): 15.5  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1269712

CATALOG NUMBER: P3AS13R129740DE010 E3DLP1MW

### Luminous Intensity Polar Plot

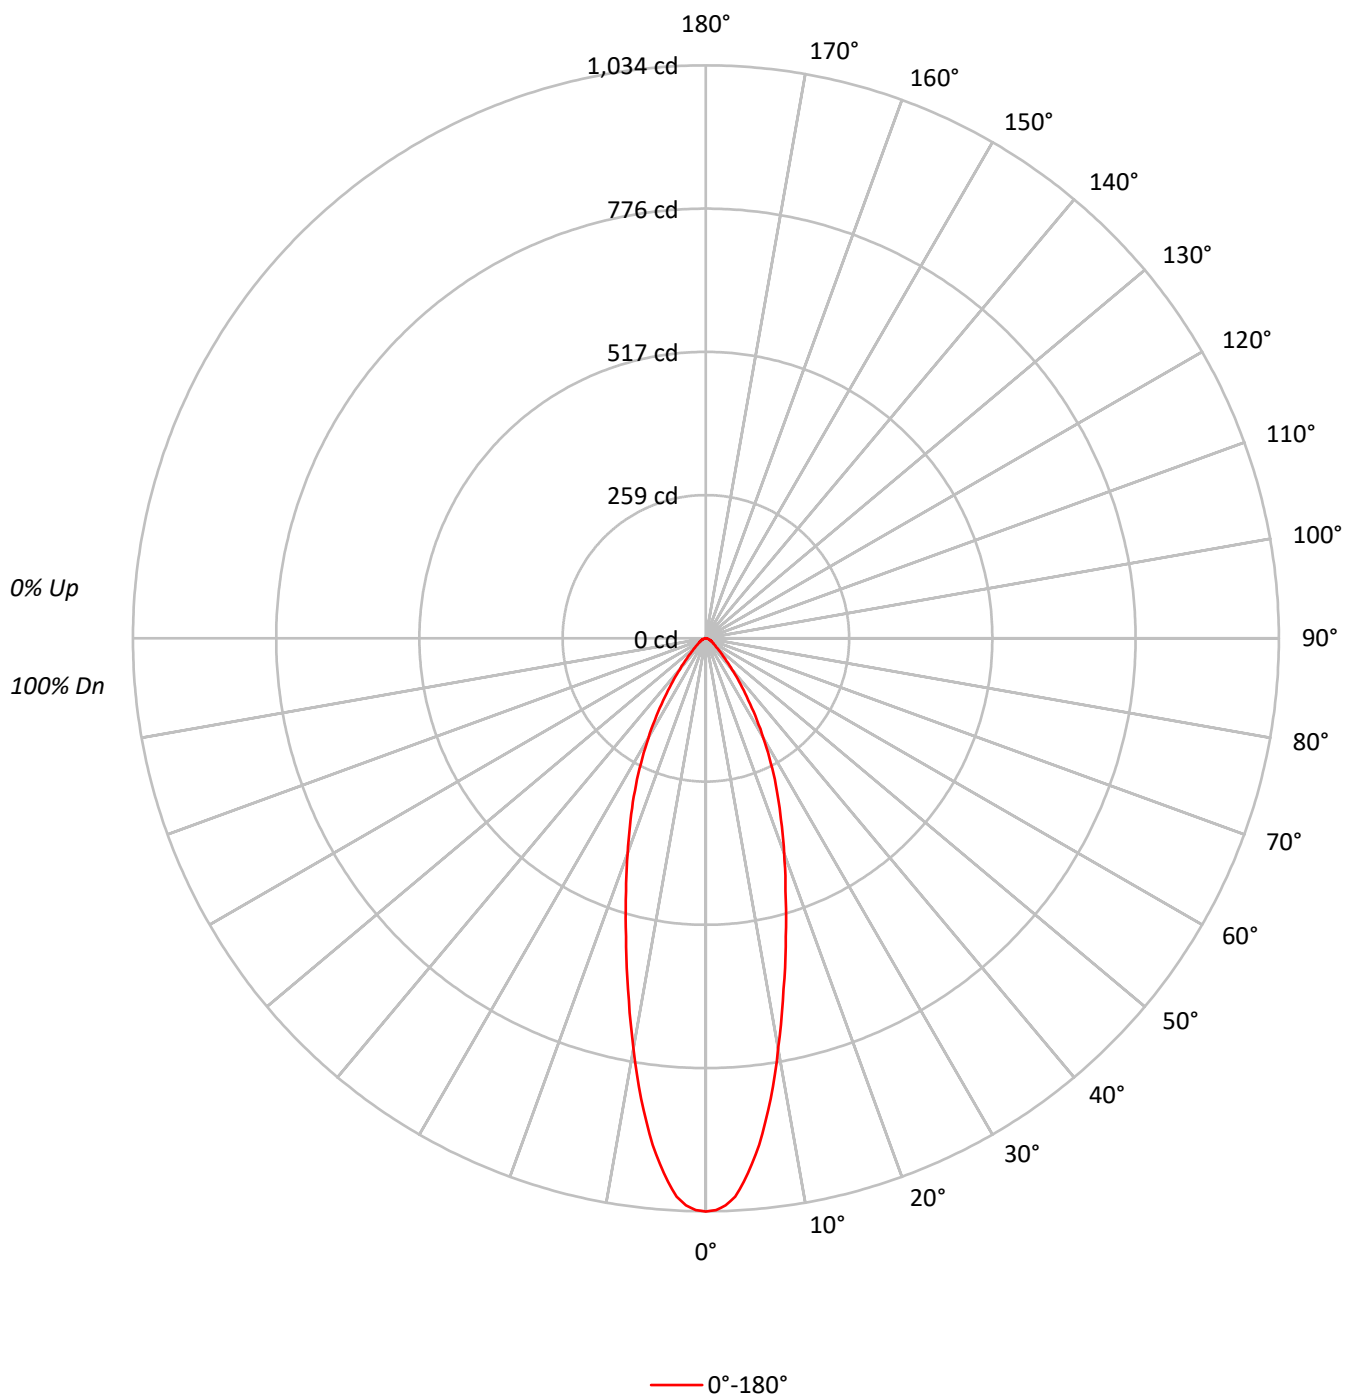

TEST NUMBER: P1269712

CATALOG NUMBER: P3AS13R129740DE010 E3DLP1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|-----|-----|-----|--|-----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |  | 20  |     |     |  | 20  |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |  | 30  |     |     |  | 10  |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  |  | 50  | 30  | 10  |  | 50  |
| RCR |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 |  | 106 | 106 | 106 |  | 102 |
| 1   | 113 | 110 | 108 | 106 | 111 | 108 | 106 | 104 | 104 | 102 | 101 |  | 100 | 99  | 98  |  | 97  |
| 2   | 108 | 103 | 98  | 95  | 105 | 101 | 97  | 94  | 98  | 95  | 92  |  | 95  | 92  | 90  |  | 92  |
| 3   | 102 | 96  | 91  | 87  | 100 | 94  | 90  | 86  | 92  | 88  | 85  |  | 89  | 86  | 83  |  | 87  |
| 4   | 97  | 90  | 84  | 80  | 95  | 88  | 83  | 79  | 86  | 82  | 78  |  | 84  | 81  | 78  |  | 82  |
| 5   | 93  | 84  | 78  | 74  | 91  | 83  | 78  | 74  | 81  | 77  | 73  |  | 80  | 76  | 72  |  | 78  |
| 6   | 88  | 79  | 73  | 69  | 87  | 79  | 73  | 69  | 77  | 72  | 69  |  | 76  | 71  | 68  |  | 74  |
| 7   | 84  | 75  | 69  | 65  | 83  | 74  | 69  | 65  | 73  | 68  | 64  |  | 72  | 67  | 64  |  | 71  |
| 8   | 80  | 71  | 65  | 61  | 79  | 71  | 65  | 61  | 69  | 64  | 61  |  | 68  | 64  | 61  |  | 67  |
| 9   | 77  | 68  | 62  | 58  | 76  | 67  | 62  | 58  | 66  | 61  | 58  |  | 65  | 61  | 57  |  | 64  |
| 10  | 74  | 64  | 59  | 55  | 73  | 64  | 59  | 55  | 63  | 58  | 55  |  | 62  | 58  | 55  |  | 62  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |        |
|-----|--------|
|     | 0°     |
| 0°  | 226824 |
| 5°  | 209641 |
| 10° | 167376 |
| 15° | 126425 |
| 20° | 96282  |
| 25° | 73359  |
| 30° | 52565  |
| 35° | 34291  |
| 40° | 21039  |
| 45° | 12714  |
| 50° | 8460   |
| 55° | 6537   |
| 60° | 5614   |
| 65° | 4877   |
| 70° | 4360   |
| 75° | 4321   |
| 80° | 3283   |
| 85° | 2264   |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 12714 cd/sqm

TEST NUMBER: P1269712

CATALOG NUMBER: P3AS13R129740DE010 E3DLP1MW

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 84.4   | 16.0      |
| 10°-20°   | 155.7  | 29.6      |
| 20°-30°   | 138.6  | 26.3      |
| 30°-40°   | 82.0   | 15.6      |
| 40°-50°   | 33.7   | 6.4       |
| 50°-60°   | 15.8   | 3.0       |
| 60°-70°   | 9.6    | 1.8       |
| 70°-80°   | 5.1    | 1.0       |
| 80°-90°   | 1.3    | 0.2       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| <hr/>     |        |           |
| 0°-30°    | 378.6  | 72.0      |
| 0°-40°    | 460.6  | 87.6      |
| 0°-60°    | 510.1  | 97.0      |
| 0°-90°    | 526.0  | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 526.0  | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 1034 |      |
| 5°  | 952  | 84   |
| 15° | 557  | 156  |
| 25° | 303  | 139  |
| 35° | 128  | 82   |
| 45° | 41   | 34   |
| 55° | 17   | 16   |
| 65° | 9    | 10   |
| 75° | 5    | 5    |
| 85° | 1    | 1    |
| 90° | 0    |      |

TEST NUMBER: P1269712

CATALOG NUMBER: P3AS13R129740DE010 E3DLP1MW

**CANDELA DISTRIBUTION (FULL):**

| 0°    |        |
|-------|--------|
| 0°    | 1034.4 |
| 1°    | 1031.8 |
| 2°    | 1024.1 |
| 3°    | 1008.8 |
| 4°    | 983.1  |
| 5°    | 952.4  |
| 6°    | 919.1  |
| 7°    | 879.8  |
| 8°    | 838.8  |
| 9°    | 796.9  |
| 10°   | 751.7  |
| 12.5° | 648.3  |
| 15°   | 556.9  |
| 17.5° | 478.3  |
| 20°   | 412.6  |
| 22.5° | 354.5  |
| 25°   | 303.2  |
| 27.5° | 253.7  |
| 30°   | 207.6  |
| 32.5° | 165.7  |
| 35°   | 128.1  |
| 37.5° | 98.2   |
| 40°   | 73.5   |
| 42.5° | 54.7   |
| 45°   | 41.0   |
| 47.5° | 31.6   |
| 50°   | 24.8   |
| 52.5° | 20.5   |
| 55°   | 17.1   |
| 57.5° | 14.5   |
| 60°   | 12.8   |
| 62.5° | 11.1   |
| 65°   | 9.4    |
| 67.5° | 8.5    |
| 70°   | 6.8    |
| 72.5° | 6.0    |
| 75°   | 5.1    |
| 77.5° | 3.4    |
| 80°   | 2.6    |
| 82.5° | 1.7    |
| 85°   | 0.9    |
| 87.5° | 0.9    |
| 90°   | 0.0    |

(END OF REPORT)