

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1273707

Luminaire Tested: P3AS09R359830DE010 E3DLD1GPH

Issue Date: 1/30/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1273707  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-18)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3AS09R359830DE010 E3DLD1GPH  
Description: 3in Adjustable LED luminaire with, R35 optic, 3000K CCT AND, 98CRI , E3DLD1GPH TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 217.0 lumens  
Efficiency: N/A  
Efficacy: 19.7 lumens/watt  
Spacing Criteria (0/90/45): 0.8 / 0.8 / 0.87  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct

Input Watts (W): 11  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1273707

CATALOG NUMBER: P3AS09R359830DE010 E3DLD1GPH

### Luminous Intensity Polar Plot

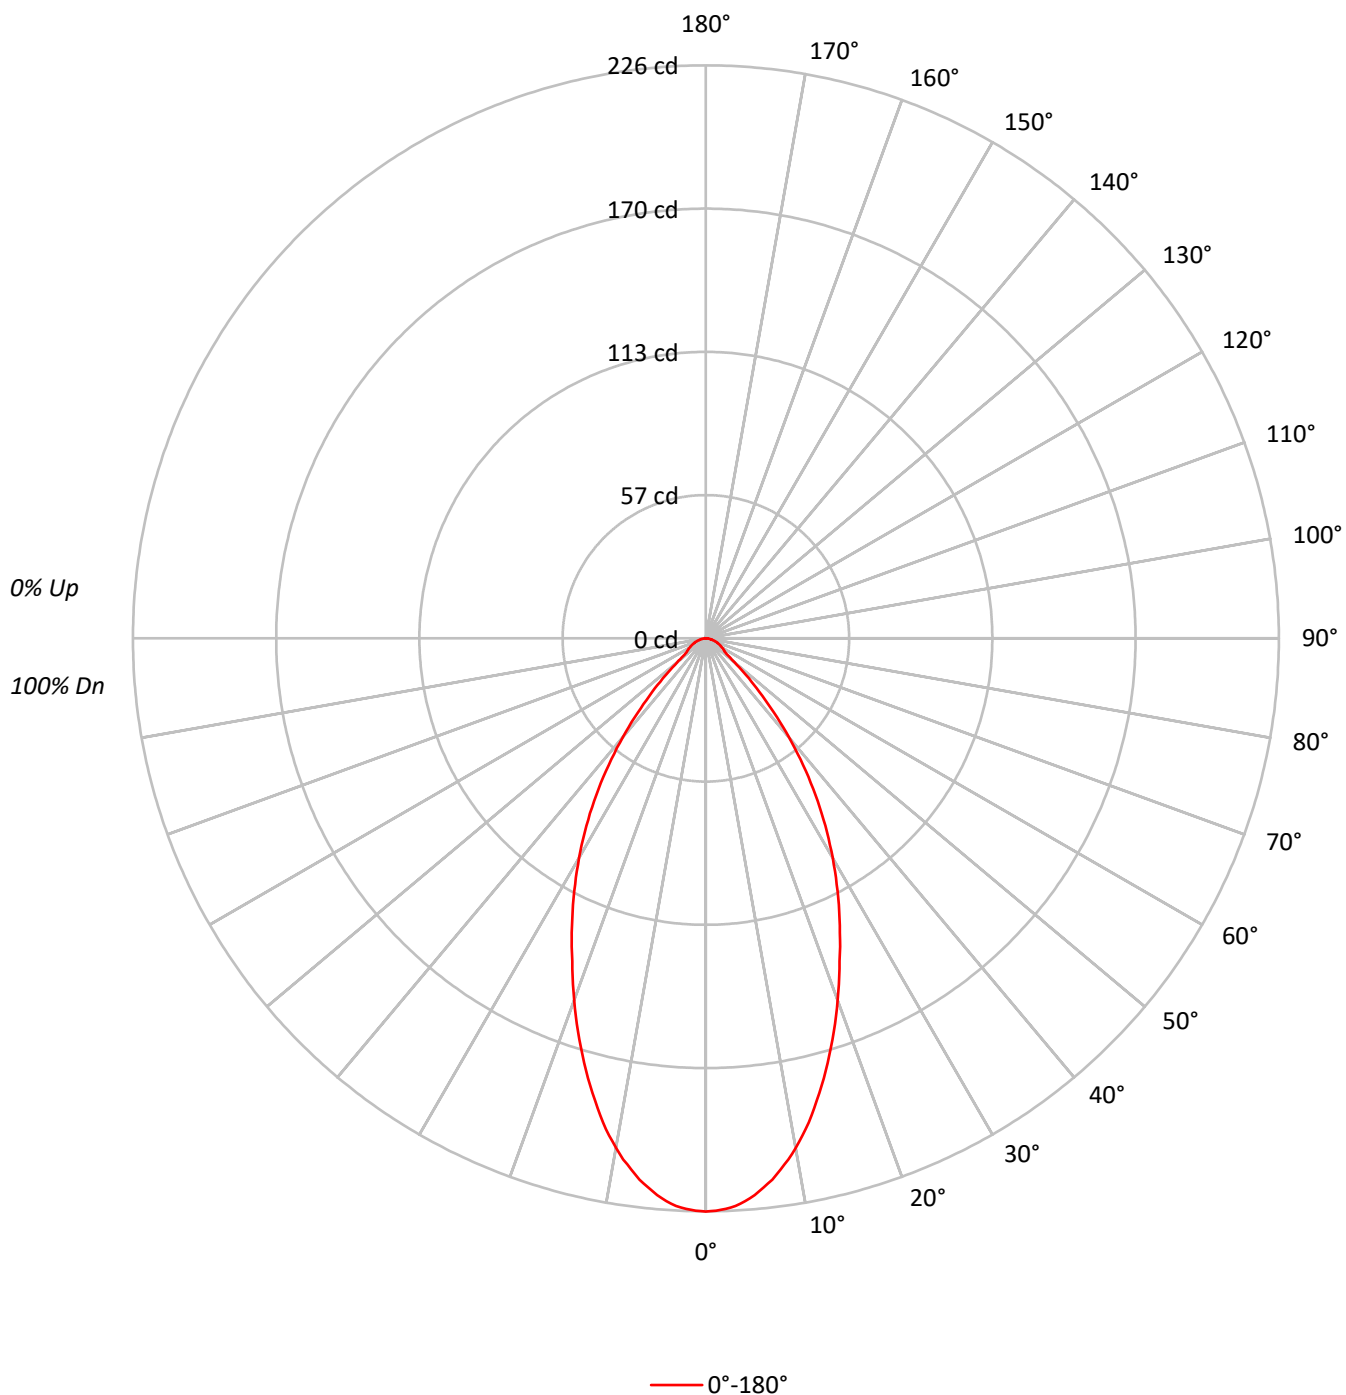

TEST NUMBER: P1273707

CATALOG NUMBER: P3AS09R359830DE010 E3DLD1GPH

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|-----|-----|-----|--|-----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |  | 20  |     |     |  | 20  |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |  | 30  |     |     |  | 10  |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  |  | 50  | 30  | 10  |  | 50  |
| RCR |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 |  | 106 | 106 | 106 |  | 102 |
| 1   | 112 | 109 | 106 | 104 | 110 | 107 | 104 | 102 | 103 | 101 | 99  |  | 99  | 98  | 96  |  | 96  |
| 2   | 106 | 100 | 96  | 92  | 104 | 98  | 94  | 91  | 95  | 92  | 89  |  | 92  | 89  | 87  |  | 89  |
| 3   | 100 | 92  | 87  | 82  | 98  | 91  | 86  | 81  | 88  | 84  | 80  |  | 86  | 82  | 79  |  | 83  |
| 4   | 94  | 85  | 79  | 74  | 92  | 84  | 78  | 74  | 82  | 77  | 73  |  | 80  | 75  | 72  |  | 78  |
| 5   | 89  | 79  | 73  | 68  | 87  | 78  | 72  | 67  | 76  | 71  | 67  |  | 75  | 70  | 66  |  | 73  |
| 6   | 84  | 74  | 67  | 62  | 82  | 73  | 67  | 62  | 71  | 66  | 61  |  | 70  | 65  | 61  |  | 68  |
| 7   | 79  | 69  | 62  | 57  | 78  | 68  | 62  | 57  | 67  | 61  | 57  |  | 65  | 60  | 57  |  | 64  |
| 8   | 75  | 64  | 58  | 53  | 74  | 64  | 57  | 53  | 63  | 57  | 53  |  | 62  | 56  | 53  |  | 61  |
| 9   | 71  | 60  | 54  | 50  | 70  | 60  | 54  | 50  | 59  | 53  | 49  |  | 58  | 53  | 49  |  | 57  |
| 10  | 67  | 57  | 51  | 46  | 66  | 56  | 50  | 46  | 56  | 50  | 46  |  | 55  | 50  | 46  |  | 54  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |       |
|-----|-------|
|     | 0°    |
| 0°  | 49579 |
| 5°  | 48514 |
| 10° | 45446 |
| 15° | 40795 |
| 20° | 35470 |
| 25° | 30244 |
| 30° | 25320 |
| 35° | 20184 |
| 40° | 14570 |
| 45° | 9241  |
| 50° | 5015  |
| 55° | 3479  |
| 60° | 3289  |
| 65° | 3061  |
| 70° | 2949  |
| 75° | 2457  |
| 80° | 2399  |
| 85° | 2013  |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 9241 cd/sqm

TEST NUMBER: P1273707

CATALOG NUMBER: P3AS09R359830DE010 E3DLD1GPH

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 20.5   | 9.5       |
| 10°-20°   | 50.0   | 23.0      |
| 20°-30°   | 57.3   | 26.4      |
| 30°-40°   | 46.8   | 21.5      |
| 40°-50°   | 23.6   | 10.9      |
| 50°-60°   | 8.7    | 4.0       |
| 60°-70°   | 5.9    | 2.7       |
| 70°-80°   | 3.3    | 1.5       |
| 80°-90°   | 1.0    | 0.4       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 127.8  | 58.9      |
| 0°-40°    | 174.6  | 80.5      |
| 0°-60°    | 206.9  | 95.3      |
| 0°-90°    | 217.0  | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 217.0  | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°  | Flux |
|-----|-----|------|
| 0°  | 226 |      |
| 5°  | 220 | 21   |
| 15° | 180 | 50   |
| 25° | 125 | 57   |
| 35° | 75  | 47   |
| 45° | 30  | 24   |
| 55° | 9   | 9    |
| 65° | 6   | 6    |
| 75° | 3   | 3    |
| 85° | 1   | 1    |
| 90° | 0   |      |



TEST NUMBER: P1273707

CATALOG NUMBER: P3AS09R359830DE010 E3DLD1GPH

**CANDELA DISTRIBUTION (FULL):**

| 0°    |       |
|-------|-------|
| 0°    | 226.1 |
| 1°    | 225.8 |
| 2°    | 225.2 |
| 3°    | 224.2 |
| 4°    | 222.6 |
| 5°    | 220.4 |
| 6°    | 217.7 |
| 7°    | 215.1 |
| 8°    | 211.6 |
| 9°    | 208.1 |
| 10°   | 204.1 |
| 11°   | 199.8 |
| 12°   | 195.2 |
| 13°   | 190.1 |
| 14°   | 184.8 |
| 15°   | 179.7 |
| 17.5° | 166.0 |
| 20°   | 152.0 |
| 22.5° | 137.8 |
| 25°   | 125.0 |
| 27.5° | 112.4 |
| 30°   | 100.0 |
| 32.5° | 87.7  |
| 35°   | 75.4  |
| 37.5° | 63.0  |
| 40°   | 50.9  |
| 42.5° | 39.7  |
| 45°   | 29.8  |
| 47.5° | 21.5  |
| 50°   | 14.7  |
| 52.5° | 10.7  |
| 55°   | 9.1   |
| 57.5° | 8.3   |
| 60°   | 7.5   |
| 62.5° | 6.7   |
| 65°   | 5.9   |
| 67.5° | 5.1   |
| 70°   | 4.6   |
| 72.5° | 3.8   |
| 75°   | 2.9   |
| 77.5° | 2.4   |
| 80°   | 1.9   |
| 82.5° | 1.3   |
| 85°   | 0.8   |
| 87.5° | 0.5   |



TEST NUMBER: P1273707  
CATALOG NUMBER: P3AS09R359830DE010 E3DLD1GPH

CANDELA DISTRIBUTION (continued):



(END OF REPORT)