

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1274619

Luminaire Tested: P3AS20R159830D010 E3DL1H

Issue Date: 1/30/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1274619  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-3)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3AS20R159830D010 E3DL1H  
Description: 3in Adjustable LED luminaire with, R15 optic, 3000K CCT AND, 98CRI , E3DL1H TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 1585.0 lumens  
Efficiency: N/A  
Efficacy: 57.8 lumens/watt  
Spacing Criteria (0/90/45): 0.4 / 0.4 / 0.43  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct

Input Watts (W): 27.4  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1274619

CATALOG NUMBER: P3AS20R159830D010 E3DL1H

### Luminous Intensity Polar Plot

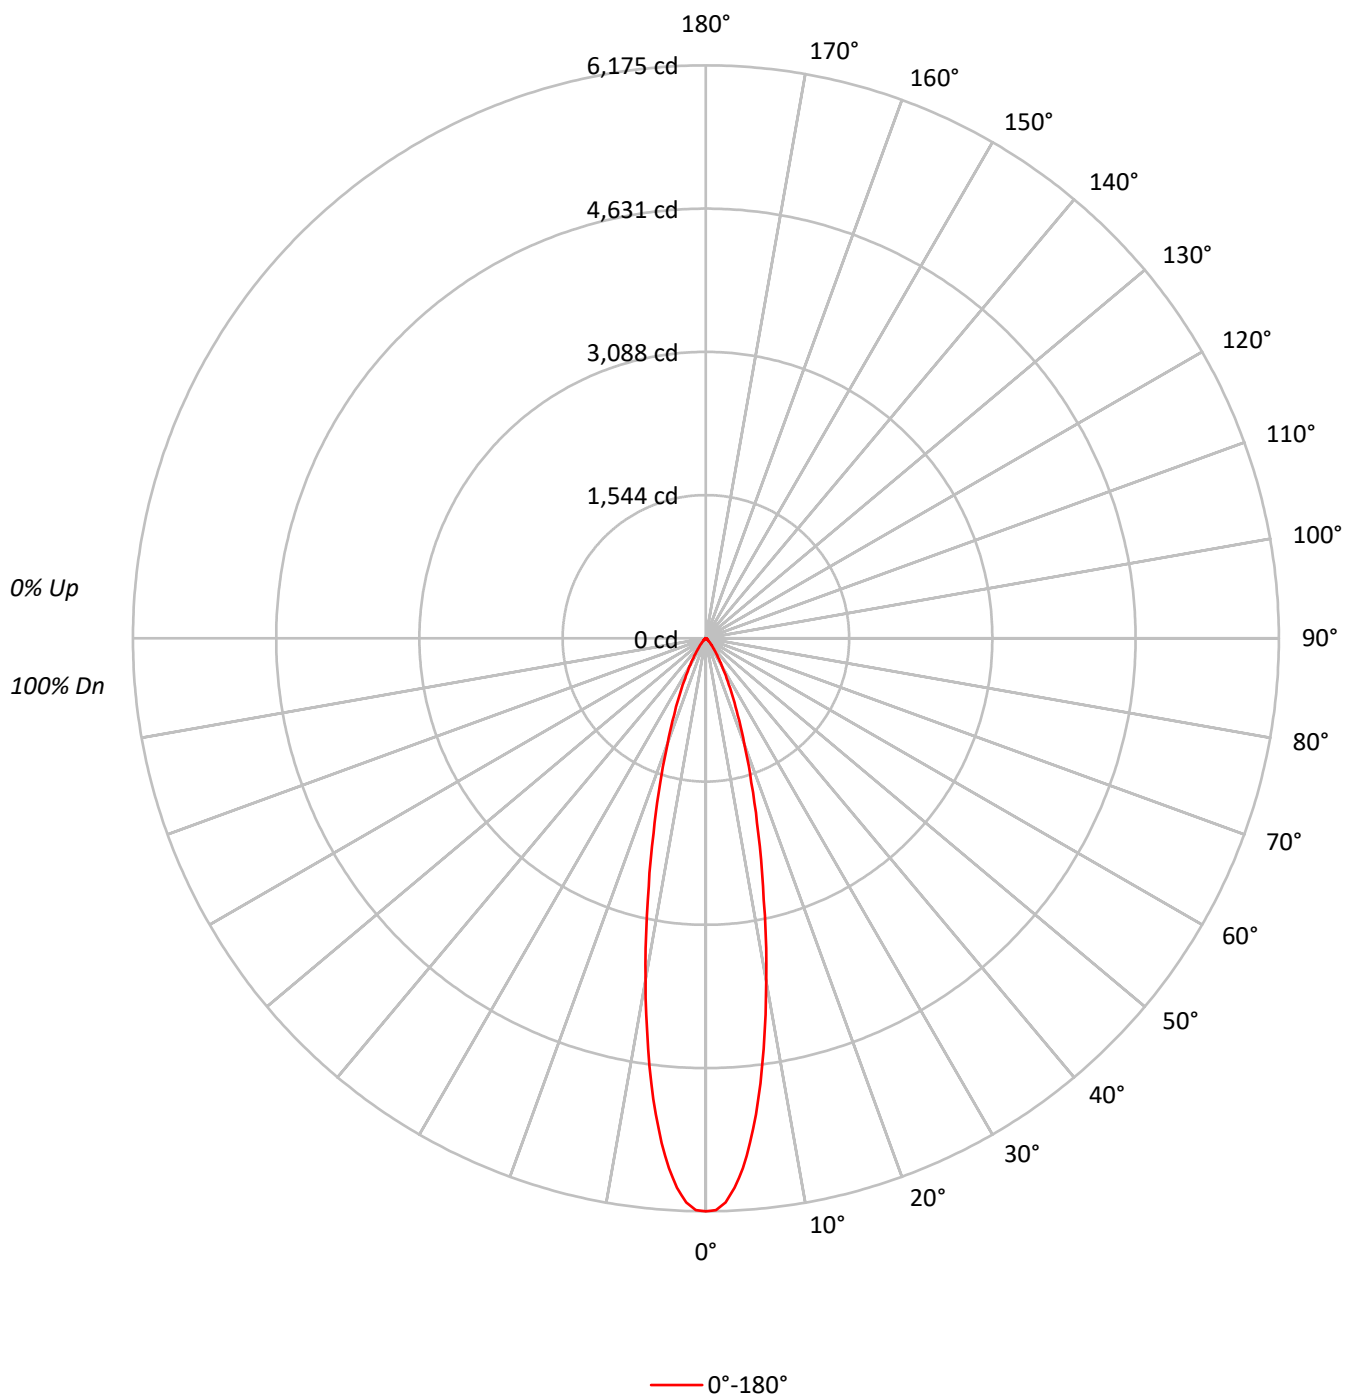

TEST NUMBER: P1274619

CATALOG NUMBER: P3AS20R159830D010 E3DL1H

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|
| RF  | 20  |     |     |     | 20  |     |     |     |     | 20  |     |     |     |     | 20  |     |     |     |    | 20 |
| RC  | 80  |     |     |     | 70  |     |     |     |     | 50  |     |     |     |     | 30  |     |     |     |    | 10 |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30 | 10 |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 |    |    |
| 1   | 114 | 112 | 110 | 108 | 112 | 110 | 108 | 106 | 106 | 104 | 103 | 102 | 101 | 100 | 99  | 98  | 97  | 95  |    |    |
| 2   | 110 | 106 | 103 | 100 | 108 | 104 | 101 | 99  | 101 | 99  | 97  | 98  | 96  | 95  | 96  | 94  | 93  | 91  |    |    |
| 3   | 106 | 101 | 97  | 93  | 104 | 99  | 96  | 93  | 97  | 94  | 91  | 94  | 92  | 90  | 92  | 90  | 88  | 87  |    |    |
| 4   | 102 | 96  | 92  | 88  | 100 | 95  | 91  | 88  | 93  | 89  | 87  | 91  | 88  | 86  | 89  | 87  | 85  | 83  |    |    |
| 5   | 98  | 92  | 87  | 84  | 97  | 91  | 87  | 83  | 89  | 85  | 83  | 88  | 84  | 82  | 86  | 83  | 81  | 80  |    |    |
| 6   | 95  | 88  | 83  | 80  | 94  | 87  | 83  | 80  | 86  | 82  | 79  | 85  | 81  | 79  | 83  | 80  | 78  | 77  |    |    |
| 7   | 92  | 85  | 80  | 77  | 91  | 84  | 80  | 76  | 83  | 79  | 76  | 82  | 78  | 76  | 81  | 78  | 75  | 74  |    |    |
| 8   | 89  | 81  | 77  | 74  | 88  | 81  | 77  | 73  | 80  | 76  | 73  | 79  | 75  | 73  | 78  | 75  | 73  | 72  |    |    |
| 9   | 86  | 79  | 74  | 71  | 85  | 78  | 74  | 71  | 77  | 73  | 71  | 77  | 73  | 70  | 76  | 73  | 70  | 69  |    |    |
| 10  | 84  | 76  | 71  | 68  | 83  | 76  | 71  | 68  | 75  | 71  | 68  | 74  | 71  | 68  | 74  | 70  | 68  | 67  |    |    |

**AVERAGE LUMINANCE (cd/sqm):**

|     |         |
|-----|---------|
|     | 0°      |
| 0°  | 1354014 |
| 5°  | 1201890 |
| 10° | 834654  |
| 15° | 493601  |
| 20° | 281121  |
| 25° | 160703  |
| 30° | 88925   |
| 35° | 47408   |
| 40° | 26221   |
| 45° | 14203   |
| 50° | 8870    |
| 55° | 6996    |
| 60° | 6008    |
| 65° | 5552    |
| 70° | 4873    |
| 75° | 5168    |
| 80° | 3915    |
| 85° | 3774    |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 14203 cd/sqm

TEST NUMBER: P1274619

CATALOG NUMBER: P3AS20R159830D010 E3DL1H

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 464.3  | 29.3      |
| 10°-20°   | 612.8  | 38.7      |
| 20°-30°   | 315.5  | 19.9      |
| 30°-40°   | 118.5  | 7.5       |
| 40°-50°   | 38.8   | 2.4       |
| 50°-60°   | 16.7   | 1.1       |
| 60°-70°   | 10.6   | 0.7       |
| 70°-80°   | 6.2    | 0.4       |
| 80°-90°   | 1.7    | 0.1       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| <hr/>     |        |           |
| 0°-30°    | 1392.6 | 87.9      |
| 0°-40°    | 1511.1 | 95.3      |
| 0°-60°    | 1566.5 | 98.8      |
| 0°-90°    | 1585.0 | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 1585.0 | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 6175 |      |
| 5°  | 5460 | 464  |
| 15° | 2174 | 613  |
| 25° | 664  | 316  |
| 35° | 177  | 118  |
| 45° | 46   | 39   |
| 55° | 18   | 17   |
| 65° | 11   | 11   |
| 75° | 6    | 6    |
| 85° | 2    | 2    |
| 90° | 0    |      |

TEST NUMBER: P1274619

CATALOG NUMBER: P3AS20R159830D010 E3DL1H

**CANDELA DISTRIBUTION (FULL):**

| 0°    |        |
|-------|--------|
| 0°    | 6174.8 |
| 1°    | 6162.5 |
| 2°    | 6081.6 |
| 3°    | 5927.4 |
| 4°    | 5724.3 |
| 5°    | 5460.2 |
| 6°    | 5160.9 |
| 7°    | 4832.6 |
| 8°    | 4467.7 |
| 9°    | 4107.3 |
| 10°   | 3748.5 |
| 12.5° | 2884.3 |
| 15°   | 2174.3 |
| 17.5° | 1627.7 |
| 20°   | 1204.7 |
| 22.5° | 899.3  |
| 25°   | 664.2  |
| 27.5° | 484.0  |
| 30°   | 351.2  |
| 32.5° | 248.9  |
| 35°   | 177.1  |
| 37.5° | 126.7  |
| 40°   | 91.6   |
| 42.5° | 65.7   |
| 45°   | 45.8   |
| 47.5° | 33.6   |
| 50°   | 26.0   |
| 52.5° | 21.4   |
| 55°   | 18.3   |
| 57.5° | 15.3   |
| 60°   | 13.7   |
| 62.5° | 12.2   |
| 65°   | 10.7   |
| 67.5° | 9.2    |
| 70°   | 7.6    |
| 72.5° | 7.6    |
| 75°   | 6.1    |
| 77.5° | 4.6    |
| 80°   | 3.1    |
| 82.5° | 3.1    |
| 85°   | 1.5    |
| 87.5° | 0.0    |
| 90°   | 0.0    |

(END OF REPORT)