

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1275413

Luminaire Tested: P3AS05R309835DE010 E3DLP1MW

Issue Date: 1/30/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1275413  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-13)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3AS05R309835DE010 E3DLP1MW  
Description: 3in Adjustable LED luminaire with, R30 optic, 3500K CCT AND, 98CRI , E3DLP1MW TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 249.0 lumens  
Efficiency: N/A  
Efficacy: 34.6 lumens/watt  
Spacing Criteria (0/90/45): 0.66 / 0.66 / 0.7  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct

Input Watts (W): 7.2  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1275413

CATALOG NUMBER: P3AS05R309835DE010 E3DLP1MW

### Luminous Intensity Polar Plot

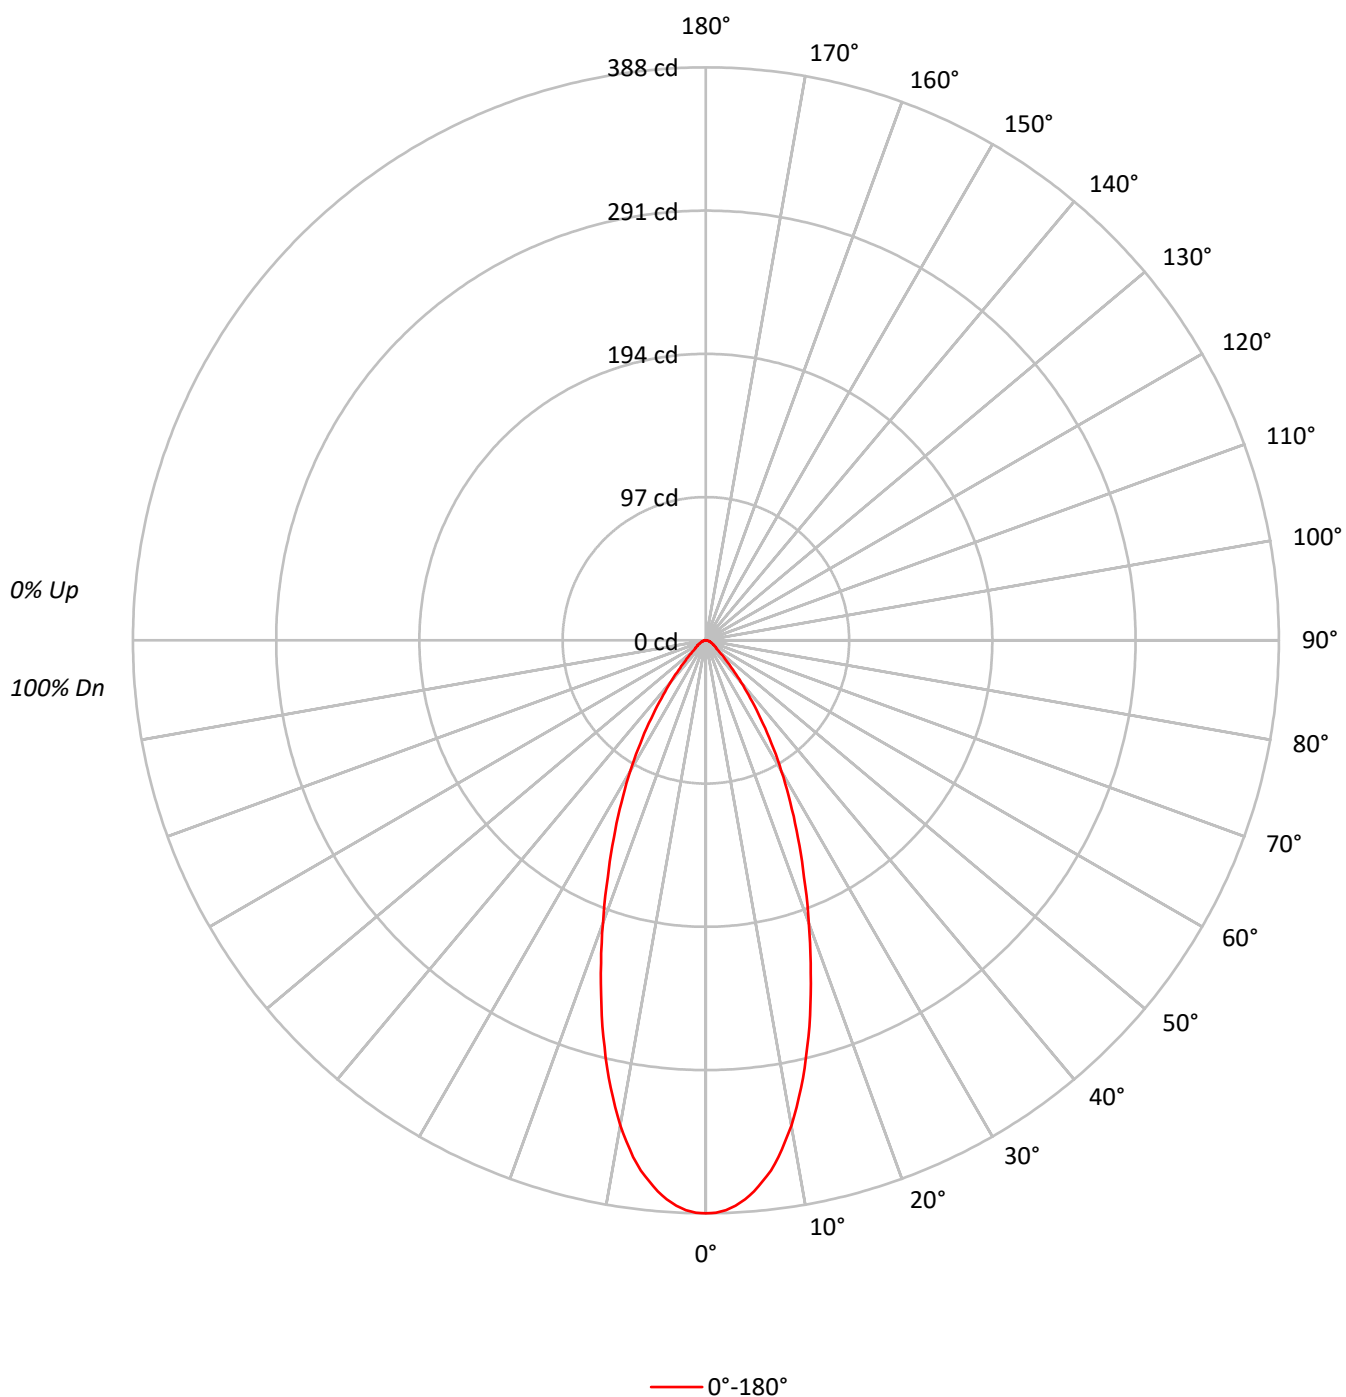

TEST NUMBER: P1275413

CATALOG NUMBER: P3AS05R309835DE010 E3DLP1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|-----|-----|-----|--|-----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |  | 20  |     |     |  | 20  |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |  | 30  |     |     |  | 10  |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  |  | 50  | 30  | 10  |  | 50  |
| RCR |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 |  | 106 | 106 | 106 |  | 102 |
| 1   | 113 | 110 | 108 | 105 | 111 | 108 | 106 | 104 | 104 | 102 | 100 |  | 100 | 99  | 97  |  | 97  |
| 2   | 107 | 102 | 98  | 95  | 105 | 101 | 97  | 94  | 97  | 94  | 92  |  | 94  | 92  | 90  |  | 92  |
| 3   | 102 | 95  | 90  | 86  | 100 | 94  | 89  | 85  | 91  | 87  | 84  |  | 89  | 86  | 83  |  | 87  |
| 4   | 97  | 89  | 84  | 79  | 95  | 88  | 83  | 79  | 86  | 81  | 78  |  | 84  | 80  | 77  |  | 82  |
| 5   | 92  | 84  | 78  | 73  | 90  | 83  | 77  | 73  | 81  | 76  | 72  |  | 79  | 75  | 72  |  | 78  |
| 6   | 88  | 79  | 73  | 68  | 86  | 78  | 72  | 68  | 76  | 71  | 68  |  | 75  | 71  | 67  |  | 74  |
| 7   | 83  | 74  | 68  | 64  | 82  | 74  | 68  | 64  | 72  | 67  | 63  |  | 71  | 67  | 63  |  | 70  |
| 8   | 80  | 70  | 64  | 60  | 78  | 70  | 64  | 60  | 69  | 63  | 60  |  | 67  | 63  | 60  |  | 67  |
| 9   | 76  | 67  | 61  | 57  | 75  | 66  | 60  | 57  | 65  | 60  | 56  |  | 64  | 60  | 56  |  | 63  |
| 10  | 73  | 63  | 58  | 54  | 72  | 63  | 57  | 54  | 62  | 57  | 53  |  | 61  | 57  | 53  |  | 60  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |       |
|-----|-------|
|     | 0°    |
| 0°  | 85081 |
| 5°  | 82434 |
| 10° | 74281 |
| 15° | 61453 |
| 20° | 47581 |
| 25° | 35688 |
| 30° | 25903 |
| 35° | 17266 |
| 40° | 10620 |
| 45° | 6233  |
| 50° | 3821  |
| 55° | 3097  |
| 60° | 2719  |
| 65° | 2179  |
| 70° | 1988  |
| 75° | 1949  |
| 80° | 1515  |
| 85° | 2013  |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 6233 cd/sqm

TEST NUMBER: P1275413

CATALOG NUMBER: P3AS05R309835DE010 E3DLP1MW

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 34.4   | 13.8      |
| 10°-20°   | 74.6   | 29.9      |
| 20°-30°   | 67.8   | 27.2      |
| 30°-40°   | 41.0   | 16.5      |
| 40°-50°   | 16.5   | 6.6       |
| 50°-60°   | 7.3    | 2.9       |
| 60°-70°   | 4.4    | 1.8       |
| 70°-80°   | 2.4    | 1.0       |
| 80°-90°   | 0.7    | 0.3       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 176.8  | 71.0      |
| 0°-40°    | 217.8  | 87.5      |
| 0°-60°    | 241.5  | 97.0      |
| 0°-90°    | 249.0  | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 249.0  | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°  | Flux |
|-----|-----|------|
| 0°  | 388 |      |
| 5°  | 374 | 34   |
| 15° | 271 | 75   |
| 25° | 148 | 68   |
| 35° | 64  | 41   |
| 45° | 20  | 16   |
| 55° | 8   | 7    |
| 65° | 4   | 4    |
| 75° | 2   | 2    |
| 85° | 1   | 1    |
| 90° | 0   |      |

TEST NUMBER: P1275413

CATALOG NUMBER: P3AS05R309835DE010 E3DLP1MW

**CANDELA DISTRIBUTION (FULL):**

| 0°    |       |
|-------|-------|
| 0°    | 388.0 |
| 1°    | 387.6 |
| 2°    | 386.1 |
| 3°    | 383.4 |
| 4°    | 379.5 |
| 5°    | 374.5 |
| 6°    | 368.3 |
| 7°    | 361.8 |
| 8°    | 353.3 |
| 9°    | 343.6 |
| 10°   | 333.6 |
| 11°   | 322.0 |
| 12°   | 309.7 |
| 13°   | 297.3 |
| 14°   | 283.8 |
| 15°   | 270.7 |
| 17.5° | 236.3 |
| 20°   | 203.9 |
| 22.5° | 173.7 |
| 25°   | 147.5 |
| 27.5° | 123.6 |
| 30°   | 102.3 |
| 32.5° | 82.6  |
| 35°   | 64.5  |
| 37.5° | 49.4  |
| 40°   | 37.1  |
| 42.5° | 27.0  |
| 45°   | 20.1  |
| 47.5° | 15.1  |
| 50°   | 11.2  |
| 52.5° | 8.9   |
| 55°   | 8.1   |
| 57.5° | 6.9   |
| 60°   | 6.2   |
| 62.5° | 5.0   |
| 65°   | 4.2   |
| 67.5° | 3.9   |
| 70°   | 3.1   |
| 72.5° | 2.7   |
| 75°   | 2.3   |
| 77.5° | 1.9   |
| 80°   | 1.2   |
| 82.5° | 0.8   |
| 85°   | 0.8   |
| 87.5° | 0.4   |



TEST NUMBER: P1275413  
CATALOG NUMBER: P3AS05R309835DE010 E3DLP1MW

CANDELA DISTRIBUTION (continued):



(END OF REPORT)