Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: IRiS

Report Number: P1275585

Luminaire Tested: P3AS05R609835DE010 E3DLP1MW

Issue Date: 1/30/2026

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-2019
Report Number:	P1275585
	TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-37)
Test Lab:	INNOVATION CENTER
Issue Date:	1/30/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	IRiS
Catalog Number:	P3AS05R609835DE010 E3DLP1MW
Description:	3in Adjustable LED luminaire with, R60 optic, 3500K CCT AND, 98CRI , E3DLP1MW TRIM
Light Source:	-
Ballast/Driver:	-

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	281.0 lumens
Efficiency:	N/A
Efficacy:	39.0 lumens/watt
Spacing Criteria (0/90/45):	0.79 / 0.79 / 0.83
Luminous Opening:	Circular (Dia: 0.25' x H: 0')
CIE Type:	Direct

Input Watts (W):	7.2
Input Voltage (V):	NR
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	NR
Total Harmonic Distortion (THDi):	NR
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	24 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1275585
CATALOG NUMBER: P3AS05R609835DE010 E3DLP1MW

Luminous Intensity Polar Plot

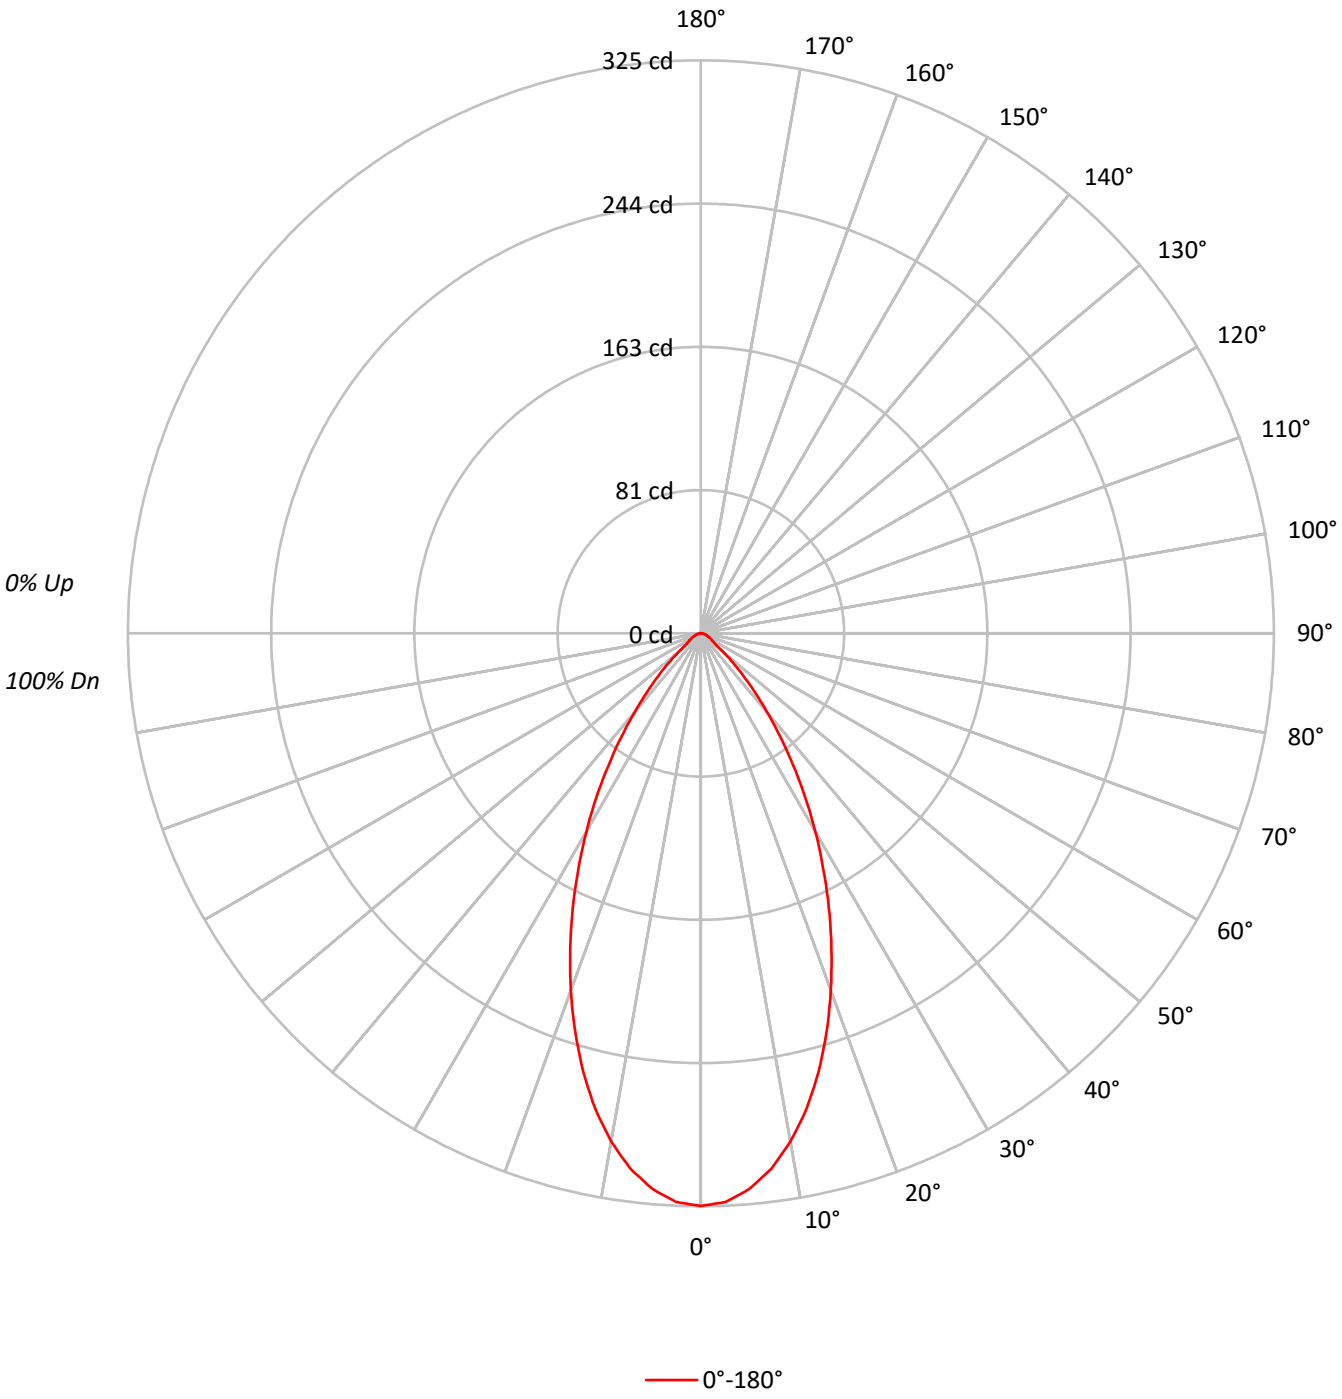

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1275585
CATALOG NUMBER: P3AS05R609835DE010 E3DLP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20			20			20			20
RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	113	110	107	105	110	108	105	103	104	102	100	100	98	97	96	95	94	92
2	107	101	97	93	104	100	96	92	96	93	90	93	91	88	91	88	86	85
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78
4	95	87	81	77	93	86	80	76	84	79	75	82	78	74	80	76	73	72
5	90	81	75	70	88	80	74	70	78	73	69	77	72	69	75	71	68	66
6	85	76	69	65	84	75	69	65	73	68	64	72	67	64	71	66	63	62
7	81	71	65	60	79	70	64	60	69	64	60	68	63	59	67	62	59	57
8	77	67	60	56	75	66	60	56	65	60	56	64	59	55	63	58	55	54
9	73	63	57	52	72	62	56	52	61	56	52	60	55	52	60	55	52	50
10	69	59	53	49	68	59	53	49	58	53	49	57	52	49	56	52	49	47

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	71222
5°	69623
10°	65174
15°	58479
20°	50288
25°	41567
30°	32866
35°	24387
40°	16803
45°	10544
50°	5799
55°	3403
60°	3070
65°	2594
70°	2244
75°	2288
80°	1894
85°	2013

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 10544 cd/sqm

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1275585
CATALOG NUMBER: P3AS05R609835DE010 E3DLP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	29.4	10.5
10°-20°	71.5	25.5
20°-30°	78.5	27.9
30°-40°	57.2	20.3
40°-50°	27.0	9.6
50°-60°	8.9	3.1
60°-70°	5.0	1.8
70°-80°	2.7	1.0
80°-90°	0.9	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	179.4	63.9
0°-40°	236.6	84.2
0°-60°	272.5	97.0
0°-90°	281.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	281.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	325	
5°	316	29
15°	258	72
25°	172	78
35°	91	57
45°	34	27
55°	9	9
65°	5	5
75°	3	3
85°	1	1
90°	0	

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1275585
CATALOG NUMBER: P3AS05R609835DE010 E3DLP1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	324.8
2.5°	322.8
5°	316.3
7.5°	306.2
10°	292.7
12.5°	276.5
15°	257.6
17.5°	237.1
20°	215.5
22.5°	193.5
25°	171.8
27.5°	150.2
30°	129.8
32.5°	110.1
35°	91.1
37.5°	74.1
40°	58.7
42.5°	45.2
45°	34.0
47.5°	24.7
50°	17.0
52.5°	11.2
55°	8.9
57.5°	7.7
60°	7.0
62.5°	5.8
65°	5.0
67.5°	4.2
70°	3.5
72.5°	3.1
75°	2.7
77.5°	1.9
80°	1.5
82.5°	1.2
85°	0.8
87.5°	0.4
90°	0.0

(END OF REPORT)