

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1275992

Luminaire Tested: P3AS13R159835DE010 E3CD1MW

Issue Date: 1/30/2026

**Test Information**


Test Method: LM-79-2019  
Report Number: P1275992  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-4)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3AS13R159835DE010 E3CD1MW  
Description: 3in Adjustable LED luminaire with, R15 optic, 3500K CCT AND, 98CRI , E3CD1MW TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 958.0 lumens  
Efficiency: N/A  
Efficacy: 66.1 lumens/watt  
Spacing Criteria (0/90/45): 0.3 / 0.3 / 0.29  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 14.5  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1275992  
CATALOG NUMBER: P3AS13R159835DE010 E3CD1MW

### Luminous Intensity Polar Plot

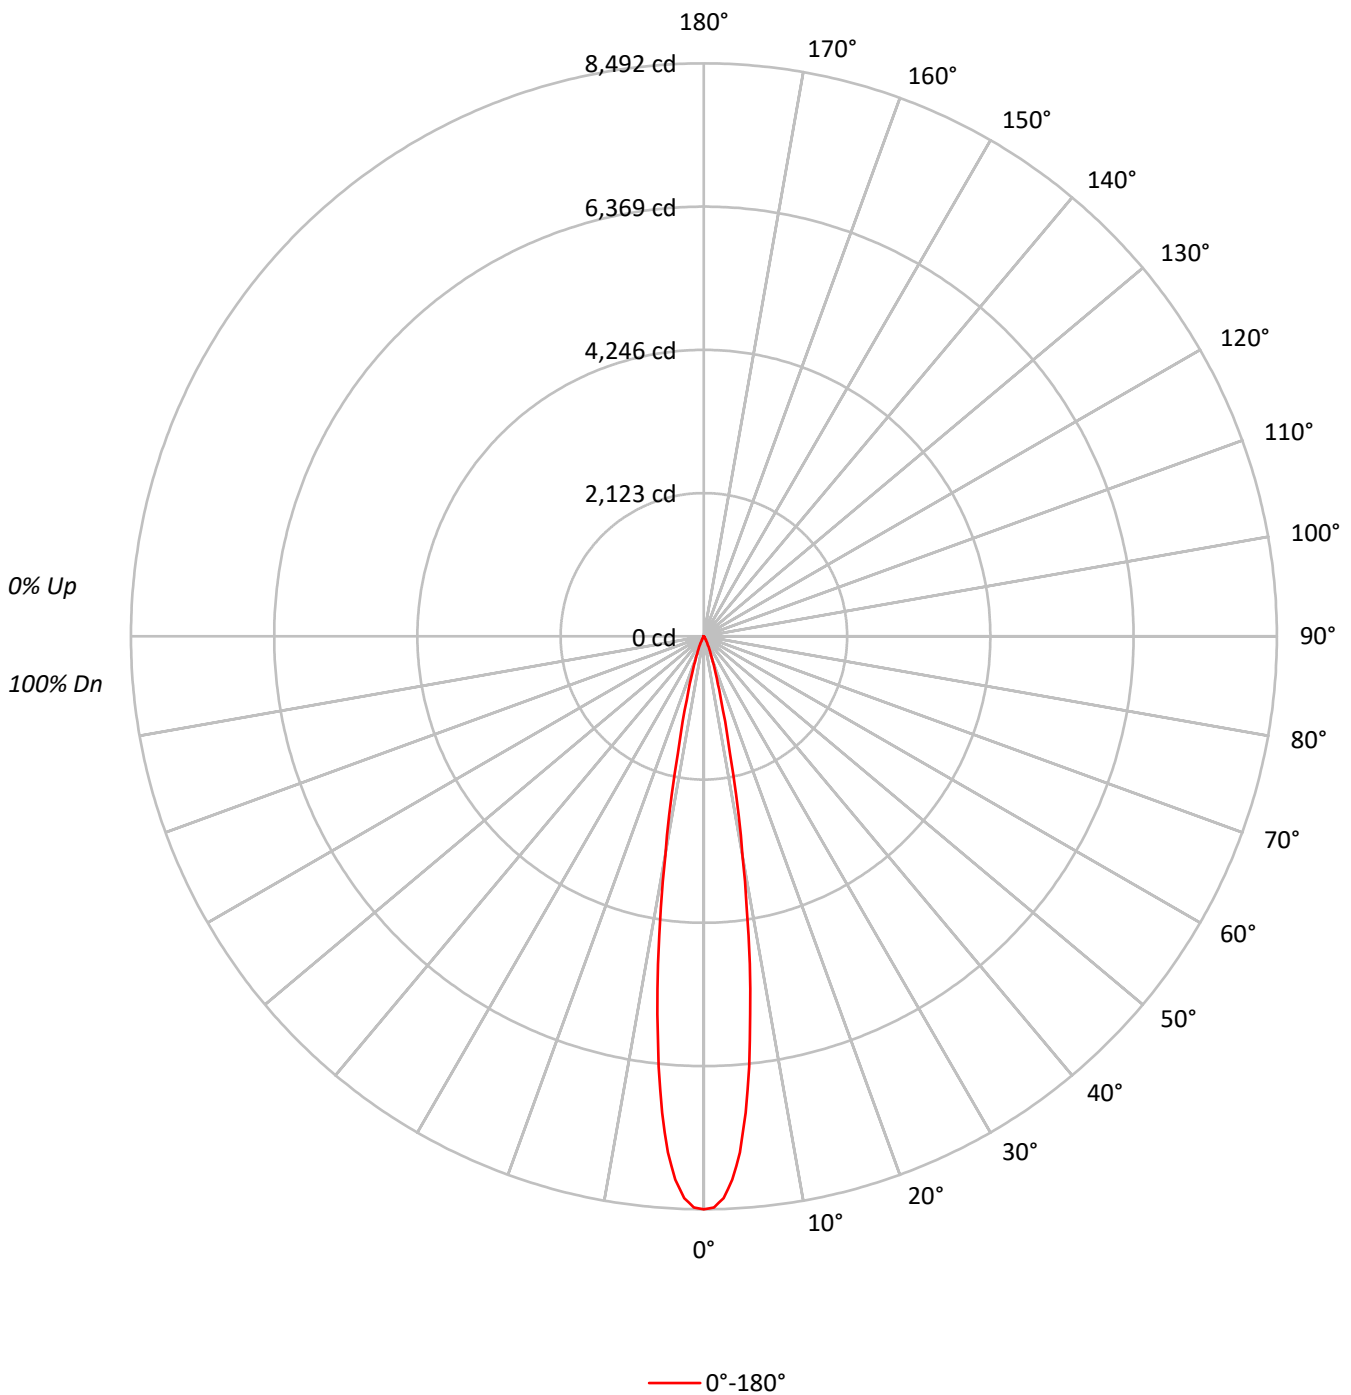



TEST NUMBER: P1275992

CATALOG NUMBER: P3AS13R159835DE010 E3CD1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     |     |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |     | 30  |     |     |     | 10  |     |     | 0   |     |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 0   |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | 100 | 100 | 100 |
| 1   | 116 | 114 | 112 | 111 | 113 | 112 | 110 | 109 | 108 | 107 | 106 | 104 | 103 | 103 | 101 | 100 | 100 | 98  | 98  | 98  | 98  |
| 2   | 113 | 110 | 107 | 105 | 111 | 108 | 106 | 104 | 105 | 103 | 101 | 102 | 101 | 99  | 99  | 98  | 97  | 96  | 96  | 96  | 96  |
| 3   | 110 | 106 | 103 | 100 | 108 | 105 | 102 | 100 | 102 | 100 | 98  | 100 | 98  | 97  | 98  | 97  | 95  | 94  | 94  | 94  | 94  |
| 4   | 107 | 103 | 100 | 97  | 106 | 102 | 99  | 97  | 100 | 97  | 95  | 98  | 96  | 94  | 97  | 95  | 93  | 92  | 92  | 92  | 92  |
| 5   | 105 | 100 | 97  | 94  | 104 | 99  | 96  | 94  | 98  | 95  | 93  | 96  | 94  | 92  | 95  | 93  | 92  | 91  | 91  | 91  | 91  |
| 6   | 103 | 98  | 94  | 92  | 102 | 97  | 94  | 92  | 96  | 93  | 91  | 95  | 92  | 91  | 94  | 92  | 90  | 89  | 89  | 89  | 89  |
| 7   | 101 | 96  | 92  | 90  | 100 | 95  | 92  | 90  | 94  | 91  | 89  | 93  | 91  | 89  | 92  | 90  | 89  | 88  | 88  | 88  | 88  |
| 8   | 99  | 94  | 90  | 88  | 98  | 93  | 90  | 88  | 92  | 90  | 88  | 92  | 89  | 87  | 91  | 89  | 87  | 86  | 86  | 86  | 86  |
| 9   | 97  | 92  | 89  | 87  | 97  | 92  | 89  | 86  | 91  | 88  | 86  | 90  | 88  | 86  | 90  | 87  | 86  | 85  | 85  | 85  | 85  |
| 10  | 96  | 90  | 87  | 85  | 95  | 90  | 87  | 85  | 89  | 87  | 85  | 89  | 86  | 85  | 88  | 86  | 85  | 84  | 84  | 84  | 84  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |         |
|-----|---------|
|     | 0°      |
| 0°  | 1862132 |
| 5°  | 1560639 |
| 10° | 735123  |
| 15° | 221636  |
| 20° | 82000   |
| 25° | 31889   |
| 30° | 11901   |
| 35° | 3641    |
| 40° | 1288    |
| 45° | 713     |
| 50° | 512     |
| 55° | 573     |
| 60° | 658     |
| 65° | 415     |
| 70° | 513     |
| 75° | 678     |
| 80° | 0       |
| 85° | 0       |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 713 cd/sqm



TEST NUMBER: P1275992  
 CATALOG NUMBER: P3AS13R159835DE010 E3CD1MW

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 548.1  | 57.2      |
| 10°-20°   | 325.8  | 34.0      |
| 20°-30°   | 68.4   | 7.1       |
| 30°-40°   | 11.0   | 1.2       |
| 40°-50°   | 1.9    | 0.2       |
| 50°-60°   | 1.3    | 0.1       |
| 60°-70°   | 0.9    | 0.1       |
| 70°-80°   | 0.5    | 0.1       |
| 80°-90°   | 0.0    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 942.4  | 98.4      |
| 0°-40°    | 953.4  | 99.5      |
| 0°-60°    | 956.6  | 99.9      |
| 0°-90°    | 958.0  | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 958.0  | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 8492 |      |
| 5°  | 7090 | 548  |
| 15° | 976  | 326  |
| 25° | 132  | 68   |
| 35° | 14   | 11   |
| 45° | 2    | 2    |
| 55° | 2    | 1    |
| 65° | 1    | 1    |
| 75° | 1    | 1    |
| 85° | 0    | 0    |
| 90° | 0    |      |



TEST NUMBER: P1275992  
CATALOG NUMBER: P3AS13R159835DE010 E3CD1MW

**CANDELA DISTRIBUTION (FULL):**

| 0°    |        |
|-------|--------|
| 0°    | 8492.0 |
| 1°    | 8465.5 |
| 2°    | 8330.6 |
| 3°    | 8061.0 |
| 4°    | 7665.6 |
| 5°    | 7090.0 |
| 6°    | 6413.7 |
| 7°    | 5640.4 |
| 8°    | 4901.9 |
| 9°    | 4065.7 |
| 10°   | 3301.5 |
| 12.5° | 1781.4 |
| 15°   | 976.3  |
| 17.5° | 571.8  |
| 20°   | 351.4  |
| 22.5° | 215.1  |
| 25°   | 131.8  |
| 27.5° | 79.5   |
| 30°   | 47.0   |
| 32.5° | 26.5   |
| 35°   | 13.6   |
| 37.5° | 7.6    |
| 40°   | 4.5    |
| 42.5° | 3.0    |
| 45°   | 2.3    |
| 47.5° | 1.5    |
| 50°   | 1.5    |
| 52.5° | 1.5    |
| 55°   | 1.5    |
| 57.5° | 1.5    |
| 60°   | 1.5    |
| 62.5° | 0.8    |
| 65°   | 0.8    |
| 67.5° | 0.8    |
| 70°   | 0.8    |
| 72.5° | 0.8    |
| 75°   | 0.8    |
| 77.5° | 0.0    |
| 80°   | 0.0    |
| 82.5° | 0.0    |
| 85°   | 0.0    |
| 87.5° | 0.0    |
| 90°   | 0.0    |

(END OF REPORT)