

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1282756

Luminaire Tested: P3AS09R20B2750DE010 E3D1WMH_5000K

Issue Date: 1/29/2026

Test Information

Test Method: LM-79-2019
Report Number: P1282756
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2501-338-8)
Test Lab: INNOVATION CENTER
Issue Date: 1/29/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: IRiS
Catalog Number: P3AS09R20B2750DE010 E3D1WMH_5000K
Description: 3in Adjustable Boosted Cyan Tunable White LED luminaire with, R20 optic, 5000K CCT AND, 80CRI , E3D1WMH TRIM
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 785.0 lumens
Efficiency: N/A
Efficacy: 59.9 lumens/watt
Spacing Criteria (0/90/45): 0.35 / 0.35 / 0.34
Luminous Opening: Circular (Dia: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 13.1
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1282756

CATALOG NUMBER: P3AS09R20B2750DE010 E3D1WMH_5000K

Luminous Intensity Polar Plot

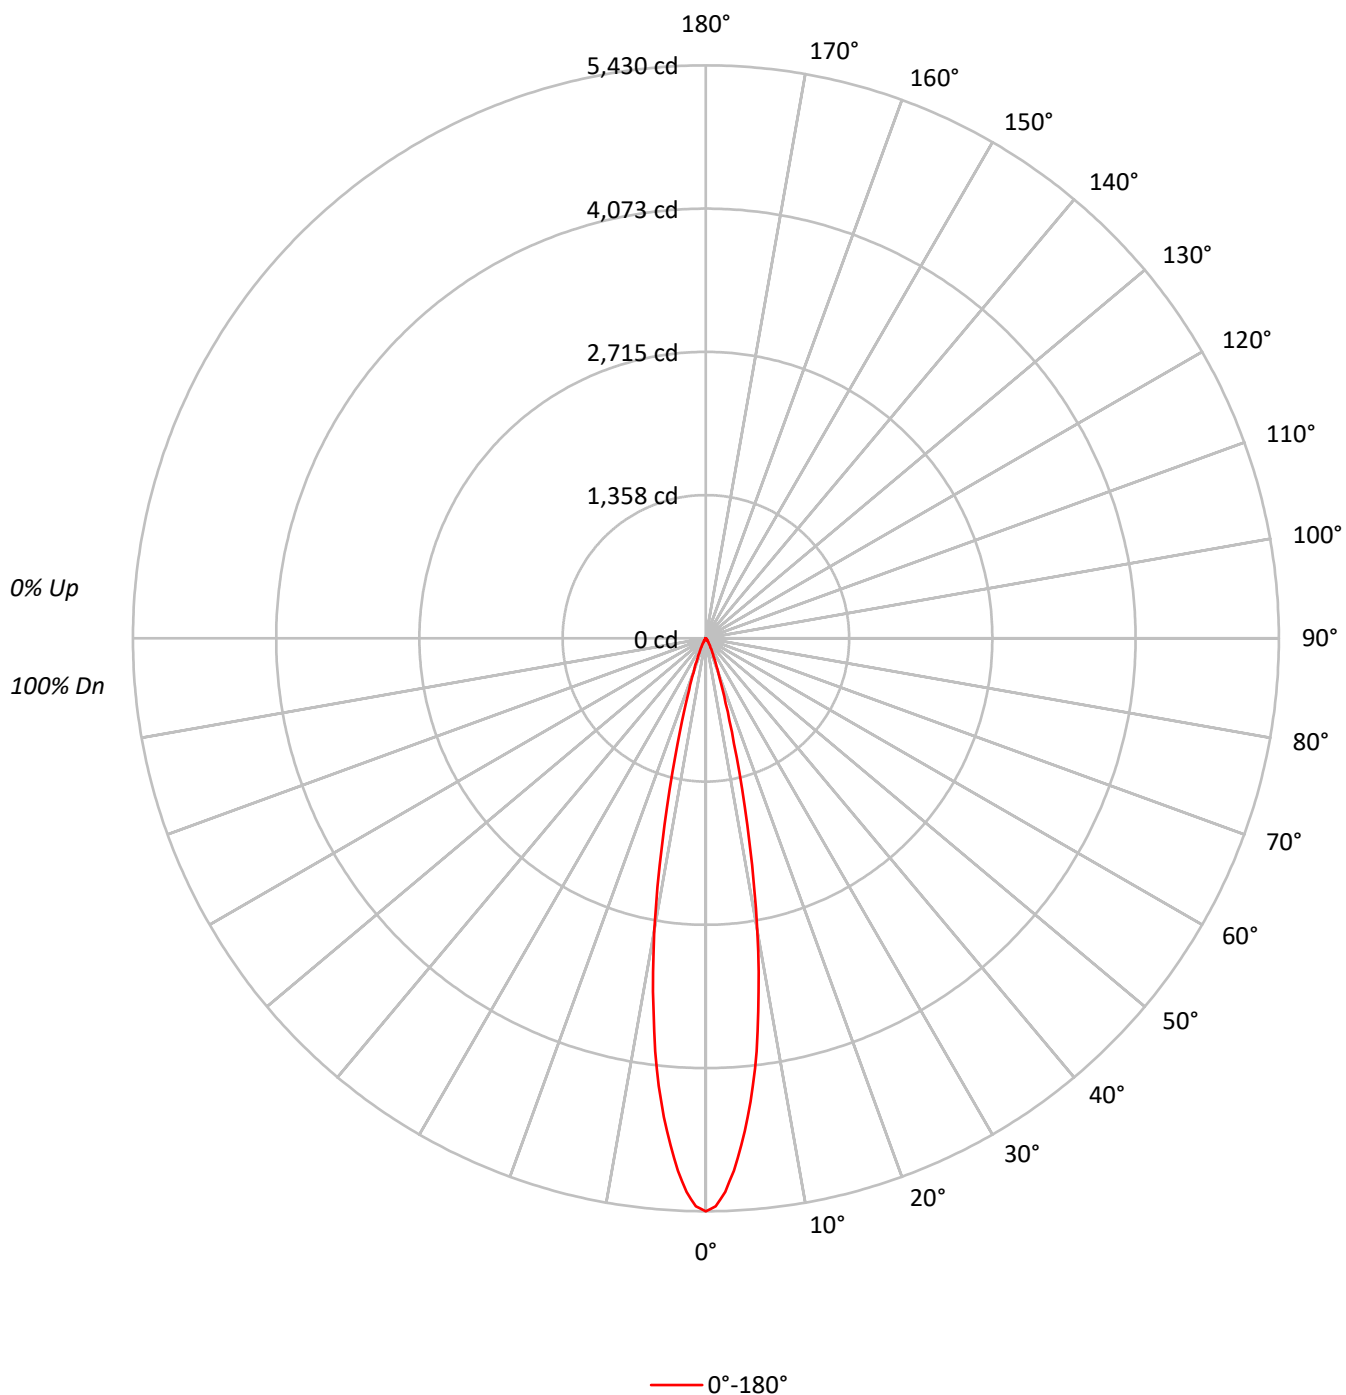

TEST NUMBER: P1282756

CATALOG NUMBER: P3AS09R20B2750DE010 E3D1WMH_5000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20					20					20					20
RC	80				70					50					30					0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100
1	115	114	112	110	113	111	110	108	107	106	105	104	103	102	100	100	99	97	97	97
2	112	109	106	104	110	107	105	103	104	102	101	101	100	98	99	98	96	95	95	95
3	109	105	102	99	107	104	101	98	101	99	97	99	97	95	97	95	94	93	93	93
4	106	101	98	95	105	100	97	95	99	96	94	97	95	93	95	93	92	91	91	91
5	104	98	95	92	102	98	94	92	96	93	91	95	92	90	93	91	90	89	89	89
6	101	96	92	89	100	95	92	89	94	91	89	93	90	88	92	89	88	87	87	87
7	99	93	90	87	98	93	89	87	92	89	86	91	88	86	90	87	86	85	85	85
8	97	91	87	85	96	91	87	85	90	87	85	89	86	84	88	86	84	83	83	83
9	95	89	85	83	94	89	85	83	88	85	83	87	84	83	87	84	82	81	81	81
10	93	87	84	81	92	87	83	81	86	83	81	86	83	81	85	83	81	80	80	80

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1190782
5°	1002573
10°	626196
15°	234122
20°	80367
25°	33486
30°	15775
35°	7067
40°	3349
45°	1706
50°	614
55°	115
60°	132
65°	156
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1706 cd/sqm

TEST NUMBER: P1282756

CATALOG NUMBER: P3AS09R20B2750DE010 E3D1WMH_5000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	378.8	48.3
10°-20°	312.0	39.7
20°-30°	70.9	9.0
30°-40°	18.1	2.3
40°-50°	4.5	0.6
50°-60°	0.6	0.1
60°-70°	0.2	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	761.7	97.0
0°-40°	779.7	99.3
0°-60°	784.8	100.0
0°-90°	785.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	785.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	5430	
5°	4555	379
15°	1031	312
25°	138	71
35°	26	18
45°	6	5
55°	0	1
65°	0	0
75°	0	0
85°	0	0
90°	0	

TEST NUMBER: P1282756

CATALOG NUMBER: P3AS09R20B2750DE010 E3D1WMH_5000K

CANDELA DISTRIBUTION (FULL):

0°	
0°	5430.4
1°	5384.4
2°	5248.7
3°	5054.1
4°	4815.3
5°	4554.7
6°	4264.4
7°	3944.0
8°	3570.1
9°	3199.7
10°	2812.3
11°	2400.1
12°	1988.6
13°	1639.9
14°	1306.6
15°	1031.3
16°	814.0
17°	642.1
18°	515.9
19°	419.6
20°	344.4
21°	287.9
22°	240.3
23°	199.8
24°	166.7
25°	138.4
27.5°	90.5
30°	62.3
32.5°	38.4
35°	26.4
37.5°	16.9
40°	11.7
42.5°	8.0
45°	5.5
47.5°	3.7
50°	1.8
52.5°	0.9
55°	0.3
57.5°	0.3
60°	0.3
62.5°	0.3
65°	0.3
67.5°	0.0
70°	0.0
72.5°	0.0



TEST NUMBER: P1282756

CATALOG NUMBER: P3AS09R20B2750DE010 E3D1WMH_5000K

CANDELA DISTRIBUTION (continued):

	0°
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)