

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1290453

Luminaire Tested: P3AS05R55W2N902765DE010 E3CD1MMS\_5000K

Issue Date: 1/30/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1290453  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-36)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3AS05R55W2N902765DE010 E3CD1MMS\_5000K  
Description: 3in Adjustable Tunable White LED luminaire with, R55 optic, 5000K CCT AND, 90CRI , E3CD1MMS TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 531.0 lumens  
Efficiency: N/A  
Efficacy: 90.0 lumens/watt  
Spacing Criteria (0/90/45): 0.94 / 0.94 / 0.82  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct

Input Watts (W): 5.9  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1290453

CATALOG NUMBER: P3AS05R55W2N902765DE010 E3CD1MMS\_5000K

### Luminous Intensity Polar Plot

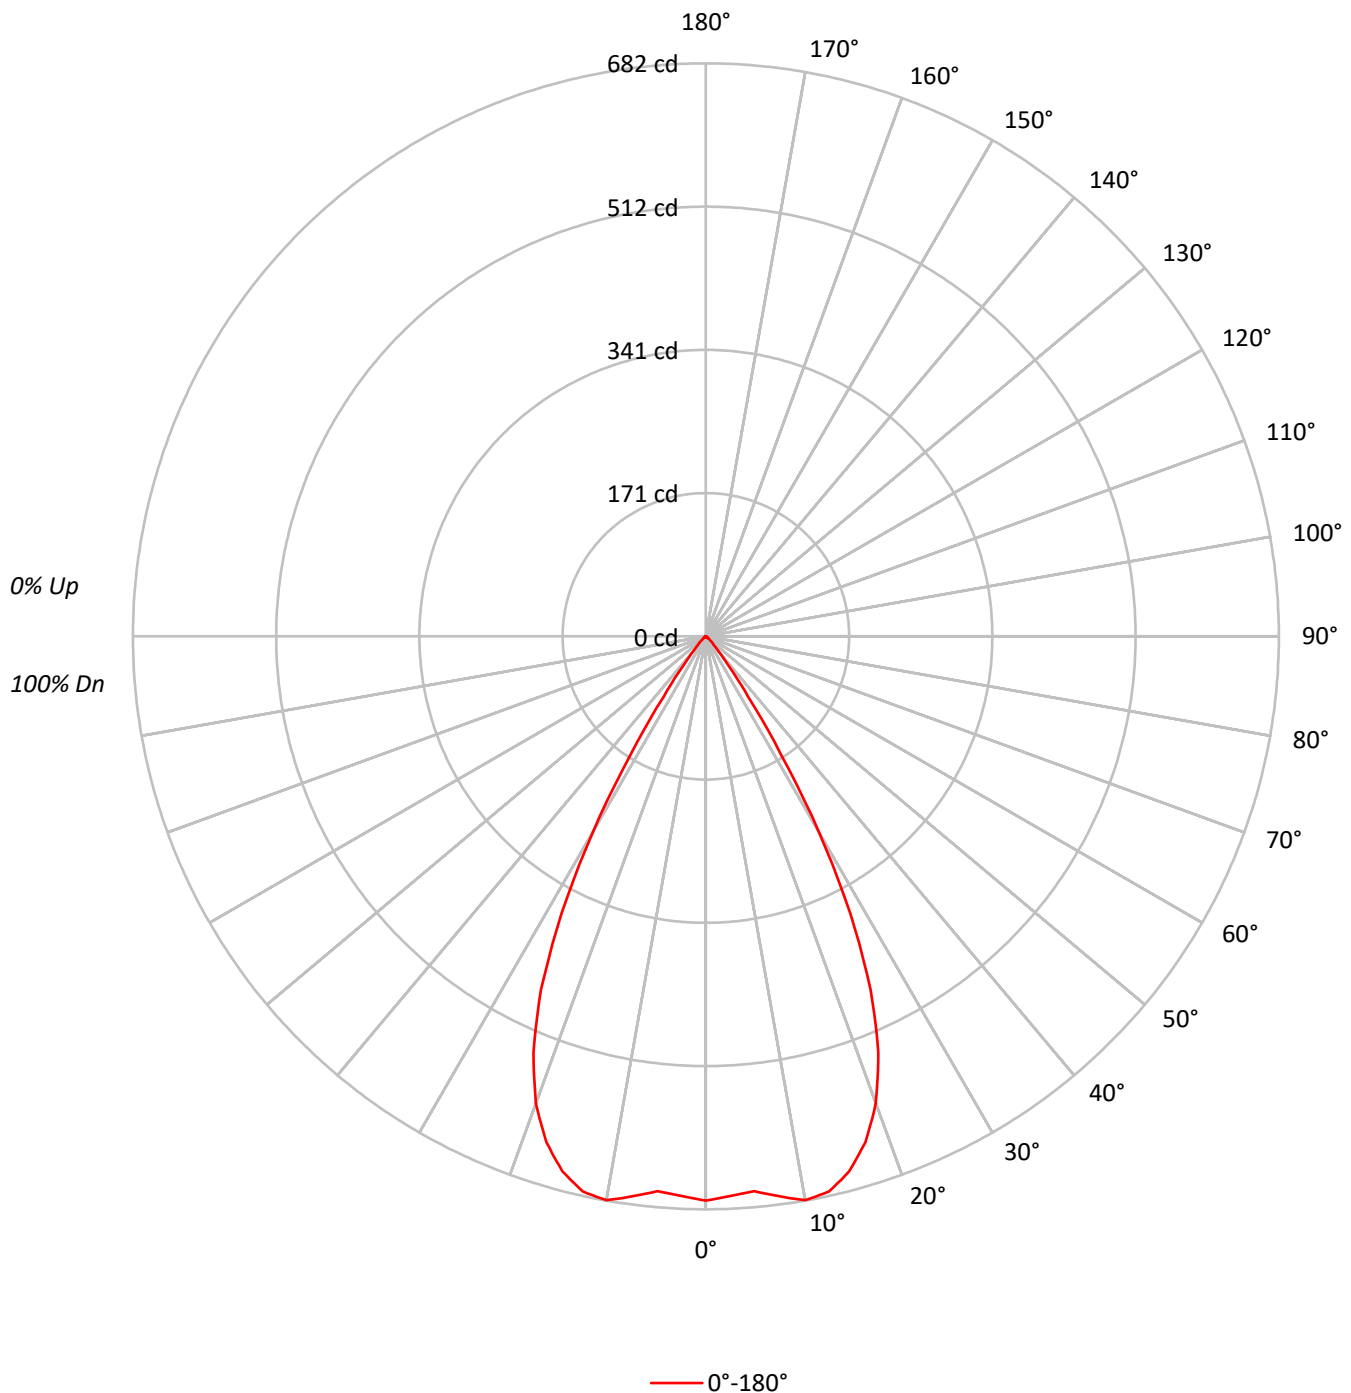

TEST NUMBER: P1290453

CATALOG NUMBER: P3AS05R55W2N902765DE010 E3CD1MMS\_5000K

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |     |     |  |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|-----|-----|-----|--|-----|-----|-----|--|-----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |  | 20  |     |     |  | 20  |     |     |  | 20  |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |  | 30  |     |     |  | 10  |     |     |  | 0   |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  |  | 50  | 30  | 10  |  | 50  | 30  | 10  |  | 0   |
| RCR |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |     |     |  |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 |  | 106 | 106 | 106 |  | 102 | 102 | 102 |  | 100 |
| 1   | 114 | 111 | 109 | 107 | 112 | 109 | 107 | 105 | 105 | 104 | 102 |  | 101 | 100 | 99  |  | 98  | 97  | 96  |  | 94  |
| 2   | 109 | 104 | 101 | 98  | 107 | 103 | 99  | 96  | 100 | 97  | 94  |  | 97  | 94  | 92  |  | 94  | 92  | 90  |  | 89  |
| 3   | 104 | 98  | 94  | 90  | 102 | 97  | 93  | 89  | 94  | 91  | 88  |  | 92  | 89  | 86  |  | 90  | 87  | 85  |  | 84  |
| 4   | 99  | 92  | 87  | 84  | 98  | 91  | 87  | 83  | 89  | 85  | 82  |  | 87  | 84  | 81  |  | 85  | 83  | 80  |  | 79  |
| 5   | 95  | 87  | 82  | 78  | 93  | 86  | 81  | 78  | 85  | 80  | 77  |  | 83  | 79  | 76  |  | 82  | 78  | 76  |  | 74  |
| 6   | 91  | 83  | 77  | 73  | 89  | 82  | 77  | 73  | 80  | 76  | 72  |  | 79  | 75  | 72  |  | 78  | 74  | 72  |  | 70  |
| 7   | 87  | 78  | 73  | 69  | 85  | 78  | 72  | 69  | 76  | 72  | 68  |  | 75  | 71  | 68  |  | 74  | 70  | 68  |  | 66  |
| 8   | 83  | 74  | 69  | 65  | 82  | 74  | 68  | 65  | 73  | 68  | 65  |  | 72  | 67  | 64  |  | 71  | 67  | 64  |  | 63  |
| 9   | 79  | 71  | 65  | 61  | 78  | 70  | 65  | 61  | 69  | 64  | 61  |  | 68  | 64  | 61  |  | 68  | 64  | 61  |  | 60  |
| 10  | 76  | 67  | 62  | 58  | 75  | 67  | 62  | 58  | 66  | 61  | 58  |  | 65  | 61  | 58  |  | 65  | 61  | 58  |  | 57  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |        |
|-----|--------|
|     | 0°     |
| 0°  | 147269 |
| 5°  | 145916 |
| 10° | 151767 |
| 15° | 149672 |
| 20° | 138005 |
| 25° | 112289 |
| 30° | 68213  |
| 35° | 23610  |
| 40° | 6727   |
| 45° | 3225   |
| 50° | 1365   |
| 55° | 612    |
| 60° | 702    |
| 65° | 623    |
| 70° | 513    |
| 75° | 678    |
| 80° | 505    |
| 85° | 0      |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3225 cd/sqm

TEST NUMBER: P1290453

CATALOG NUMBER: P3AS05R55W2N902765DE010 E3CD1MMS\_5000K

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 64.1   | 12.1      |
| 10°-20°   | 183.2  | 34.5      |
| 20°-30°   | 204.3  | 38.5      |
| 30°-40°   | 66.8   | 12.6      |
| 40°-50°   | 8.8    | 1.7       |
| 50°-60°   | 1.9    | 0.4       |
| 60°-70°   | 1.1    | 0.2       |
| 70°-80°   | 0.7    | 0.1       |
| 80°-90°   | 0.2    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| <hr/>     |        |           |
| 0°-30°    | 451.6  | 85.0      |
| 0°-40°    | 518.4  | 97.6      |
| 0°-60°    | 529.1  | 99.6      |
| 0°-90°    | 531.0  | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 531.0  | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°  | Flux |
|-----|-----|------|
| 0°  | 672 |      |
| 5°  | 663 | 64   |
| 15° | 659 | 183  |
| 25° | 464 | 204  |
| 35° | 88  | 67   |
| 45° | 10  | 9    |
| 55° | 2   | 2    |
| 65° | 1   | 1    |
| 75° | 1   | 1    |
| 85° | 0   | 0    |
| 90° | 0   |      |



TEST NUMBER: P1290453

CATALOG NUMBER: P3AS05R55W2N902765DE010 E3CD1MMS\_5000K

**CANDELA DISTRIBUTION (FULL):**

| 0°    |       |
|-------|-------|
| 0°    | 671.6 |
| 2.5°  | 666.8 |
| 5°    | 662.9 |
| 7.5°  | 672.4 |
| 10°   | 681.6 |
| 12.5° | 676.8 |
| 15°   | 659.3 |
| 17.5° | 631.3 |
| 20°   | 591.4 |
| 22.5° | 536.3 |
| 25°   | 464.1 |
| 27.5° | 372.3 |
| 30°   | 269.4 |
| 32.5° | 165.2 |
| 35°   | 88.2  |
| 37.5° | 44.7  |
| 40°   | 23.5  |
| 42.5° | 15.2  |
| 45°   | 10.4  |
| 47.5° | 7.2   |
| 50°   | 4.0   |
| 52.5° | 2.4   |
| 55°   | 1.6   |
| 57.5° | 1.6   |
| 60°   | 1.6   |
| 62.5° | 1.2   |
| 65°   | 1.2   |
| 67.5° | 0.8   |
| 70°   | 0.8   |
| 72.5° | 0.8   |
| 75°   | 0.8   |
| 77.5° | 0.4   |
| 80°   | 0.4   |
| 82.5° | 0.4   |
| 85°   | 0.0   |
| 87.5° | 0.0   |
| 90°   | 0.0   |

(END OF REPORT)