

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1292681

Luminaire Tested: P3AS09R30W2N902765DE010 E3CD1MB_3000K

Issue Date: 1/30/2026

Test Information

Test Method: LM-79-2019
Report Number: P1292681
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-16)
Test Lab: INNOVATION CENTER
Issue Date: 1/30/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: IRiS
Catalog Number: P3AS09R30W2N902765DE010 E3CD1MB_3000K
Description: 3in Adjustable Tunable White LED luminaire with, R30 optic, 3000K CCT AND, 90CRI ,
E3CD1MB TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 742.1 lumens
Efficiency: N/A
Efficacy: 82.5 lumens/watt
Spacing Criteria (0/90/45): 0.53 / 0.53 / 0.47
Luminous Opening: Circular (Dia: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1292681
CATALOG NUMBER: P3AS09R30W2N902765DE010 E3CD1MB_3000K

Luminous Intensity Polar Plot

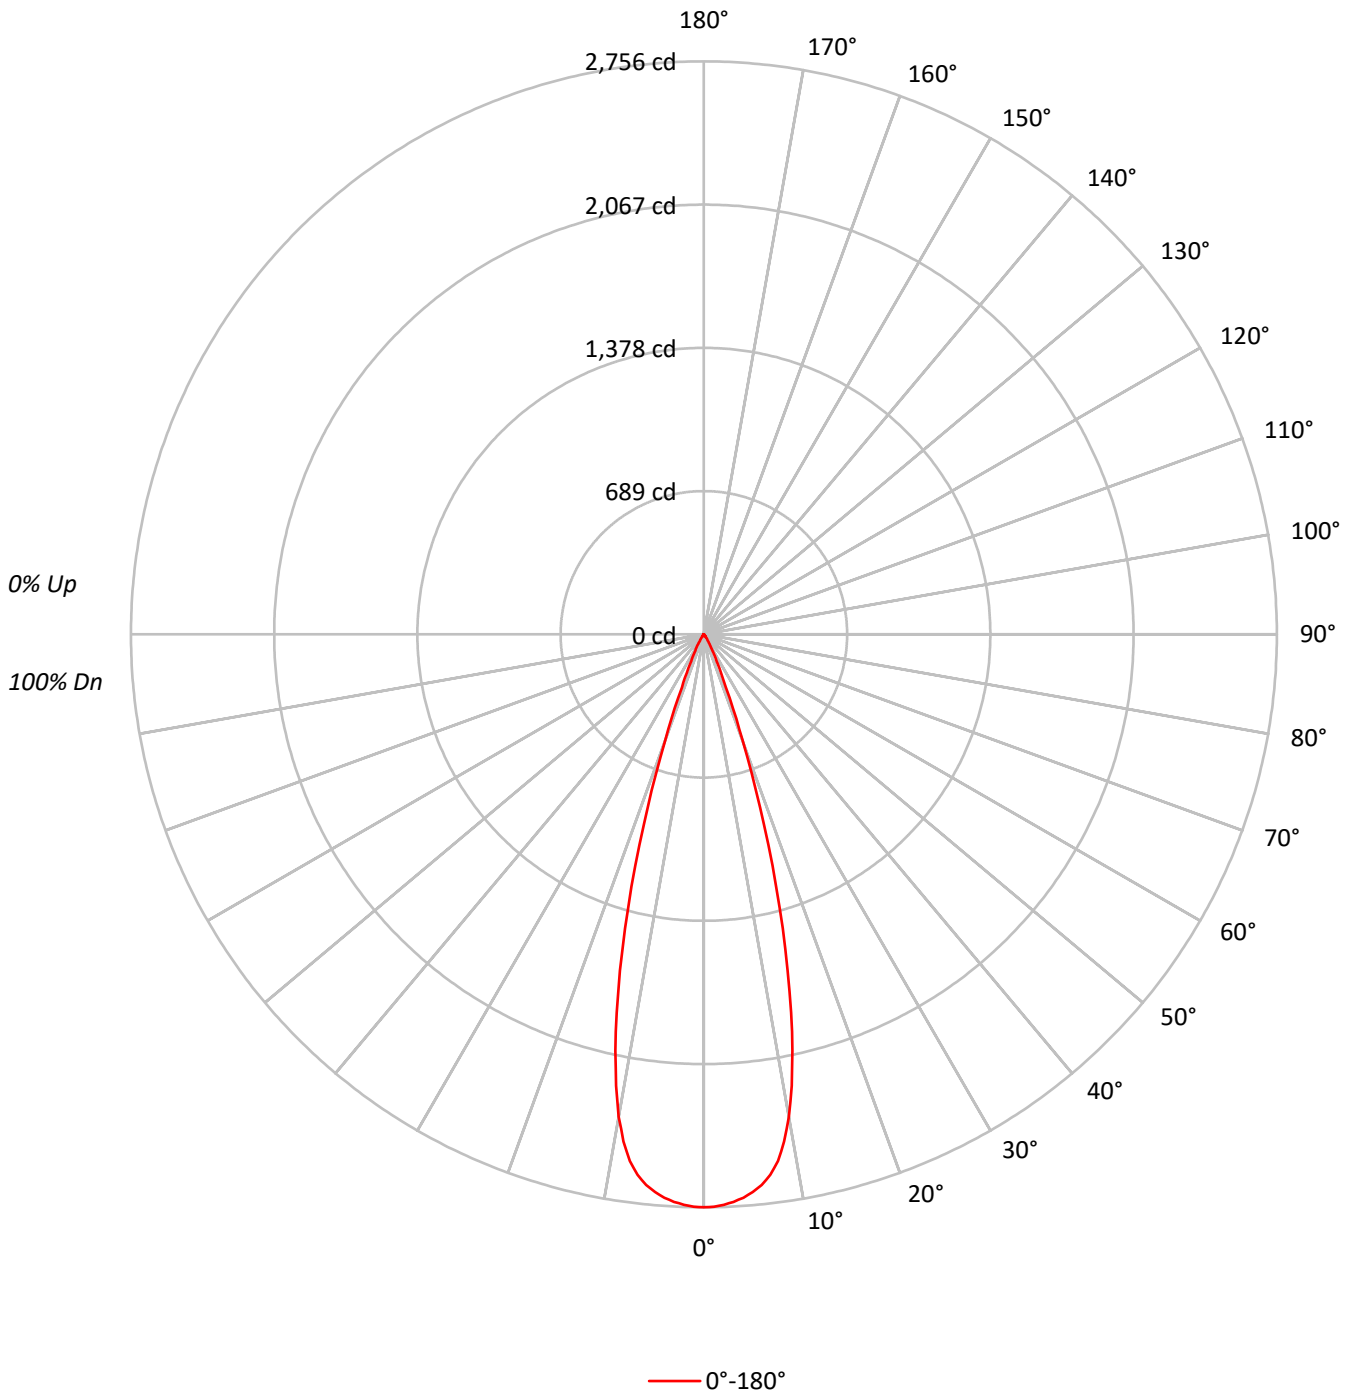



TEST NUMBER: P1292681

CATALOG NUMBER: P3AS09R30W2N902765DE010 E3CD1MB_3000K

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 247.6 | 33.4 |
| 10°-20° | 385.8 | 52.0 |
| 20°-30° | 89.6 | 12.1 |
| 30°-40° | 13.9 | 1.9 |
| 40°-50° | 2.4 | 0.3 |
| 50°-60° | 1.1 | 0.2 |
| 60°-70° | 1.0 | 0.1 |
| 70°-80° | 0.6 | 0.1 |
| 80°-90° | 0.1 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 723.0 | 97.4 |
| 0°-40° | 736.9 | 99.3 |
| 0°-60° | 740.4 | 99.8 |
| 0°-90° | 742.1 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 742.1 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 2756 | |
| 5° | 2693 | 248 |
| 15° | 1465 | 386 |
| 25° | 154 | 90 |
| 35° | 17 | 14 |
| 45° | 2 | 2 |
| 55° | 1 | 1 |
| 65° | 1 | 1 |
| 75° | 1 | 1 |
| 85° | 0 | 0 |
| 90° | 0 | |



TEST NUMBER: P1292681

CATALOG NUMBER: P3AS09R30W2N902765DE010 E3CD1MB_3000K

CANDELA DISTRIBUTION (FULL):

| 0° | |
|-------|--------|
| 0° | 2755.5 |
| 1° | 2753.8 |
| 2° | 2746.2 |
| 3° | 2733.4 |
| 4° | 2717.1 |
| 5° | 2693.2 |
| 6° | 2663.5 |
| 7° | 2619.2 |
| 8° | 2558.6 |
| 9° | 2469.4 |
| 10° | 2356.9 |
| 11° | 2211.8 |
| 12° | 2048.0 |
| 13° | 1866.2 |
| 14° | 1666.3 |
| 15° | 1464.6 |
| 17.5° | 958.1 |
| 20° | 540.9 |
| 22.5° | 276.3 |
| 25° | 154.4 |
| 27.5° | 95.0 |
| 30° | 58.3 |
| 32.5° | 31.5 |
| 35° | 16.9 |
| 37.5° | 11.1 |
| 40° | 7.0 |
| 42.5° | 4.1 |
| 45° | 2.3 |
| 47.5° | 1.7 |
| 50° | 1.7 |
| 52.5° | 1.2 |
| 55° | 1.2 |
| 57.5° | 1.2 |
| 60° | 1.2 |
| 62.5° | 1.2 |
| 65° | 1.2 |
| 67.5° | 0.6 |
| 70° | 0.6 |
| 72.5° | 0.6 |
| 75° | 0.6 |
| 77.5° | 0.6 |
| 80° | 0.6 |
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |



TEST NUMBER: P1292681
CATALOG NUMBER: P3AS09R30W2N902765DE010 E3CD1MB_3000K

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0

(END OF REPORT)