

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1292967

Luminaire Tested: P3AS09R35W2N902750DE010 E3DLP1MW_4000K

Issue Date: 1/30/2026

Test Information

Test Method: LM-79-2019
Report Number: P1292967
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-17)
Test Lab: INNOVATION CENTER
Issue Date: 1/30/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: IRiS
Catalog Number: P3AS09R35W2N902750DE010 E3DLP1MW_4000K
Description: 3in Adjustable Tunable White LED luminaire with, R35 optic, 4000K CCT AND, 90CRI ,
E3DLP1MW TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 384.0 lumens
Efficiency: N/A
Efficacy: 42.7 lumens/watt
Spacing Criteria (0/90/45): 0.69 / 0.69 / 0.72
Luminous Opening: Circular (Dia: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1292967
CATALOG NUMBER: P3AS09R35W2N902750DE010 E3DLP1MW_4000K

Luminous Intensity Polar Plot

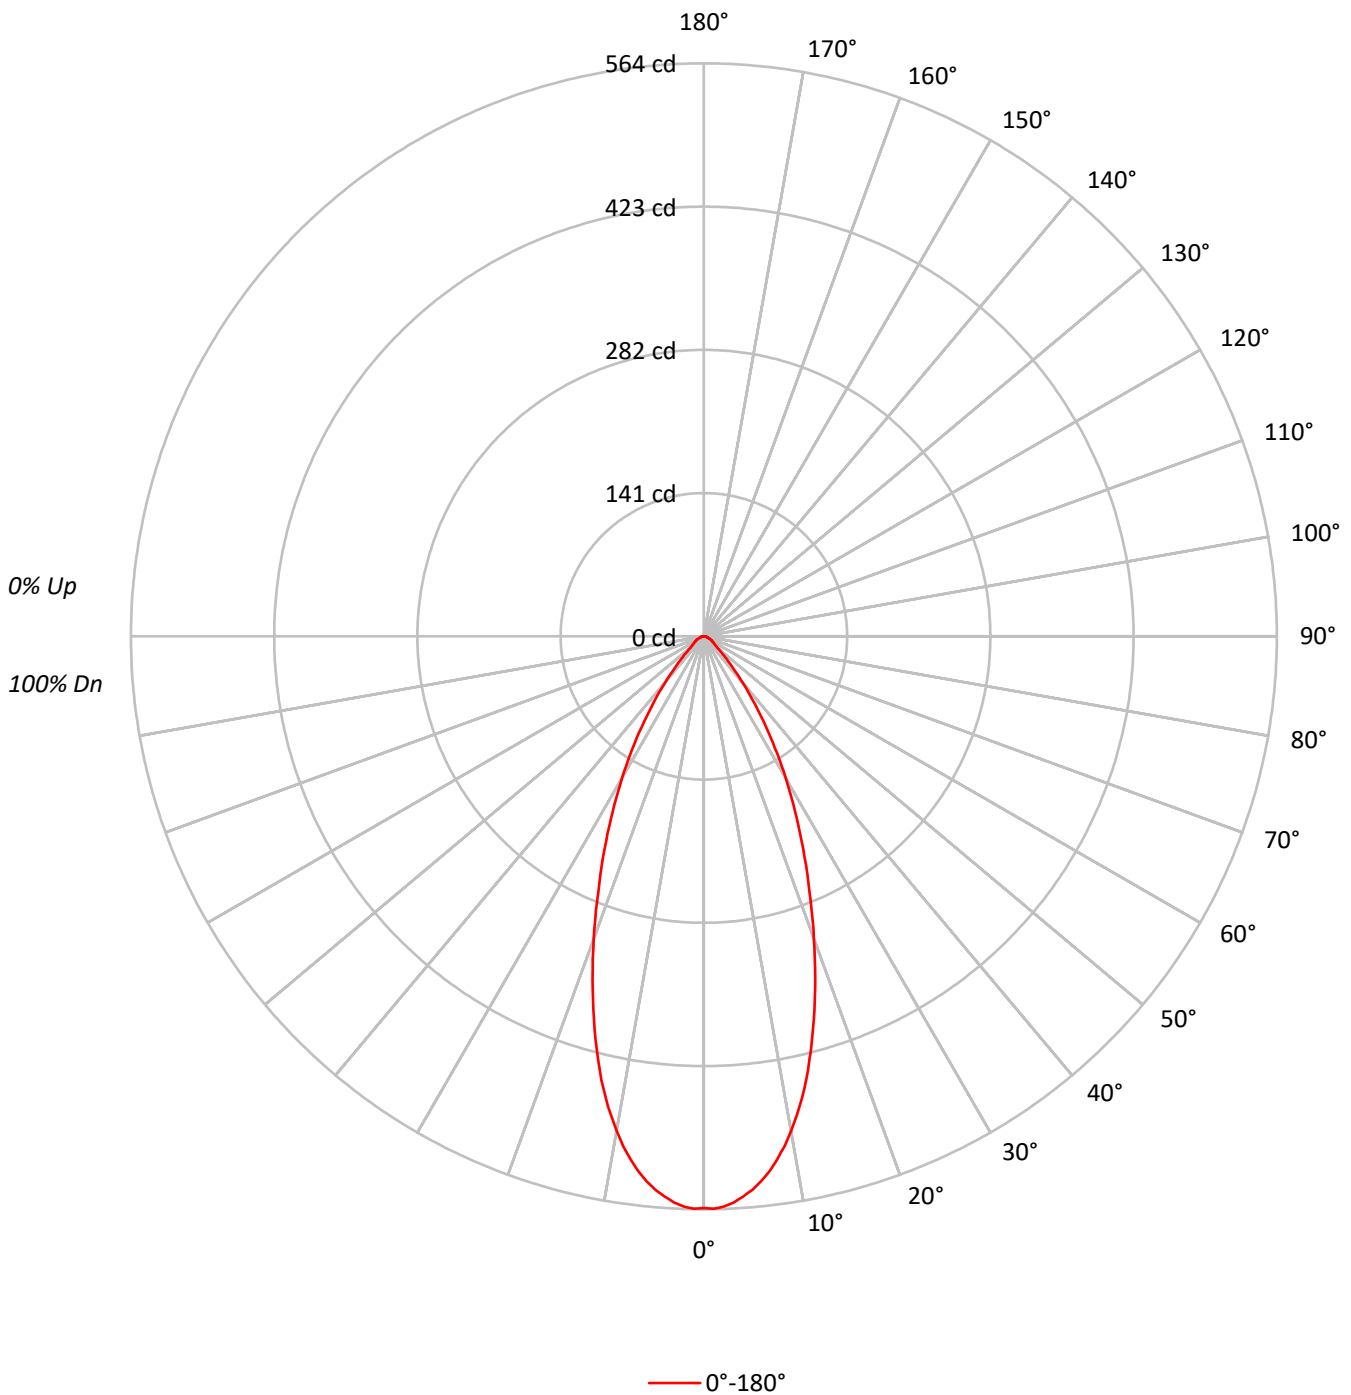



TEST NUMBER: P1292967
 CATALOG NUMBER: P3AS09R35W2N902750DE010 E3DLP1MW_4000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93	93	93	93
2	107	102	98	94	105	100	97	93	97	94	91	94	92	89	91	89	87	86	86	86	86
3	102	95	90	86	100	94	89	85	91	87	84	89	85	82	86	84	81	80	80	80	80
4	97	89	83	79	95	88	82	78	86	81	77	84	80	77	82	78	76	74	74	74	74
5	92	83	77	73	90	82	77	73	81	76	72	79	75	71	77	74	71	69	69	69	69
6	87	78	72	68	86	77	72	68	76	71	67	75	70	67	73	69	66	65	65	65	65
7	83	74	68	63	82	73	67	63	72	67	63	71	66	63	69	65	62	61	61	61	61
8	79	70	64	60	78	69	63	59	68	63	59	67	62	59	66	62	59	57	57	57	57
9	76	66	60	56	75	66	60	56	65	59	56	64	59	56	63	59	56	54	54	54	54
10	72	63	57	53	71	62	57	53	61	56	53	61	56	53	60	56	53	51	51	51	51

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	123433
5°	120383
10°	110063
15°	93417
20°	73950
25°	55939
30°	40715
35°	27546
40°	16917
45°	9706
50°	5833
55°	4741
60°	4166
65°	3684
70°	3013
75°	2965
80°	3031
85°	3019

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 9706 cd/sqm



TEST NUMBER: P1292967

CATALOG NUMBER: P3AS09R35W2N902750DE010 E3DLP1MW_4000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	50.5	13.2
10°-20°	113.4	29.5
20°-30°	106.1	27.6
30°-40°	65.0	16.9
40°-50°	25.6	6.7
50°-60°	11.3	2.9
60°-70°	7.0	1.8
70°-80°	3.7	1.0
80°-90°	1.3	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	270.1	70.3
0°-40°	335.1	87.3
0°-60°	371.9	96.9
0°-90°	384.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	384.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	563	
5°	547	51
15°	412	113
25°	231	106
35°	103	65
45°	31	26
55°	12	11
65°	7	7
75°	4	4
85°	1	1
90°	0	



TEST NUMBER: P1292967
CATALOG NUMBER: P3AS09R35W2N902750DE010 E3DLP1MW_4000K

CANDELA DISTRIBUTION (FULL):

0°	
0°	562.9
1°	563.5
2°	561.7
3°	558.1
4°	552.8
5°	546.9
6°	539.2
7°	530.4
8°	519.7
9°	507.9
10°	494.3
11°	480.1
12°	464.7
13°	448.2
14°	429.8
15°	411.5
17.5°	364.2
20°	316.9
22.5°	271.4
25°	231.2
27.5°	193.9
30°	160.8
32.5°	130.1
35°	102.9
37.5°	78.6
40°	59.1
42.5°	42.6
45°	31.3
47.5°	22.5
50°	17.1
52.5°	14.2
55°	12.4
57.5°	10.6
60°	9.5
62.5°	8.3
65°	7.1
67.5°	5.9
70°	4.7
72.5°	4.1
75°	3.5
77.5°	3.0
80°	2.4
82.5°	1.8
85°	1.2
87.5°	0.6



TEST NUMBER: P1292967
CATALOG NUMBER: P3AS09R35W2N902750DE010 E3DLP1MW_4000K

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0

(END OF REPORT)