

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1293015

Luminaire Tested: P3AS09R35W2N902765DE010 E3CD1MB_4000K

Issue Date: 1/30/2026

Test Information

Test Method: LM-79-2019
Report Number: P1293015
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-20)
Test Lab: INNOVATION CENTER
Issue Date: 1/30/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: IRiS
Catalog Number: P3AS09R35W2N902765DE010 E3CD1MB_4000K
Description: 3in Adjustable Tunable White LED luminaire with, R35 optic, 4000K CCT AND, 90CRI ,
E3CD1MB TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 751.1 lumens
Efficiency: N/A
Efficacy: 83.5 lumens/watt
Spacing Criteria (0/90/45): 0.58 / 0.58 / 0.52
Luminous Opening: Circular (Dia: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1293015
CATALOG NUMBER: P3AS09R35W2N902765DE010 E3CD1MB_4000K

Luminous Intensity Polar Plot

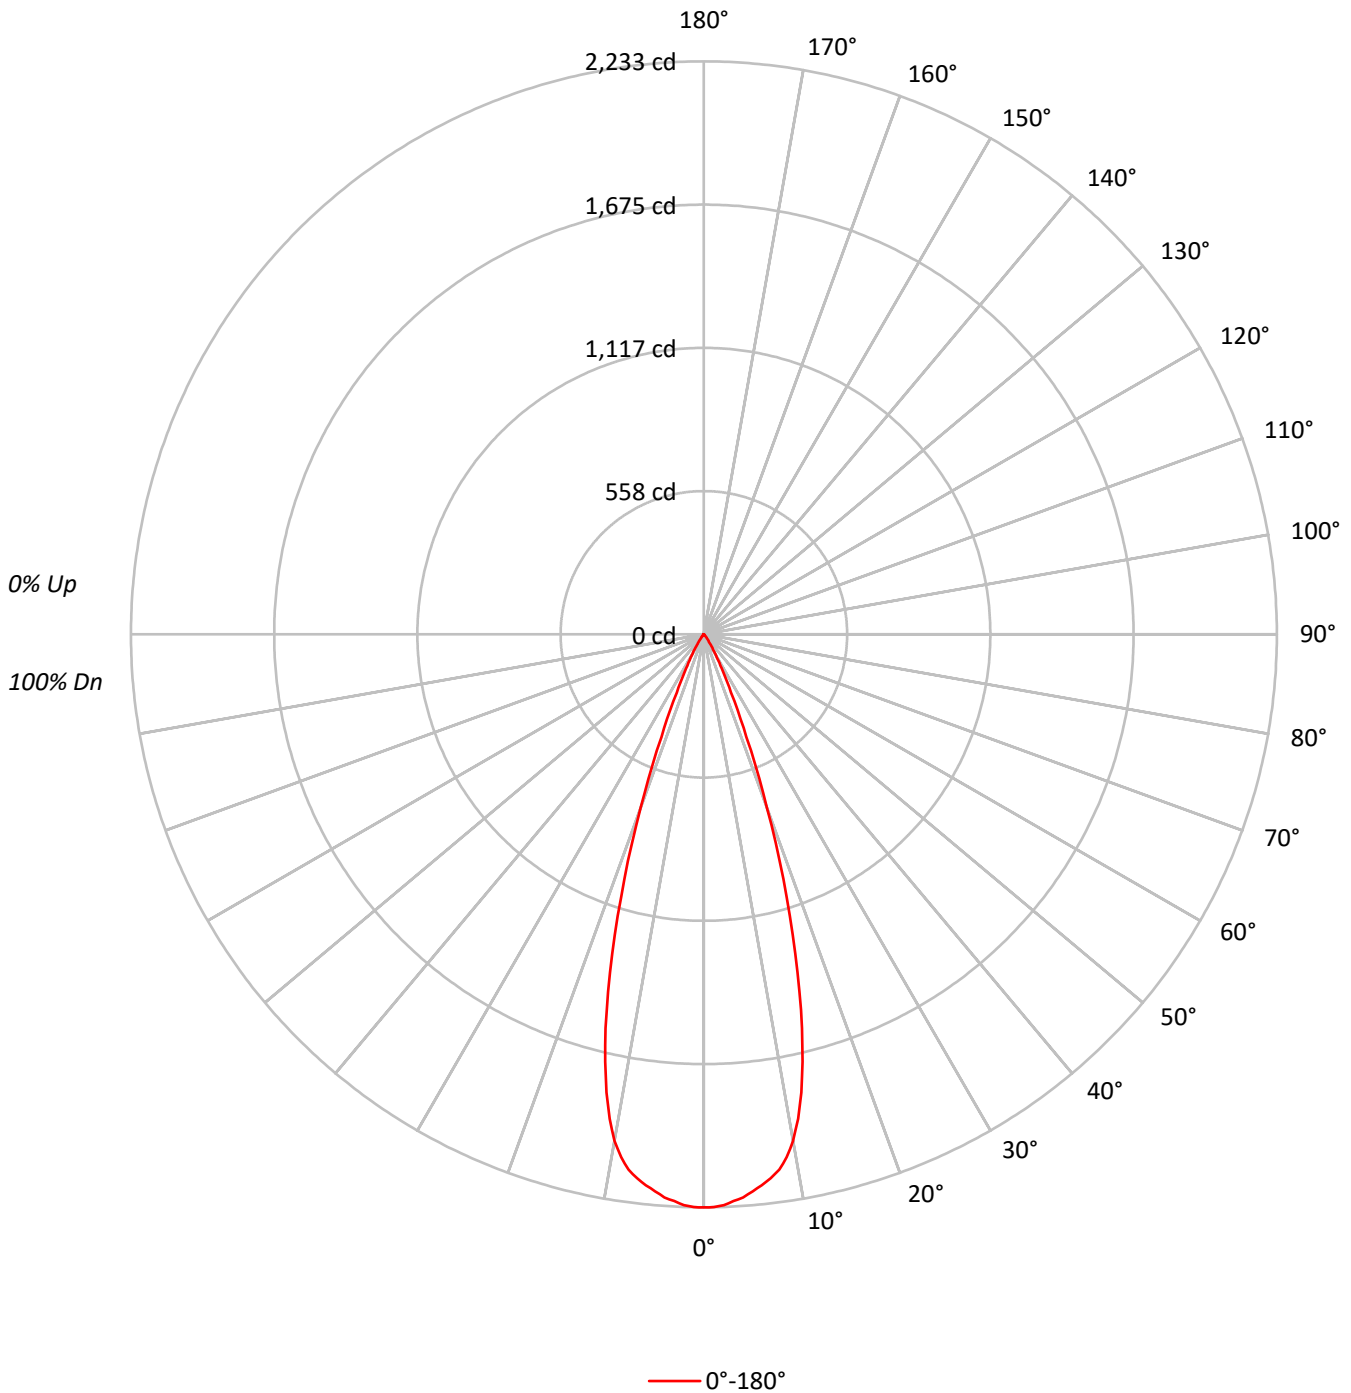



TEST NUMBER: P1293015

CATALOG NUMBER: P3AS09R35W2N902765DE010 E3CD1MB_4000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96	96	96	96
2	111	107	104	101	109	105	103	100	102	100	98	99	98	96	97	95	94	93	93	93	93
3	107	102	98	95	105	101	97	95	98	96	93	96	94	92	94	92	90	89	89	89	89
4	104	98	94	91	102	97	93	90	95	92	89	93	90	88	91	89	87	86	86	86	86
5	100	94	90	87	99	93	89	86	92	88	86	90	87	85	89	86	84	83	83	83	83
6	97	91	86	83	96	90	86	83	89	85	82	87	84	82	86	83	81	80	80	80	80
7	94	87	83	80	93	87	83	80	86	82	79	85	81	79	84	81	79	77	77	77	77
8	91	84	80	77	90	84	80	77	83	79	77	82	79	76	81	78	76	75	75	75	75
9	89	82	77	74	88	81	77	74	80	77	74	80	76	74	79	76	74	73	73	73	73
10	86	79	75	72	85	79	75	72	78	74	72	77	74	72	77	74	71	70	70	70	70

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	489698
5°	479726
10°	446284
15°	327198
20°	167548
25°	60391
30°	23523
35°	8245
40°	3378
45°	930
50°	819
55°	918
60°	789
65°	623
70°	769
75°	1017
80°	758
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 75°
 Luminance: 1017 cd/sqm



TEST NUMBER: P1293015

CATALOG NUMBER: P3AS09R35W2N902765DE010 E3CD1MB_4000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	203.2	27.1
10°-20°	381.2	50.8
20°-30°	135.0	18.0
30°-40°	23.6	3.1
40°-50°	3.5	0.5
50°-60°	1.9	0.3
60°-70°	1.4	0.2
70°-80°	1.0	0.1
80°-90°	0.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	719.3	95.8
0°-40°	743.0	98.9
0°-60°	748.4	99.6
0°-90°	751.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	751.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2233	
5°	2179	203
15°	1441	381
25°	250	135
35°	31	24
45°	3	3
55°	2	2
65°	1	1
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P1293015

CATALOG NUMBER: P3AS09R35W2N902765DE010 E3CD1MB_4000K

CANDELA DISTRIBUTION (FULL):

0°	
0°	2233.2
1°	2232.6
2°	2225.5
3°	2211.9
4°	2199.5
5°	2179.4
6°	2158.7
7°	2135.6
8°	2107.2
9°	2062.9
10°	2004.3
11°	1923.3
12°	1825.7
13°	1709.8
14°	1582.1
15°	1441.3
17.5°	1073.4
20°	718.0
22.5°	432.9
25°	249.6
27.5°	149.0
30°	92.9
32.5°	53.8
35°	30.8
37.5°	19.5
40°	11.8
42.5°	5.9
45°	3.0
47.5°	2.4
50°	2.4
52.5°	2.4
55°	2.4
57.5°	1.8
60°	1.8
62.5°	1.8
65°	1.2
67.5°	1.2
70°	1.2
72.5°	1.2
75°	1.2
77.5°	0.6
80°	0.6
82.5°	0.6
85°	0.0
87.5°	0.0



TEST NUMBER: P1293015
CATALOG NUMBER: P3AS09R35W2N902765DE010 E3CD1MB_4000K

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0

(END OF REPORT)