

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1293332

Luminaire Tested: P3AS09R40W2N902765DE010 E3CD1MMS\_3000K

Issue Date: 1/30/2026

**Test Information**


Test Method: LM-79-2019  
Report Number: P1293332  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-24)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3AS09R40W2N902765DE010 E3CD1MMS\_3000K  
Description: 3in Adjustable Tunable White LED luminaire with, R40 optic, 3000K CCT AND, 90CRI ,  
E3CD1MMS TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 819.0 lumens  
Efficiency: N/A  
Efficacy: 91.0 lumens/watt  
Spacing Criteria (0/90/45): 0.69 / 0.69 / 0.59  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 9  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1293332  
CATALOG NUMBER: P3AS09R40W2N902765DE010 E3CD1MMS\_3000K

### Luminous Intensity Polar Plot

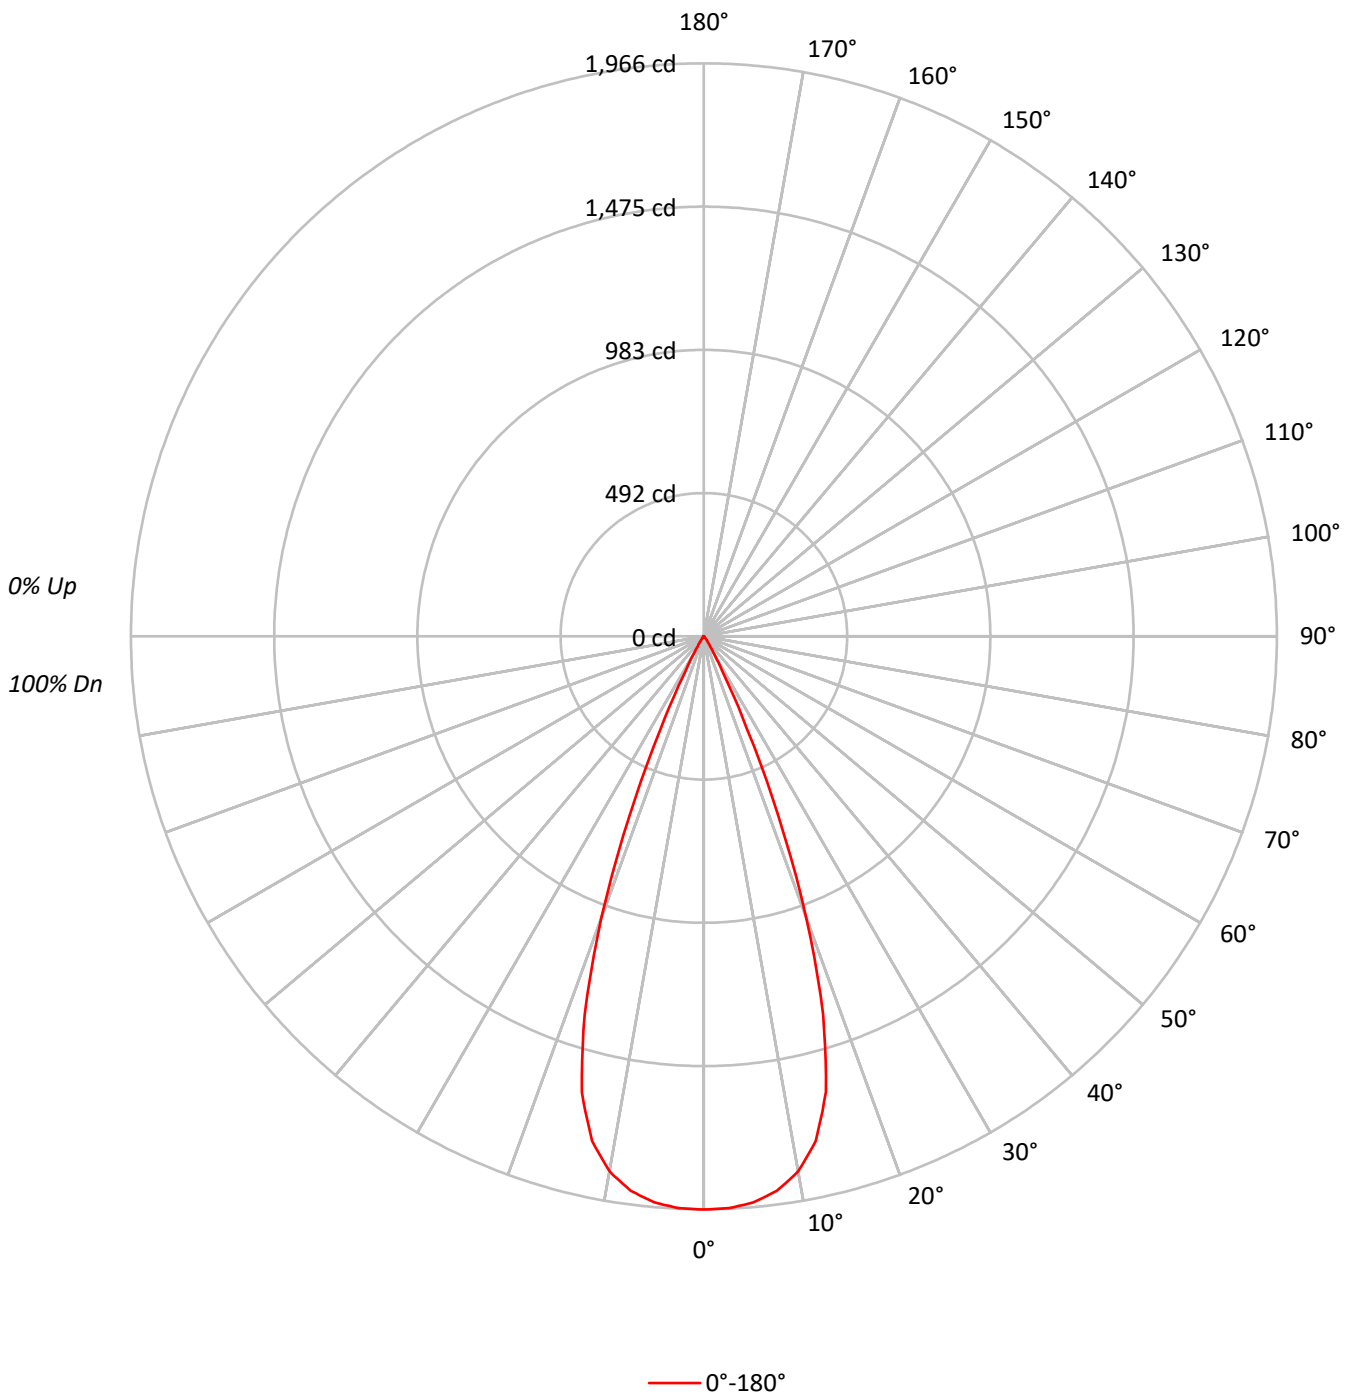



TEST NUMBER: P1293332  
 CATALOG NUMBER: P3AS09R40W2N902765DE010 E3CD1MMS\_3000K

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     |     |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |     | 30  |     |     |     | 10  |     |     | 0   |     |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 0   |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | 100 | 100 | 100 |
| 1   | 115 | 112 | 110 | 109 | 112 | 110 | 109 | 107 | 106 | 105 | 104 | 103 | 102 | 101 | 99  | 98  | 98  | 96  | 96  | 96  | 96  |
| 2   | 111 | 107 | 104 | 101 | 109 | 105 | 102 | 100 | 102 | 100 | 98  | 99  | 97  | 96  | 96  | 95  | 94  | 92  | 92  | 92  | 92  |
| 3   | 107 | 102 | 98  | 95  | 105 | 100 | 97  | 94  | 98  | 95  | 93  | 96  | 93  | 91  | 94  | 92  | 90  | 89  | 89  | 89  | 89  |
| 4   | 103 | 97  | 93  | 90  | 102 | 96  | 92  | 89  | 94  | 91  | 88  | 92  | 90  | 87  | 91  | 88  | 86  | 85  | 85  | 85  | 85  |
| 5   | 100 | 93  | 89  | 86  | 98  | 92  | 88  | 85  | 91  | 87  | 85  | 89  | 86  | 84  | 88  | 85  | 83  | 82  | 82  | 82  | 82  |
| 6   | 96  | 90  | 85  | 82  | 95  | 89  | 85  | 82  | 88  | 84  | 81  | 86  | 83  | 81  | 85  | 82  | 80  | 79  | 79  | 79  | 79  |
| 7   | 93  | 86  | 82  | 79  | 92  | 86  | 81  | 78  | 85  | 81  | 78  | 83  | 80  | 78  | 82  | 79  | 77  | 76  | 76  | 76  | 76  |
| 8   | 90  | 83  | 79  | 76  | 89  | 83  | 78  | 75  | 82  | 78  | 75  | 81  | 77  | 75  | 80  | 77  | 75  | 73  | 73  | 73  | 73  |
| 9   | 87  | 80  | 76  | 73  | 87  | 80  | 76  | 73  | 79  | 75  | 72  | 78  | 75  | 72  | 77  | 74  | 72  | 71  | 71  | 71  | 71  |
| 10  | 85  | 77  | 73  | 70  | 84  | 77  | 73  | 70  | 76  | 73  | 70  | 76  | 72  | 70  | 75  | 72  | 70  | 69  | 69  | 69  | 69  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |        |
|-----|--------|
|     | 0°     |
| 0°  | 431215 |
| 5°  | 429143 |
| 10° | 415156 |
| 15° | 367312 |
| 20° | 239654 |
| 25° | 84900  |
| 30° | 18003  |
| 35° | 5916   |
| 40° | 2176   |
| 45° | 713    |
| 50° | 580    |
| 55° | 650    |
| 60° | 526    |
| 65° | 623    |
| 70° | 385    |
| 75° | 508    |
| 80° | 758    |
| 85° | 0      |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 82.5°  
 Luminance: 1008 cd/sqm



TEST NUMBER: P1293332

CATALOG NUMBER: P3AS09R40W2N902765DE010 E3CD1MMS\_3000K

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 183.4  | 22.4      |
| 10°-20°   | 427.2  | 52.2      |
| 20°-30°   | 185.4  | 22.6      |
| 30°-40°   | 17.1   | 2.1       |
| 40°-50°   | 2.4    | 0.3       |
| 50°-60°   | 1.5    | 0.2       |
| 60°-70°   | 1.1    | 0.1       |
| 70°-80°   | 0.6    | 0.1       |
| 80°-90°   | 0.2    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 796.1  | 97.2      |
| 0°-40°    | 813.1  | 99.3      |
| 0°-60°    | 817.0  | 99.8      |
| 0°-90°    | 819.0  | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 819.0  | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 1966 |      |
| 5°  | 1950 | 183  |
| 15° | 1618 | 427  |
| 25° | 351  | 185  |
| 35° | 22   | 17   |
| 45° | 2    | 2    |
| 55° | 2    | 1    |
| 65° | 1    | 1    |
| 75° | 1    | 1    |
| 85° | 0    | 0    |
| 90° | 0    |      |



TEST NUMBER: P1293332  
CATALOG NUMBER: P3AS09R40W2N902765DE010 E3CD1MMS\_3000K

**CANDELA DISTRIBUTION (FULL):**

| 0°    |        |
|-------|--------|
| 0°    | 1966.5 |
| 2.5°  | 1964.2 |
| 5°    | 1949.6 |
| 7.5°  | 1918.7 |
| 10°   | 1864.5 |
| 12.5° | 1773.0 |
| 15°   | 1618.0 |
| 17.5° | 1361.0 |
| 20°   | 1027.0 |
| 22.5° | 666.8  |
| 25°   | 350.9  |
| 27.5° | 151.0  |
| 30°   | 71.1   |
| 32.5° | 38.5   |
| 35°   | 22.1   |
| 37.5° | 13.4   |
| 40°   | 7.6    |
| 42.5° | 4.1    |
| 45°   | 2.3    |
| 47.5° | 1.7    |
| 50°   | 1.7    |
| 52.5° | 1.7    |
| 55°   | 1.7    |
| 57.5° | 1.7    |
| 60°   | 1.2    |
| 62.5° | 1.2    |
| 65°   | 1.2    |
| 67.5° | 1.2    |
| 70°   | 0.6    |
| 72.5° | 0.6    |
| 75°   | 0.6    |
| 77.5° | 0.6    |
| 80°   | 0.6    |
| 82.5° | 0.6    |
| 85°   | 0.0    |
| 87.5° | 0.0    |
| 90°   | 0.0    |

(END OF REPORT)