

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1295343

Luminaire Tested: P3AS13R15W2N902750DE010 E3D1LI_3000K

Issue Date: 1/29/2026

Test Information

Test Method: LM-79-2019
Report Number: P1295343
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2501-338-7)
Test Lab: INNOVATION CENTER
Issue Date: 1/29/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: IRiS
Catalog Number: P3AS13R15W2N902750DE010 E3D1LI_3000K
Description: 3in Adjustable Tunable White LED luminaire with, R15 optic, 3000K CCT AND, 90CRI ,
E3D1LI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 988.0 lumens
Efficiency: N/A
Efficacy: 80.3 lumens/watt
Spacing Criteria (0/90/45): 0.3 / 0.3 / 0.29
Luminous Opening: Circular (Dia: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 12.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1295343
CATALOG NUMBER: P3AS13R15W2N902750DE010 E3D1LI_3000K

Luminous Intensity Polar Plot

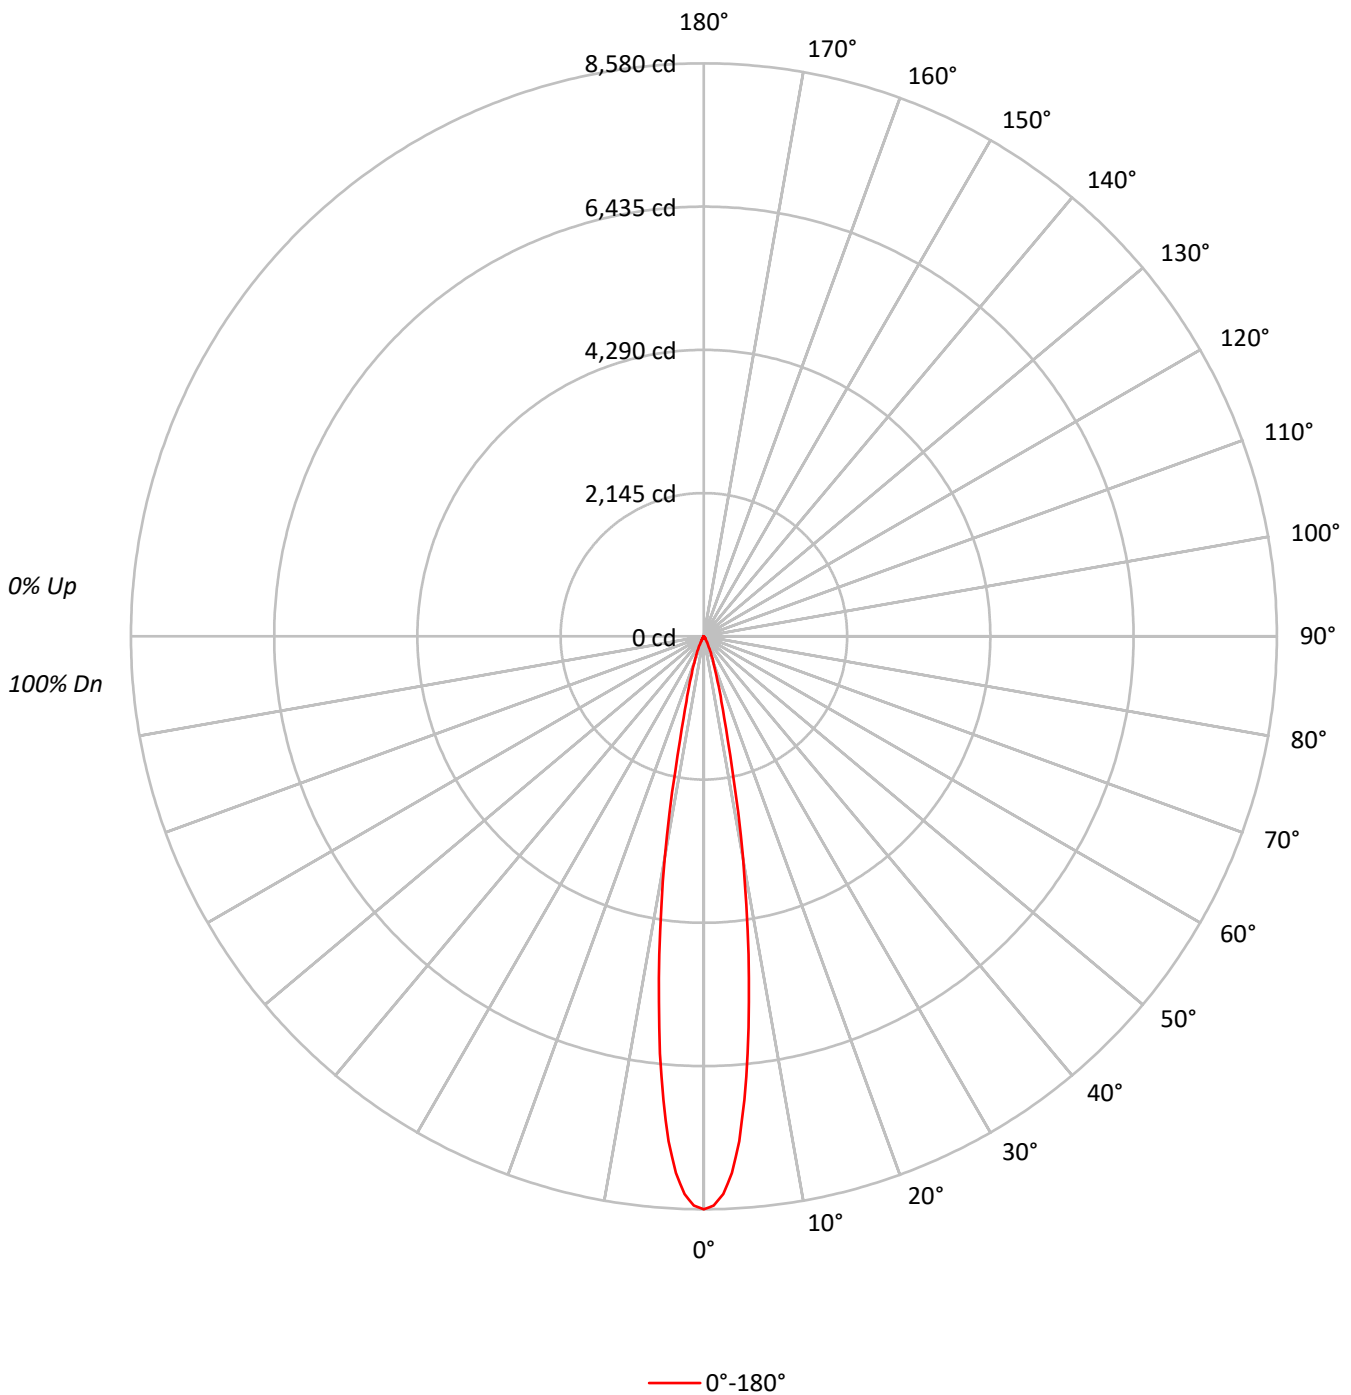



TEST NUMBER: P1295343

CATALOG NUMBER: P3AS13R15W2N902750DE010 E3D1LI_3000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	116	114	112	111	113	112	110	109	108	107	105	104	103	102	101	100	99	99	98	98	98
2	112	109	107	105	110	108	105	103	105	103	101	102	100	99	99	98	97	99	98	97	96
3	110	106	102	100	108	104	102	99	102	100	98	100	98	96	98	96	95	98	96	95	94
4	107	102	99	96	105	101	98	96	99	97	95	98	96	94	96	94	93	96	94	93	92
5	105	100	96	94	103	99	96	93	97	94	92	96	93	92	94	93	91	94	93	91	90
6	102	97	94	91	101	96	93	91	95	92	90	94	92	90	93	91	89	93	91	89	88
7	100	95	91	89	99	94	91	89	93	90	88	92	90	88	91	89	88	91	89	88	87
8	98	93	89	87	97	92	89	87	91	89	87	91	88	86	90	88	86	90	88	86	85
9	96	91	88	85	96	91	87	85	90	87	85	89	87	85	88	86	85	88	86	85	84
10	95	89	86	84	94	89	86	84	88	85	83	88	85	83	87	85	83	87	85	83	82

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1881406
5°	1534158
10°	751333
15°	229967
20°	97378
25°	44059
30°	17167
35°	7924
40°	2462
45°	930
50°	375
55°	153
60°	175
65°	208
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 930 cd/sqm



TEST NUMBER: P1295343

CATALOG NUMBER: P3AS13R15W2N902750DE010 E3D1LI_3000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	542.5	54.9
10°-20°	332.9	33.7
20°-30°	89.4	9.1
30°-40°	19.7	2.0
40°-50°	2.8	0.3
50°-60°	0.5	0.1
60°-70°	0.2	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	964.8	97.7
0°-40°	984.5	99.6
0°-60°	987.8	100.0
0°-90°	988.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	988.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	8580	
5°	6970	543
15°	1013	333
25°	182	89
35°	30	20
45°	3	3
55°	0	0
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P1295343

CATALOG NUMBER: P3AS13R15W2N902750DE010 E3D1LI_3000K

CANDELA DISTRIBUTION (FULL):

0°	
0°	8579.9
1°	8526.3
2°	8354.4
3°	8044.5
4°	7578.1
5°	6969.7
6°	6281.5
7°	5515.0
8°	4810.7
9°	4064.0
10°	3374.3
11°	2691.8
12°	2071.0
13°	1593.0
14°	1261.0
15°	1013.0
17.5°	627.9
20°	417.3
22.5°	281.0
25°	182.1
27.5°	107.9
30°	67.8
32.5°	45.7
35°	29.6
37.5°	16.5
40°	8.6
42.5°	4.9
45°	3.0
47.5°	1.9
50°	1.1
52.5°	0.7
55°	0.4
57.5°	0.4
60°	0.4
62.5°	0.4
65°	0.4
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0



TEST NUMBER: P1295343

CATALOG NUMBER: P3AS13R15W2N902750DE010 E3D1LI_3000K

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0

(END OF REPORT)