

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1295514

Luminaire Tested: P3AS13R15W2N902765DE010 E3D1LI_6500K

Issue Date: 1/29/2026

Test Information

Test Method: LM-79-2019
Report Number: P1295514
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2501-338-7)
Test Lab: INNOVATION CENTER
Issue Date: 1/29/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: IRiS
Catalog Number: P3AS13R15W2N902765DE010 E3D1LI_6500K
Description: 3in Adjustable Tunable White LED luminaire with, R15 optic, 6500K CCT AND, 90CRI ,
E3D1LI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 997.0 lumens
Efficiency: N/A
Efficacy: 81.1 lumens/watt
Spacing Criteria (0/90/45): 0.3 / 0.3 / 0.29
Luminous Opening: Circular (Dia: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 12.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1295514
CATALOG NUMBER: P3AS13R15W2N902765DE010 E3D1LI_6500K

Luminous Intensity Polar Plot

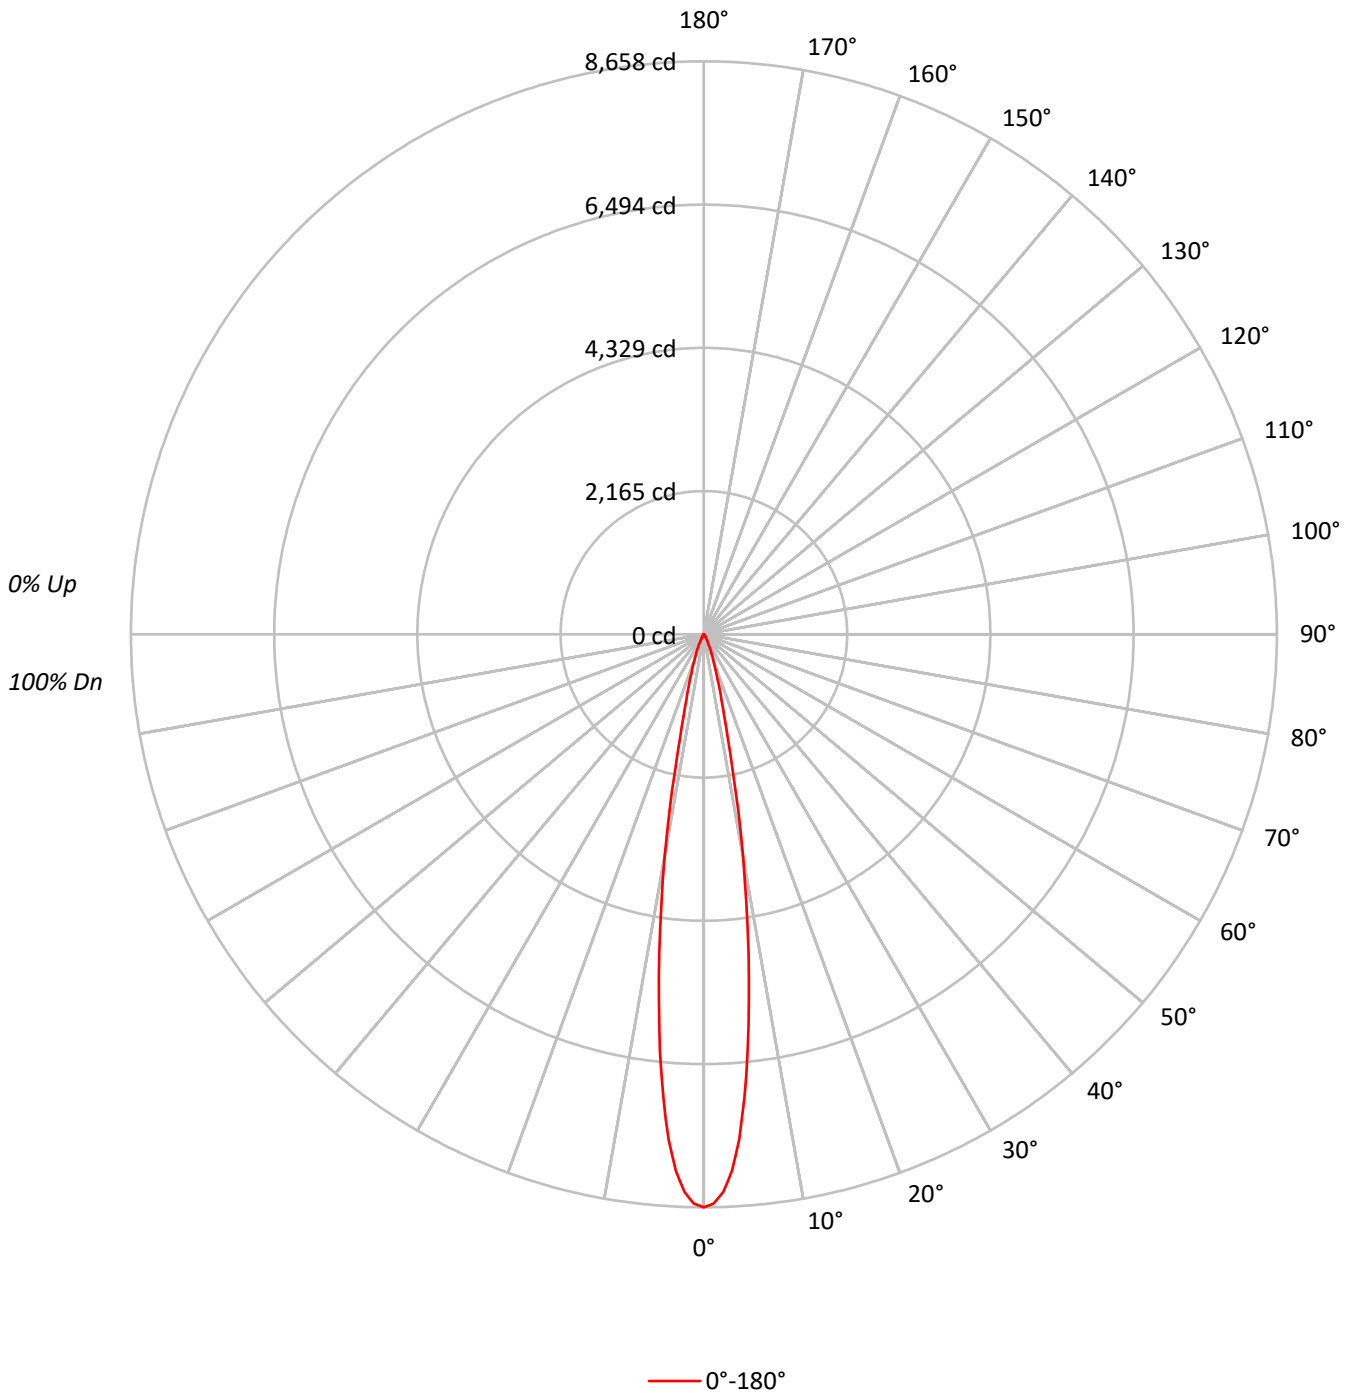



TEST NUMBER: P1295514

CATALOG NUMBER: P3AS13R15W2N902765DE010 E3D1LI_6500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	116	114	112	111	113	112	110	109	108	107	105	104	103	102	101	100	99	99	98	98	98
2	112	109	107	105	110	108	105	103	105	103	101	102	100	99	99	98	97	99	98	97	96
3	110	106	102	100	108	104	102	99	102	100	98	100	98	96	98	96	95	98	96	95	94
4	107	102	99	96	105	101	98	96	99	97	95	98	96	94	96	94	93	96	94	93	92
5	105	100	96	94	103	99	96	93	97	94	92	96	93	92	94	93	91	94	93	91	90
6	102	97	94	91	101	96	93	91	95	92	90	94	92	90	93	91	89	93	91	89	88
7	100	95	91	89	99	94	91	89	93	90	88	92	90	88	91	89	88	91	89	88	87
8	98	93	89	87	97	92	89	87	91	89	87	91	88	86	90	88	86	90	88	86	85
9	96	91	88	85	96	91	87	85	90	87	85	89	87	85	88	86	85	88	86	85	84
10	95	89	86	84	94	89	86	84	88	85	83	88	85	83	87	85	83	87	85	83	82

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1898554
5°	1548136
10°	758191
15°	232056
20°	98265
25°	44446
30°	17319
35°	8004
40°	2490
45°	930
50°	375
55°	153
60°	175
65°	208
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 930 cd/sqm



TEST NUMBER: P1295514

CATALOG NUMBER: P3AS13R15W2N902765DE010 E3D1LI_6500K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	547.5	54.9
10°-20°	335.9	33.7
20°-30°	90.2	9.0
30°-40°	19.9	2.0
40°-50°	2.8	0.3
50°-60°	0.5	0.1
60°-70°	0.2	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	973.6	97.7
0°-40°	993.5	99.6
0°-60°	996.8	100.0
0°-90°	997.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	997.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	8658	
5°	7033	547
15°	1022	336
25°	184	90
35°	30	20
45°	3	3
55°	0	1
65°	0	0
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P1295514

CATALOG NUMBER: P3AS13R15W2N902765DE010 E3D1LI_6500K

CANDELA DISTRIBUTION (FULL):

0°	
0°	8658.1
1°	8604.0
2°	8430.5
3°	8117.8
4°	7647.2
5°	7033.2
6°	6338.7
7°	5565.2
8°	4854.5
9°	4101.1
10°	3405.1
11°	2716.3
12°	2089.9
13°	1607.5
14°	1272.5
15°	1022.2
17.5°	633.6
20°	421.1
22.5°	283.5
25°	183.7
27.5°	108.9
30°	68.4
32.5°	46.1
35°	29.9
37.5°	16.6
40°	8.7
42.5°	4.9
45°	3.0
47.5°	1.9
50°	1.1
52.5°	0.8
55°	0.4
57.5°	0.4
60°	0.4
62.5°	0.4
65°	0.4
67.5°	0.0
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0



TEST NUMBER: P1295514
CATALOG NUMBER: P3AS13R15W2N902765DE010 E3D1LI_6500K

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0

(END OF REPORT)