

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1295787

Luminaire Tested: P3AS13R20W2N902750DE010 E3PHLP1MW\_4000K

Issue Date: 1/29/2026

**Test Information**


Test Method: LM-79-2019  
Report Number: P1295787  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2509-551-6)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/29/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3AS13R20W2N902750DE010 E3PHLP1MW\_4000K  
Description: 3in Adjustable Tunable White LED luminaire with, R20 optic, 4000K CCT AND, 90CRI ,  
E3PHLP1MW TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 380.0 lumens  
Efficiency: N/A  
Efficacy: 30.9 lumens/watt  
Spacing Criteria (0/90/45): 0.55 / 0.55 / 0.63  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 12.3  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1295787  
CATALOG NUMBER: P3AS13R20W2N902750DE010 E3PHLP1MW\_4000K

### Luminous Intensity Polar Plot

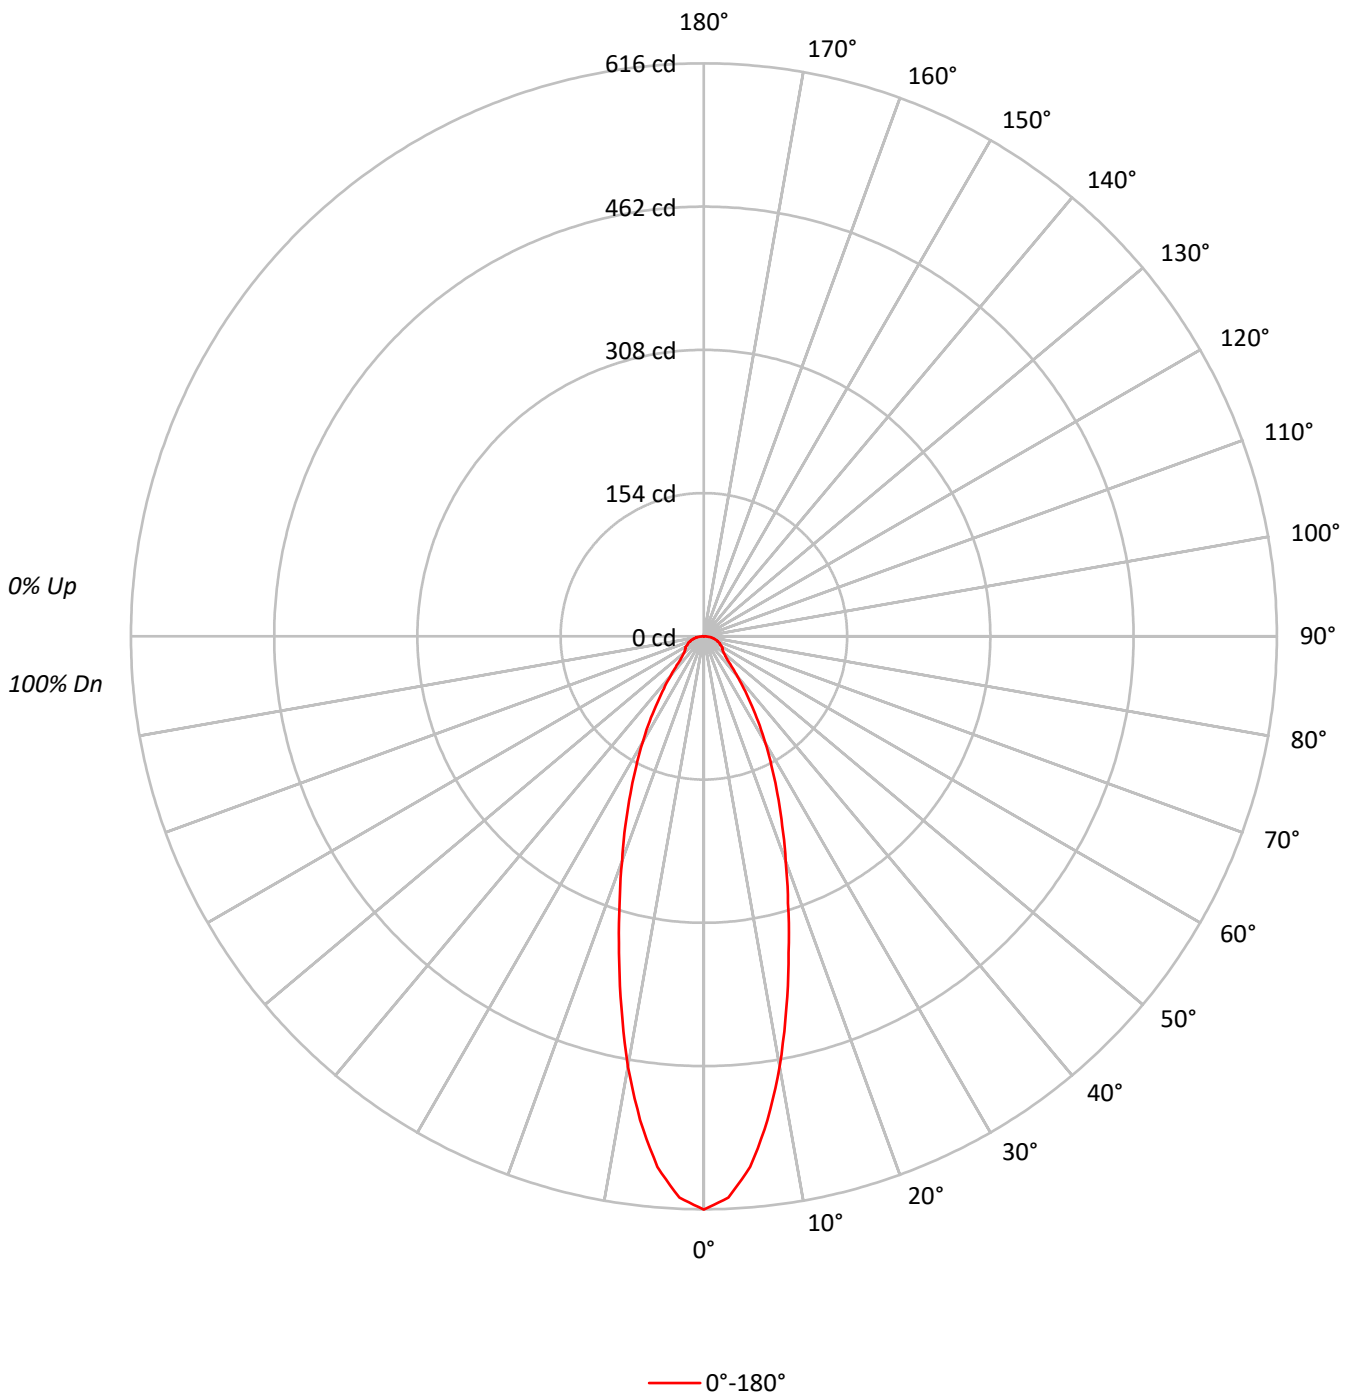



TEST NUMBER: P1295787

CATALOG NUMBER: P3AS13R20W2N902750DE010 E3PHLP1MW\_4000K

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     |     |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |     | 30  |     |     |     | 10  |     |     | 0   |     |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 0   |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | 100 | 100 | 100 |
| 1   | 112 | 108 | 105 | 102 | 109 | 106 | 103 | 101 | 102 | 100 | 97  | 98  | 96  | 95  | 95  | 93  | 92  | 90  | 90  | 90  | 90  |
| 2   | 105 | 99  | 94  | 90  | 103 | 97  | 93  | 89  | 94  | 90  | 87  | 91  | 88  | 85  | 88  | 85  | 83  | 81  | 81  | 81  | 81  |
| 3   | 99  | 91  | 85  | 80  | 97  | 90  | 84  | 80  | 87  | 82  | 78  | 84  | 80  | 77  | 82  | 79  | 76  | 74  | 74  | 74  | 74  |
| 4   | 93  | 84  | 78  | 73  | 91  | 83  | 77  | 73  | 81  | 76  | 72  | 79  | 74  | 71  | 77  | 73  | 70  | 68  | 68  | 68  | 68  |
| 5   | 88  | 79  | 72  | 67  | 86  | 78  | 71  | 67  | 76  | 70  | 66  | 74  | 69  | 66  | 72  | 68  | 65  | 63  | 63  | 63  | 63  |
| 6   | 84  | 74  | 67  | 62  | 82  | 73  | 66  | 62  | 71  | 66  | 61  | 70  | 65  | 61  | 68  | 64  | 61  | 59  | 59  | 59  | 59  |
| 7   | 79  | 69  | 63  | 58  | 78  | 68  | 62  | 58  | 67  | 62  | 57  | 66  | 61  | 57  | 65  | 60  | 57  | 55  | 55  | 55  | 55  |
| 8   | 76  | 65  | 59  | 54  | 74  | 65  | 58  | 54  | 64  | 58  | 54  | 62  | 57  | 54  | 61  | 57  | 53  | 52  | 52  | 52  | 52  |
| 9   | 72  | 62  | 55  | 51  | 71  | 61  | 55  | 51  | 60  | 55  | 51  | 59  | 54  | 51  | 58  | 54  | 50  | 49  | 49  | 49  | 49  |
| 10  | 69  | 59  | 52  | 48  | 68  | 58  | 52  | 48  | 57  | 52  | 48  | 57  | 52  | 48  | 56  | 51  | 48  | 46  | 46  | 46  | 46  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |        |
|-----|--------|
|     | 0°     |
| 0°  | 135143 |
| 5°  | 126040 |
| 10° | 104585 |
| 15° | 79978  |
| 20° | 60019  |
| 25° | 45196  |
| 30° | 33423  |
| 35° | 23343  |
| 40° | 16001  |
| 45° | 11102  |
| 50° | 9552   |
| 55° | 9405   |
| 60° | 9824   |
| 65° | 9858   |
| 70° | 10066  |
| 75° | 10421  |
| 80° | 11239  |
| 85° | 11322  |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 82.5°  
 Luminance: 13104 cd/sqm



TEST NUMBER: P1295787

CATALOG NUMBER: P3AS13R20W2N902750DE010 E3PHLP1MW\_4000K

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 51.3   | 13.5      |
| 10°-20°   | 98.0   | 25.8      |
| 20°-30°   | 86.2   | 22.7      |
| 30°-40°   | 55.6   | 14.6      |
| 40°-50°   | 29.5   | 7.8       |
| 50°-60°   | 22.2   | 5.8       |
| 60°-70°   | 18.8   | 5.0       |
| 70°-80°   | 13.3   | 3.5       |
| 80°-90°   | 5.2    | 1.4       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| 0°-30°    | 235.4  | 62.0      |
| 0°-40°    | 291.1  | 76.6      |
| 0°-60°    | 342.7  | 90.2      |
| 0°-90°    | 380.0  | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 380.0  | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°  | Flux |
|-----|-----|------|
| 0°  | 616 |      |
| 5°  | 573 | 51   |
| 15° | 352 | 98   |
| 25° | 187 | 86   |
| 35° | 87  | 56   |
| 45° | 36  | 29   |
| 55° | 25  | 22   |
| 65° | 19  | 19   |
| 75° | 12  | 13   |
| 85° | 4   | 5    |
| 90° | 0   |      |



TEST NUMBER: P1295787  
CATALOG NUMBER: P3AS13R20W2N902750DE010 E3PHLP1MW\_4000K

**CANDELA DISTRIBUTION (FULL):**

|       | 0°    |
|-------|-------|
| 0°    | 616.3 |
| 2.5°  | 603.9 |
| 5°    | 572.6 |
| 7.5°  | 524.5 |
| 10°   | 469.7 |
| 12.5° | 409.3 |
| 15°   | 352.3 |
| 17.5° | 300.9 |
| 20°   | 257.2 |
| 22.5° | 220.3 |
| 25°   | 186.8 |
| 27.5° | 157.7 |
| 30°   | 132.0 |
| 32.5° | 108.5 |
| 35°   | 87.2  |
| 37.5° | 70.5  |
| 40°   | 55.9  |
| 42.5° | 44.7  |
| 45°   | 35.8  |
| 47.5° | 31.3  |
| 50°   | 28.0  |
| 52.5° | 25.7  |
| 55°   | 24.6  |
| 57.5° | 23.5  |
| 60°   | 22.4  |
| 62.5° | 20.1  |
| 65°   | 19.0  |
| 67.5° | 17.9  |
| 70°   | 15.7  |
| 72.5° | 14.5  |
| 75°   | 12.3  |
| 77.5° | 11.2  |
| 80°   | 8.9   |
| 82.5° | 7.8   |
| 85°   | 4.5   |
| 87.5° | 2.2   |
| 90°   | 0.0   |

(END OF REPORT)