

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1296605

Luminaire Tested: P3AS13R30W2N902765DE010 E3DLP1H_5000K

Issue Date: 1/30/2026

Test Information

Test Method: LM-79-2019
Report Number: P1296605
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-13)
Test Lab: INNOVATION CENTER
Issue Date: 1/30/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: IRiS
Catalog Number: P3AS13R30W2N902765DE010 E3DLP1H_5000K
Description: 3in Adjustable Tunable White LED luminaire with, R30 optic, 5000K CCT AND, 90CRI ,
E3DLP1H TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 497.0 lumens
Efficiency: N/A
Efficacy: 40.4 lumens/watt
Spacing Criteria (0/90/45): 0.66 / 0.66 / 0.7
Luminous Opening: Circular (Dia: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 12.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1296605
CATALOG NUMBER: P3AS13R30W2N902765DE010 E3DLP1H_5000K

Luminous Intensity Polar Plot

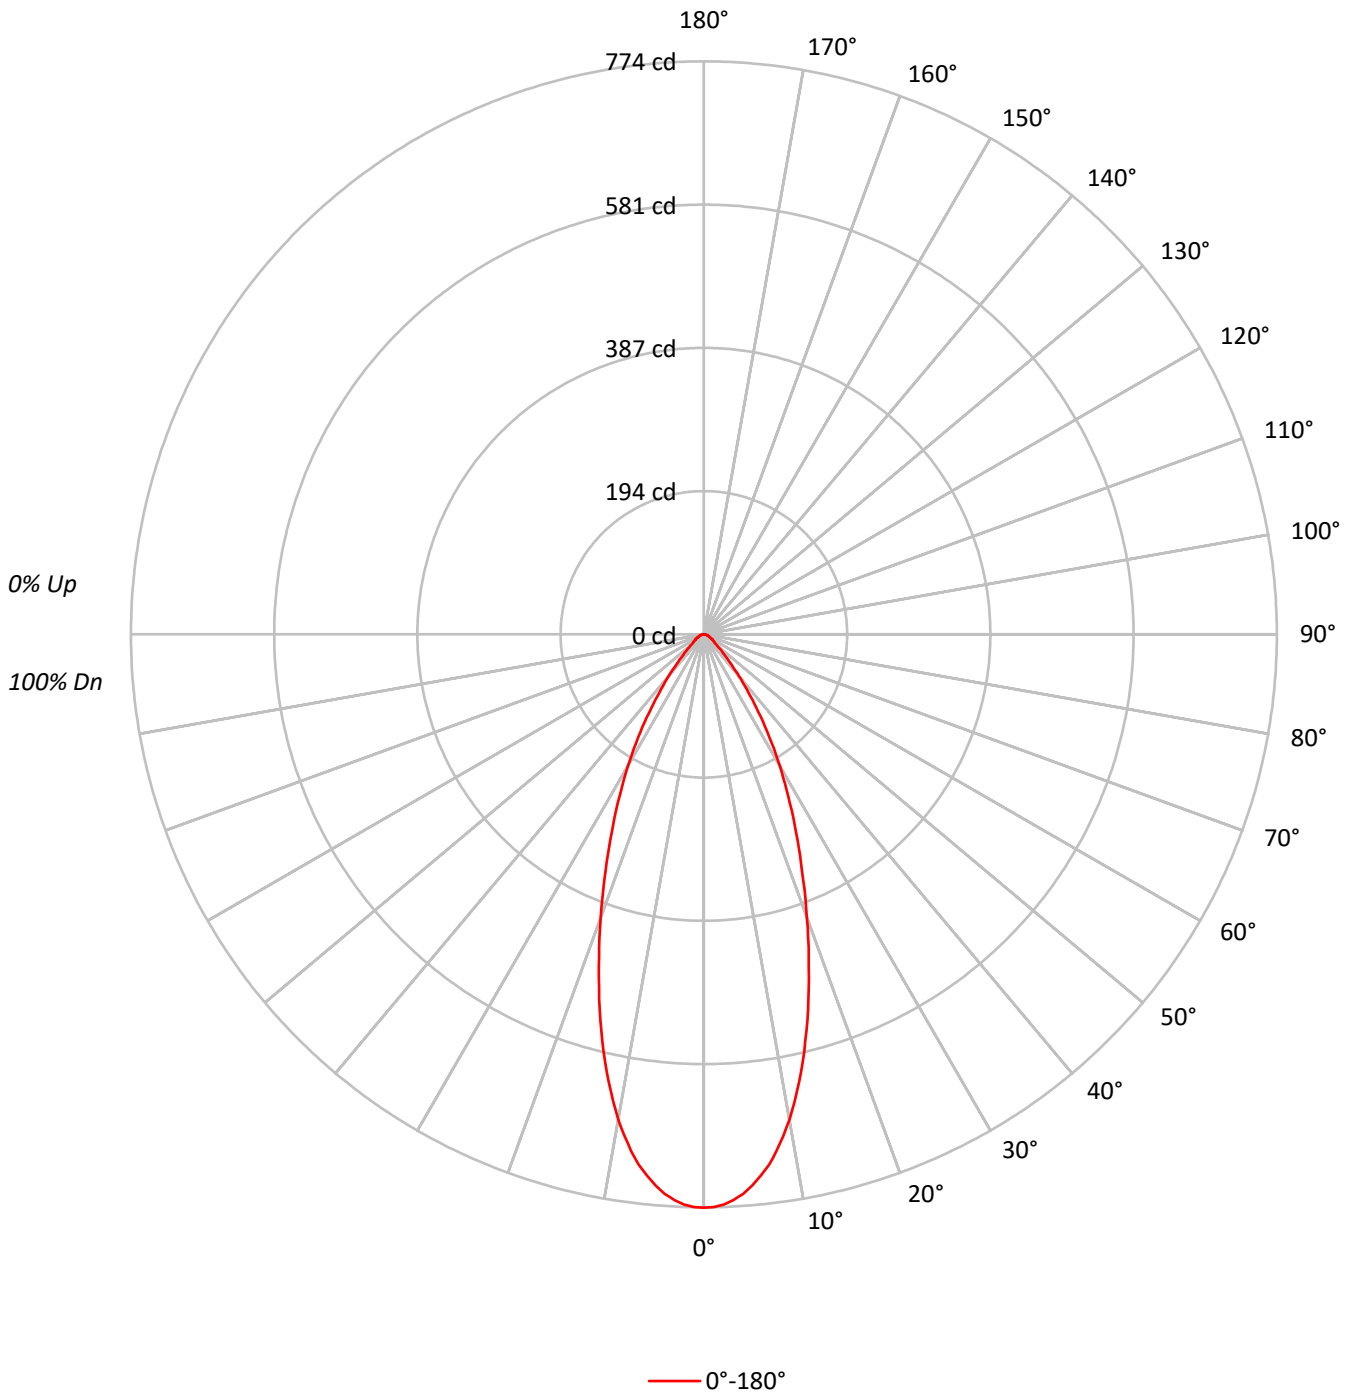



TEST NUMBER: P1296605
 CATALOG NUMBER: P3AS13R30W2N902765DE010 E3DLP1H_5000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93	93	93	93
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86	86	86	86
3	102	95	90	86	100	94	89	85	91	87	84	89	86	83	87	84	82	80	80	80	80
4	97	89	84	79	95	88	83	79	86	81	78	84	80	77	82	79	76	74	74	74	74
5	92	84	78	73	90	83	77	73	81	76	72	79	75	72	78	74	71	70	70	70	70
6	88	79	73	68	86	78	72	68	76	71	68	75	71	67	74	70	67	65	65	65	65
7	83	74	68	64	82	74	68	64	72	67	63	71	67	63	70	66	63	61	61	61	61
8	80	70	64	60	78	70	64	60	69	63	60	67	63	60	67	62	59	58	58	58	58
9	76	67	61	57	75	66	60	57	65	60	56	64	60	56	63	59	56	55	55	55	55
10	73	63	58	54	72	63	57	54	62	57	54	61	57	53	61	56	53	52	52	52	52

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	169833
5°	164538
10°	148249
15°	122634
20°	94952
25°	71230
30°	51704
35°	34452
40°	21183
45°	12435
50°	7607
55°	6193
60°	5394
65°	4410
70°	3975
75°	3897
80°	2904
85°	3774

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 12435 cd/sqm



TEST NUMBER: P1296605

CATALOG NUMBER: P3AS13R30W2N902765DE010 E3DLP1H_5000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	68.8	13.8
10°-20°	148.8	29.9
20°-30°	135.4	27.2
30°-40°	81.8	16.5
40°-50°	32.8	6.6
50°-60°	14.5	2.9
60°-70°	8.8	1.8
70°-80°	4.8	1.0
80°-90°	1.3	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	352.9	71.0
0°-40°	434.7	87.5
0°-60°	482.1	97.0
0°-90°	497.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	497.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	774	
5°	748	69
15°	540	149
25°	294	135
35°	129	82
45°	40	33
55°	16	15
65°	8	9
75°	5	5
85°	2	1
90°	0	



TEST NUMBER: P1296605
CATALOG NUMBER: P3AS13R30W2N902765DE010 E3DLP1H_5000K

CANDELA DISTRIBUTION (FULL):

0°	
0°	774.5
1°	773.7
2°	770.7
3°	765.3
4°	757.6
5°	747.5
6°	735.2
7°	722.1
8°	705.1
9°	685.9
10°	665.8
11°	642.7
12°	618.1
13°	593.4
14°	566.4
15°	540.2
17.5°	471.6
20°	406.9
22.5°	346.8
25°	294.4
27.5°	246.6
30°	204.2
32.5°	164.9
35°	128.7
37.5°	98.6
40°	74.0
42.5°	53.9
45°	40.1
47.5°	30.1
50°	22.3
52.5°	17.7
55°	16.2
57.5°	13.9
60°	12.3
62.5°	10.0
65°	8.5
67.5°	7.7
70°	6.2
72.5°	5.4
75°	4.6
77.5°	3.9
80°	2.3
82.5°	1.5
85°	1.5
87.5°	0.8



TEST NUMBER: P1296605
CATALOG NUMBER: P3AS13R30W2N902765DE010 E3DLP1H_5000K

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0

(END OF REPORT)