

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1299478

Luminaire Tested: P3AS17R20W2N902750DE010 E3CD1MMS\_5000K

Issue Date: 1/30/2026

**Test Information**


Test Method: LM-79-2019  
Report Number: P1299478  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-8)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3AS17R20W2N902750DE010 E3CD1MMS\_5000K  
Description: 3in Adjustable Tunable White LED luminaire with, R20 optic, 5000K CCT AND, 90CRI ,  
E3CD1MMS TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1522.0 lumens  
Efficiency: N/A  
Efficacy: 78.5 lumens/watt  
Spacing Criteria (0/90/45): 0.35 / 0.35 / 0.34  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 19.4  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1299478  
CATALOG NUMBER: P3AS17R20W2N902750DE010 E3CD1MMS\_5000K

### Luminous Intensity Polar Plot

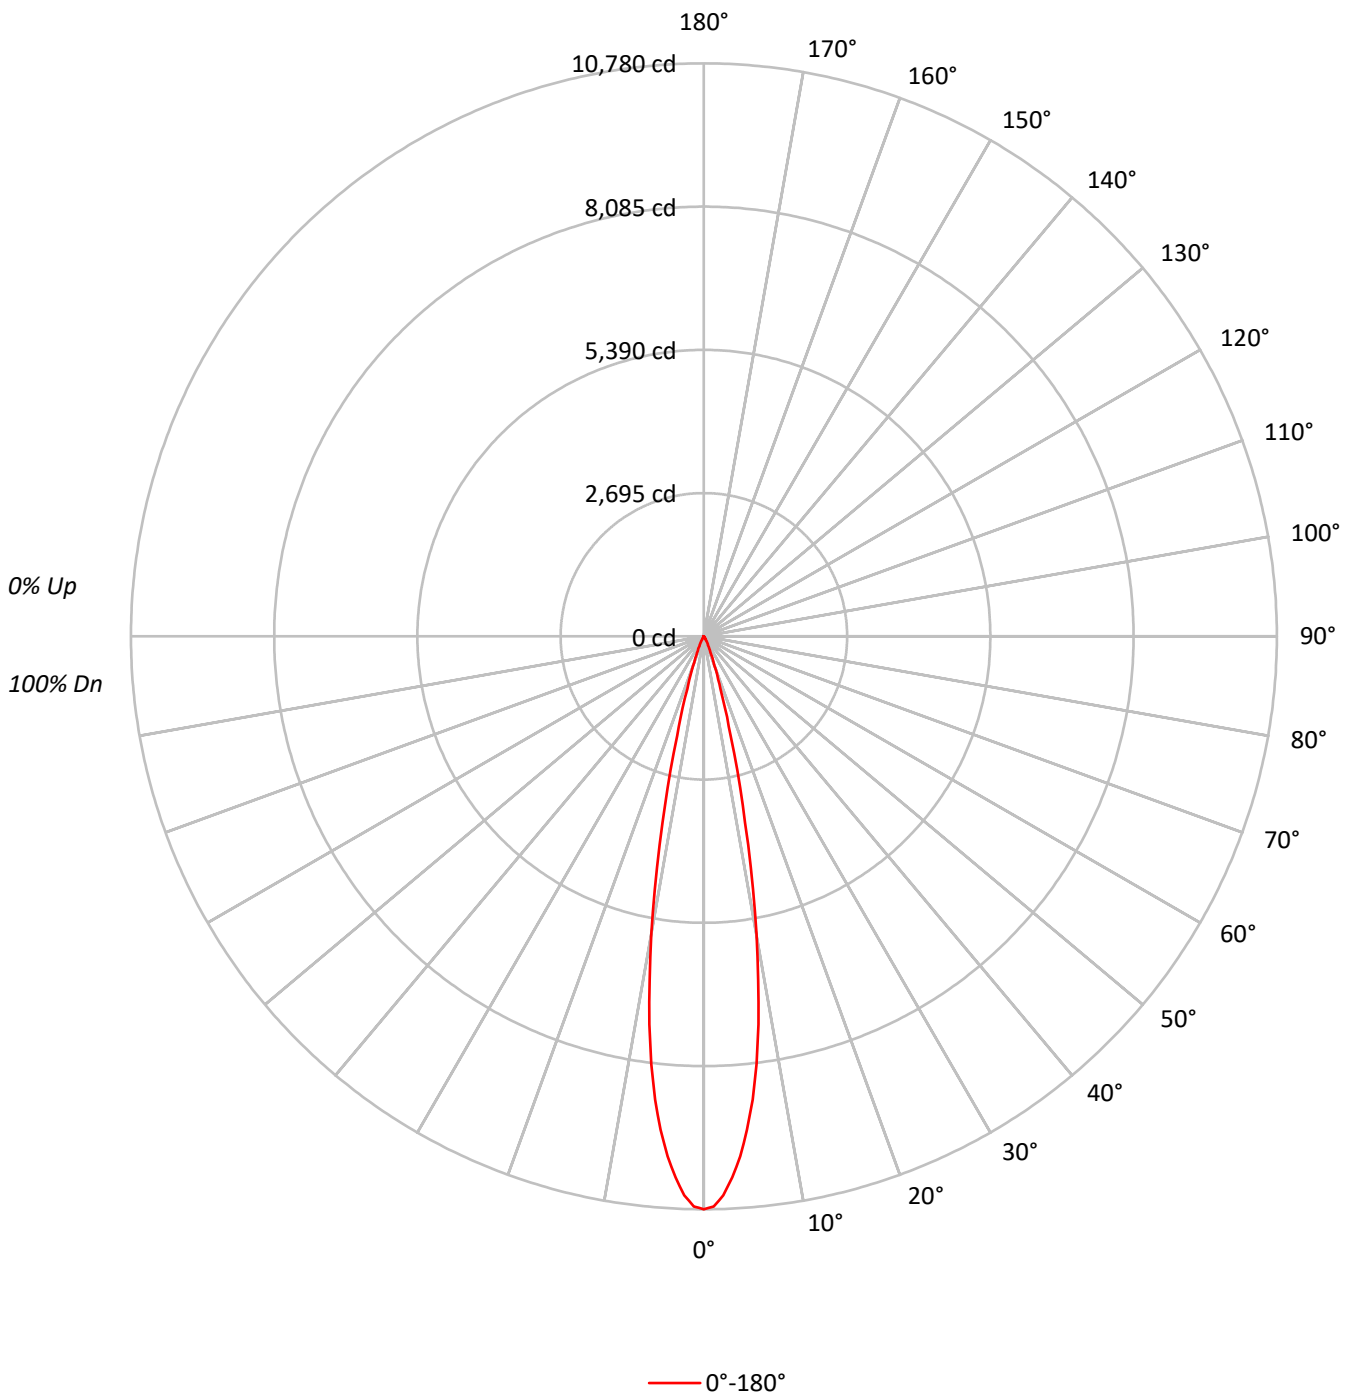



TEST NUMBER: P1299478  
 CATALOG NUMBER: P3AS17R20W2N902750DE010 E3CD1MMS\_5000K

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	99	98
1	116	114	112	110	113	112	110	109	108	106	105	104	103	102	101	100	99	98	97	96	95
2	112	109	107	104	110	108	105	103	104	103	101	102	100	99	99	98	97	96	95	94	93
3	109	105	102	100	108	104	101	99	102	99	97	99	98	96	97	96	95	94	93	92	91
4	107	102	99	96	105	101	98	96	99	97	95	97	95	93	96	94	92	91	90	89	88
5	104	99	96	93	103	98	95	93	97	94	92	95	93	91	94	92	91	90	89	88	86
6	102	97	93	91	101	96	93	90	95	92	90	94	91	89	93	90	89	88	87	86	85
7	100	94	91	88	99	94	91	88	93	90	88	92	89	87	91	89	87	86	85	84	83
8	98	92	89	86	97	92	89	86	91	88	86	90	88	86	89	87	85	84	83	82	81
9	96	90	87	85	95	90	87	85	89	86	84	89	86	84	88	86	84	83	82	81	80
10	94	89	85	83	93	88	85	83	88	85	83	87	84	83	87	84	82	81	80	79	78

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	2363846
5°	2051723
10°	1267757
15°	440320
20°	135228
25°	47809
30°	17699
35°	7094
40°	3807
45°	1489
50°	819
55°	918
60°	1053
65°	623
70°	769
75°	1017
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 1489 cd/sqm



TEST NUMBER: P1299478

CATALOG NUMBER: P3AS17R20W2N902750DE010 E3CD1MMS\_5000K

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	773.6	50.8
10°-20°	613.8	40.3
20°-30°	106.3	7.0
30°-40°	19.3	1.3
40°-50°	4.4	0.3
50°-60°	2.2	0.1
60°-70°	1.3	0.1
70°-80°	1.1	0.1
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1493.6	98.1
0°-40°	1513.0	99.4
0°-60°	1519.6	99.8
0°-90°	1522.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1522.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	10780	
5°	9321	774
15°	1940	614
25°	198	106
35°	26	19
45°	5	4
55°	2	2
65°	1	1
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P1299478  
CATALOG NUMBER: P3AS17R20W2N902750DE010 E3CD1MMS\_5000K

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	10780.0
1°	10728.2
2°	10523.4
3°	10194.5
4°	9809.0
5°	9321.0
6°	8762.0
7°	8111.5
8°	7370.6
9°	6538.1
10°	5693.6
12.5°	3591.3
15°	1939.6
17.5°	1036.1
20°	579.5
22.5°	331.3
25°	197.6
27.5°	120.5
30°	69.9
32.5°	41.0
35°	26.5
37.5°	18.1
40°	13.3
42.5°	8.4
45°	4.8
47.5°	2.4
50°	2.4
52.5°	2.4
55°	2.4
57.5°	2.4
60°	2.4
62.5°	1.2
65°	1.2
67.5°	1.2
70°	1.2
72.5°	1.2
75°	1.2
77.5°	1.2
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)