

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1299916

Luminaire Tested: P3AS17R25W2N902765DE010 E3CB1MW_5000K

Issue Date: 1/30/2026

Test Information

Test Method: LM-79-2019
Report Number: P1299916
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-12)
Test Lab: INNOVATION CENTER
Issue Date: 1/30/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: IRiS
Catalog Number: P3AS17R25W2N902765DE010 E3CB1MW_5000K
Description: 3in Adjustable Tunable White LED luminaire with, R25 optic, 5000K CCT AND, 90CRI ,
E3CB1MW TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1534.0 lumens
Efficiency: N/A
Efficacy: 79.1 lumens/watt
Spacing Criteria (0/90/45): 0.45 / 0.45 / 0.41
Luminous Opening: Circular (Dia: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 19.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1299916
CATALOG NUMBER: P3AS17R25W2N902765DE010 E3CB1MW_5000K

Luminous Intensity Polar Plot

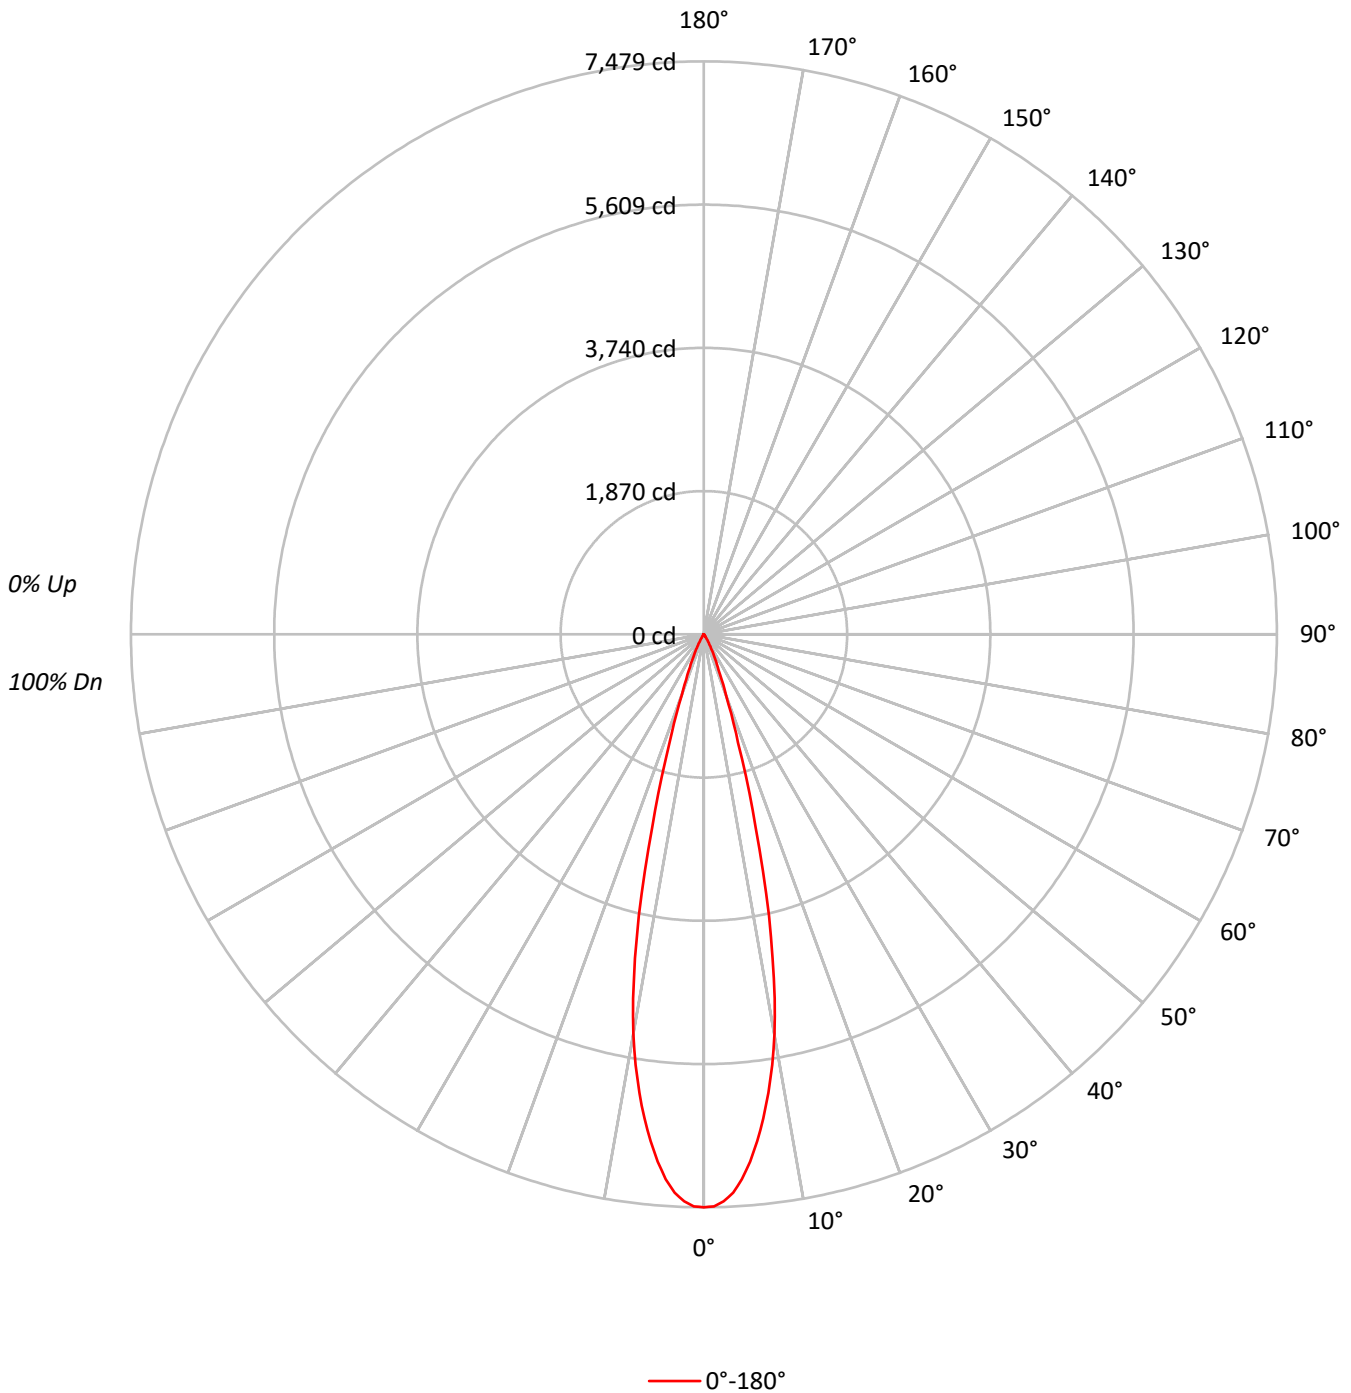



TEST NUMBER: P1299916

CATALOG NUMBER: P3AS17R25W2N902765DE010 E3CB1MW_5000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	115	113	111	110	113	111	109	108	107	106	105	103	103	102	100	99	99	97	97	97	97
2	112	108	105	103	110	107	104	102	104	102	100	101	99	98	98	97	96	94	94	94	94
3	108	104	101	98	107	103	100	97	100	98	96	98	96	94	96	94	93	92	92	92	92
4	105	100	97	94	104	99	96	93	97	95	92	96	93	91	94	92	90	89	89	89	89
5	103	97	93	90	101	96	93	90	95	92	89	93	91	89	92	90	88	87	87	87	87
6	100	94	90	87	99	93	90	87	92	89	87	91	88	86	90	87	86	85	85	85	85
7	97	91	88	85	96	91	87	85	90	87	84	89	86	84	88	85	83	83	83	83	83
8	95	89	85	83	94	89	85	82	88	84	82	87	84	82	86	83	81	81	81	81	81
9	93	87	83	80	92	86	83	80	86	82	80	85	82	80	84	82	80	79	79	79	79
10	91	85	81	78	90	84	81	78	84	80	78	83	80	78	82	80	78	77	77	77	77

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1640066
5°	1521127
10°	1179649
15°	591513
20°	194337
25°	77279
30°	28992
35°	8379
40°	3807
45°	1489
50°	1228
55°	918
60°	1053
65°	1245
70°	769
75°	1017
80°	1515
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 80°
 Luminance: 1515 cd/sqm



TEST NUMBER: P1299916

CATALOG NUMBER: P3AS17R25W2N902765DE010 E3CB1MW_5000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	607.8	39.6
10°-20°	725.2	47.3
20°-30°	163.5	10.7
30°-40°	26.5	1.7
40°-50°	4.8	0.3
50°-60°	2.5	0.2
60°-70°	2.2	0.1
70°-80°	1.3	0.1
80°-90°	0.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1496.5	97.6
0°-40°	1523.0	99.3
0°-60°	1530.3	99.8
0°-90°	1534.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1534.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7479	
5°	6910	608
15°	2606	725
25°	319	163
35°	31	27
45°	5	5
55°	2	3
65°	2	2
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P1299916
CATALOG NUMBER: P3AS17R25W2N902765DE010 E3CB1MW_5000K

CANDELA DISTRIBUTION (FULL):

0°	
0°	7479.3
1°	7467.3
2°	7407.0
3°	7296.1
4°	7128.6
5°	6910.5
6°	6650.2
7°	6368.1
8°	6045.2
9°	5692.0
10°	5297.9
11°	4843.6
12°	4320.5
13°	3773.4
14°	3186.5
15°	2605.6
17.5°	1484.8
20°	832.8
22.5°	502.6
25°	319.4
27.5°	196.4
30°	114.5
32.5°	60.3
35°	31.3
37.5°	20.5
40°	13.3
42.5°	8.4
45°	4.8
47.5°	3.6
50°	3.6
52.5°	3.6
55°	2.4
57.5°	2.4
60°	2.4
62.5°	2.4
65°	2.4
67.5°	2.4
70°	1.2
72.5°	1.2
75°	1.2
77.5°	1.2
80°	1.2
82.5°	0.0
85°	0.0
87.5°	0.0



TEST NUMBER: P1299916
CATALOG NUMBER: P3AS17R25W2N902765DE010 E3CB1MW_5000K

CANDELA DISTRIBUTION (continued):



(END OF REPORT)