

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1300375

Luminaire Tested: P3AS17R30W2N902765DE010 E3DLD1MW_4000K

Issue Date: 1/30/2026

Test Information

Test Method: LM-79-2019
Report Number: P1300375
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-14)
Test Lab: INNOVATION CENTER
Issue Date: 1/30/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: IRiS
Catalog Number: P3AS17R30W2N902765DE010 E3DLD1MW_4000K
Description: 3in Adjustable Tunable White LED luminaire with, R30 optic, 4000K CCT AND, 90CRI ,
E3DLD1MW TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 987.0 lumens
Efficiency: N/A
Efficacy: 50.9 lumens/watt
Spacing Criteria (0/90/45): 0.78 / 0.78 / 0.85
Luminous Opening: Circular (Dia: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 19.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1300375
CATALOG NUMBER: P3AS17R30W2N902765DE010 E3DLD1MW_4000K

Luminous Intensity Polar Plot

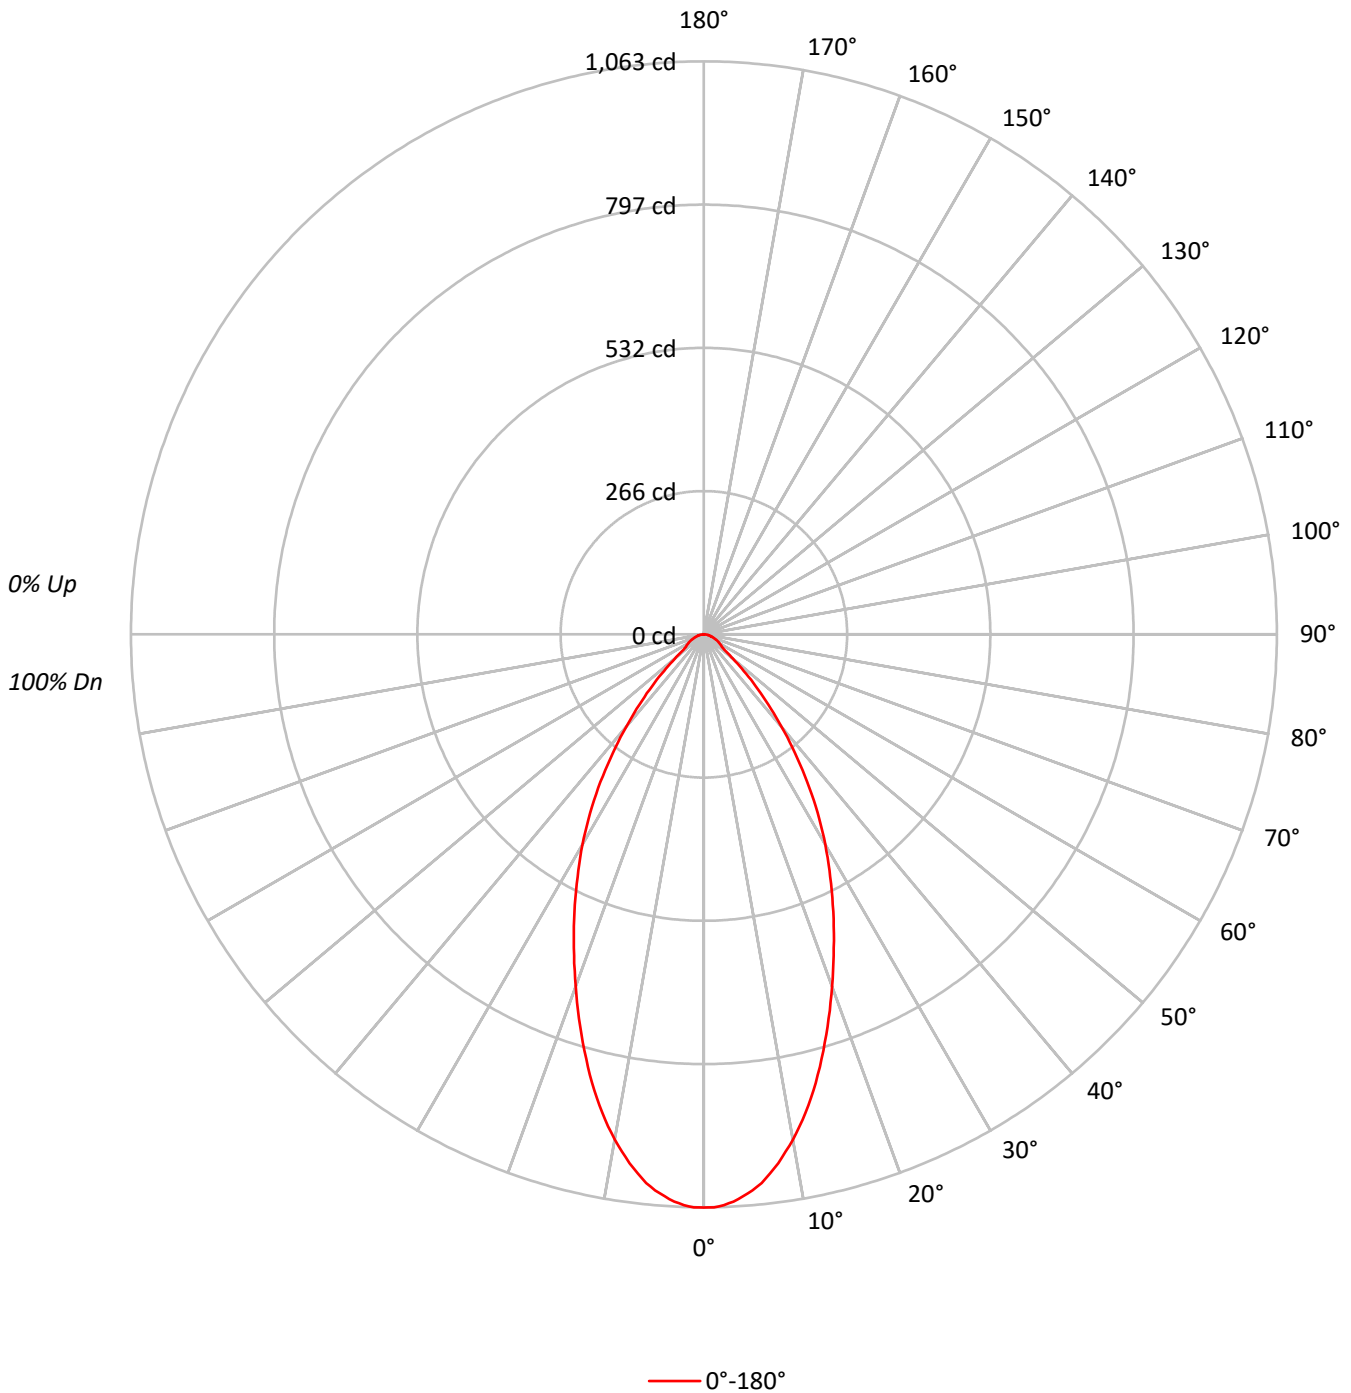



TEST NUMBER: P1300375
 CATALOG NUMBER: P3AS17R30W2N902765DE010 E3DLD1MW_4000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	112	109	106	104	110	107	105	102	103	101	99	99	98	96	96	94	93	91			91
2	106	100	96	92	104	99	94	91	95	92	89	92	89	87	89	87	85	83			83
3	100	92	87	82	98	91	86	82	88	84	80	86	82	79	84	80	78	76			76
4	94	85	79	74	92	84	79	74	82	77	73	80	76	72	78	74	71	70			70
5	89	79	73	68	87	78	72	68	76	71	67	75	70	66	73	69	66	64			64
6	84	74	67	62	82	73	67	62	71	66	62	70	65	61	69	64	61	59			59
7	79	69	62	58	78	68	62	58	67	61	57	66	61	57	65	60	57	55			55
8	75	65	58	54	74	64	58	53	63	57	53	62	57	53	61	56	53	51			51
9	71	61	54	50	70	60	54	50	59	54	50	58	53	50	57	53	49	48			48
10	68	57	51	47	67	57	51	47	56	50	47	55	50	46	54	50	46	45			45

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	233183
5°	227932
10°	211976
15°	188605
20°	162227
25°	137427
30°	114068
35°	89490
40°	64149
45°	42051
50°	23948
55°	15751
60°	14867
65°	13802
70°	12438
75°	11268
80°	10734
85°	9057

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 42051 cd/sqm



TEST NUMBER: P1300375

CATALOG NUMBER: P3AS17R30W2N902765DE010 E3DLD1MW_4000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	96.1	9.7
10°-20°	231.0	23.4
20°-30°	260.3	26.4
30°-40°	207.9	21.1
40°-50°	106.8	10.8
50°-60°	40.2	4.1
60°-70°	26.3	2.7
70°-80°	14.2	1.4
80°-90°	4.1	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	587.4	59.5
0°-40°	795.3	80.6
0°-60°	942.3	95.5
0°-90°	987.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	987.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1063	
5°	1036	96
15°	831	231
25°	568	260
35°	334	208
45°	136	107
55°	41	40
65°	27	26
75°	13	14
85°	4	4
90°	0	



TEST NUMBER: P1300375
CATALOG NUMBER: P3AS17R30W2N902765DE010 E3DLD1MW_4000K

CANDELA DISTRIBUTION (FULL):

0°	
0°	1063.4
1°	1063.4
2°	1059.8
3°	1053.7
4°	1045.2
5°	1035.5
6°	1023.4
7°	1007.7
8°	990.7
9°	971.3
10°	952.0
11°	930.2
12°	907.1
13°	882.9
14°	857.5
15°	830.8
17.5°	763.0
20°	695.2
22.5°	629.8
25°	568.0
27.5°	507.5
30°	450.5
32.5°	392.4
35°	334.3
37.5°	277.4
40°	224.1
42.5°	176.8
45°	135.6
47.5°	100.5
50°	70.2
52.5°	49.7
55°	41.2
57.5°	37.5
60°	33.9
62.5°	30.3
65°	26.6
67.5°	23.0
70°	19.4
72.5°	15.7
75°	13.3
77.5°	10.9
80°	8.5
82.5°	6.1
85°	3.6
87.5°	1.2



TEST NUMBER: P1300375
CATALOG NUMBER: P3AS17R30W2N902765DE010 E3DLD1MW_4000K

CANDELA DISTRIBUTION (continued):

0°
90° | 0.0

(END OF REPORT)