

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1301573

Luminaire Tested: P3AS17R50W2N902765DE010 E3DL1LI_5000K

Issue Date: 1/30/2026

Test Information

Test Method: LM-79-2019
Report Number: P1301573
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-31)
Test Lab: INNOVATION CENTER
Issue Date: 1/30/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: IRiS
Catalog Number: P3AS17R50W2N902765DE010 E3DL1LI_5000K
Description: 3in Adjustable Tunable White LED luminaire with, R50 optic, 5000K CCT AND, 90CRI ,
E3DL1LI TRIM
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1356.0 lumens
Efficiency: N/A
Efficacy: 69.9 lumens/watt
Spacing Criteria (0/90/45): 0.77 / 0.77 / 0.75
Luminous Opening: Circular (Dia: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 19.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1301573
CATALOG NUMBER: P3AS17R50W2N902765DE010 E3DL1LI_5000K

Luminous Intensity Polar Plot

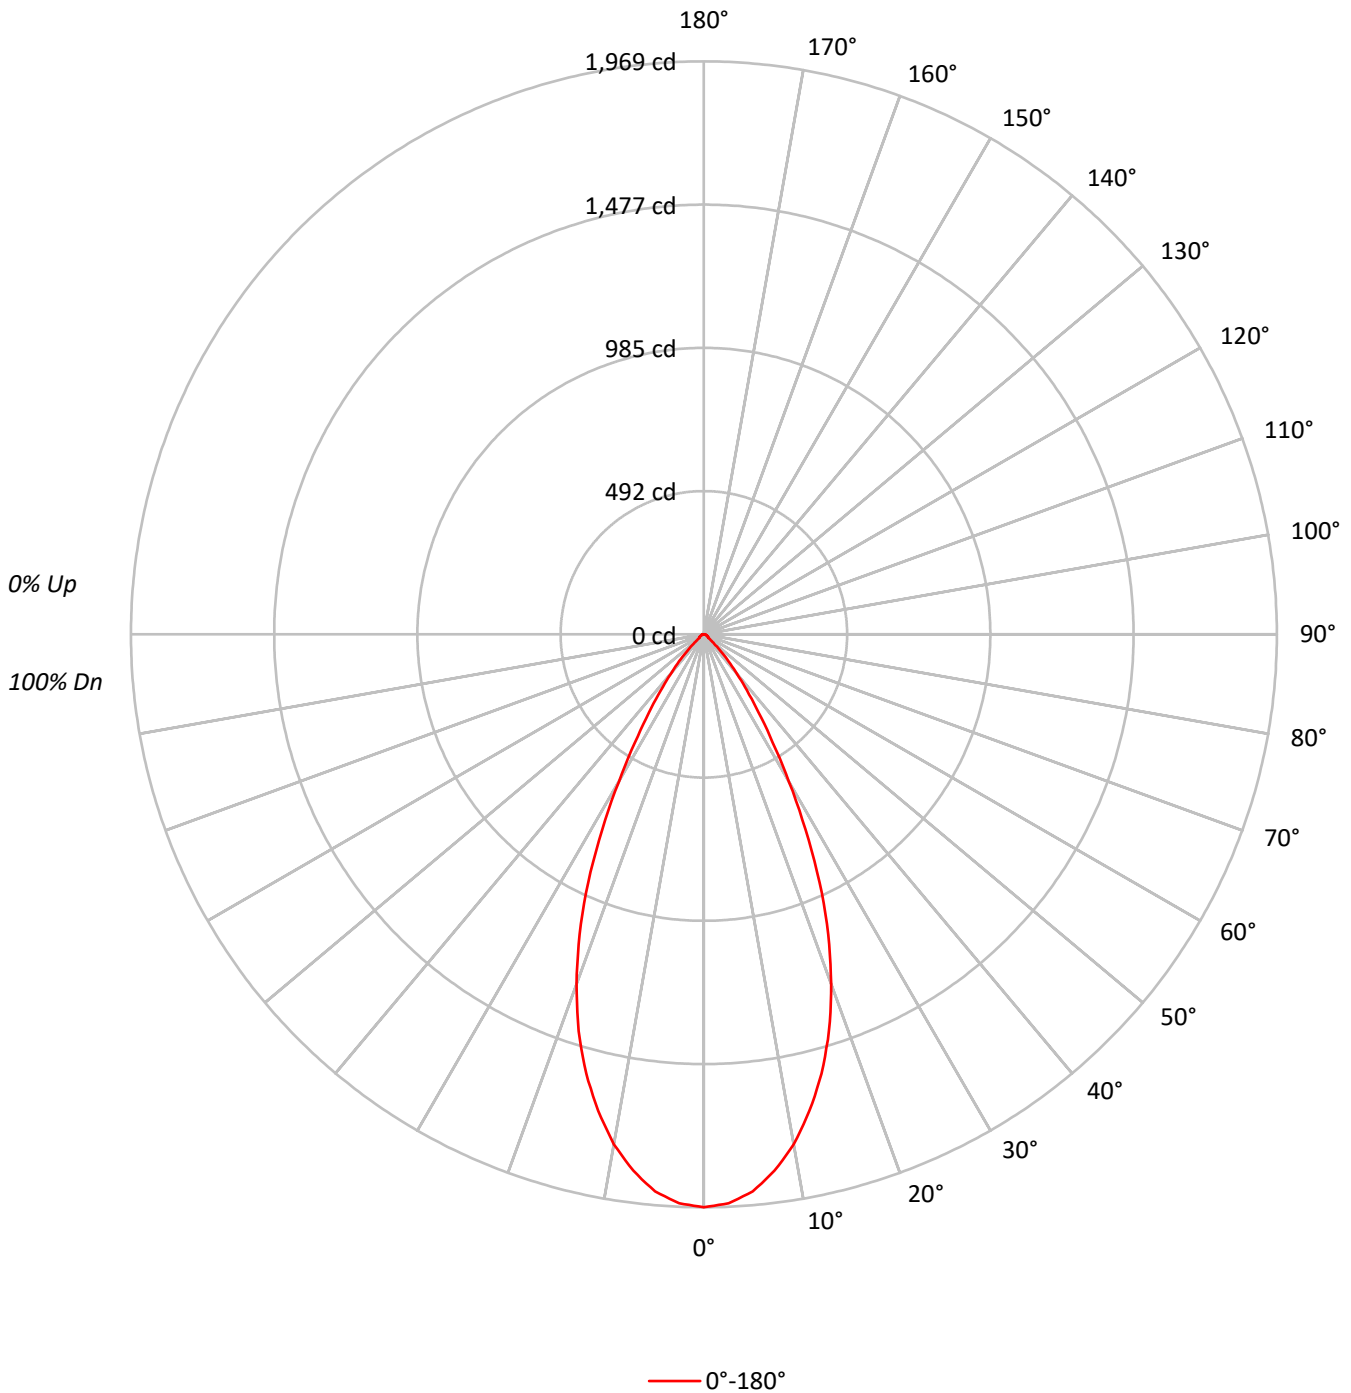



TEST NUMBER: P1301573

CATALOG NUMBER: P3AS17R50W2N902765DE010 E3DL1LI_5000K

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 178.8 | 13.2 |
| 10°-20° | 432.1 | 31.9 |
| 20°-30° | 423.9 | 31.3 |
| 30°-40° | 213.6 | 15.7 |
| 40°-50° | 67.5 | 5.0 |
| 50°-60° | 17.5 | 1.3 |
| 60°-70° | 12.4 | 0.9 |
| 70°-80° | 7.6 | 0.6 |
| 80°-90° | 2.6 | 0.2 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 1034.8 | 76.3 |
| 0°-40° | 1248.4 | 92.1 |
| 0°-60° | 1333.3 | 98.3 |
| 0°-90° | 1356.0 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 1356.0 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 1969 | |
| 5° | 1922 | 179 |
| 15° | 1562 | 432 |
| 25° | 942 | 424 |
| 35° | 328 | 214 |
| 45° | 82 | 67 |
| 55° | 19 | 17 |
| 65° | 12 | 12 |
| 75° | 7 | 8 |
| 85° | 2 | 3 |
| 90° | 0 | |



TEST NUMBER: P1301573
CATALOG NUMBER: P3AS17R50W2N902765DE010 E3DL1LI_5000K

CANDELA DISTRIBUTION (FULL):

| 0° | |
|-------|--------|
| 0° | 1968.8 |
| 2.5° | 1956.8 |
| 5° | 1921.8 |
| 7.5° | 1859.1 |
| 10° | 1779.5 |
| 12.5° | 1677.1 |
| 15° | 1562.5 |
| 17.5° | 1429.9 |
| 20° | 1279.2 |
| 22.5° | 1116.4 |
| 25° | 941.6 |
| 27.5° | 755.9 |
| 30° | 584.7 |
| 32.5° | 440.1 |
| 35° | 327.9 |
| 37.5° | 242.3 |
| 40° | 177.2 |
| 42.5° | 125.4 |
| 45° | 82.0 |
| 47.5° | 47.0 |
| 50° | 27.7 |
| 52.5° | 20.5 |
| 55° | 19.3 |
| 57.5° | 16.9 |
| 60° | 15.7 |
| 62.5° | 14.5 |
| 65° | 12.1 |
| 67.5° | 10.9 |
| 70° | 9.6 |
| 72.5° | 8.4 |
| 75° | 7.2 |
| 77.5° | 6.0 |
| 80° | 4.8 |
| 82.5° | 3.6 |
| 85° | 2.4 |
| 87.5° | 1.2 |
| 90° | 0.0 |

(END OF REPORT)