

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1246822

Luminaire Tested: P3A13R209024DE010 E3CB1MW

Issue Date: 1/30/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1246822  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-8)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3A13R209024DE010 E3CB1MW  
Description: 3in Adjustable LED luminaire with, R20 optic, 2400K CCT AND, 90CRI , E3CB1MW TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 1083.0 lumens  
Efficiency: N/A  
Efficacy: 74.2 lumens/watt  
Spacing Criteria (0/90/45): 0.35 / 0.35 / 0.34  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct

Input Watts (W): 14.6  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1246822

CATALOG NUMBER: P3A13R209024DE010 E3CB1MW

### Luminous Intensity Polar Plot

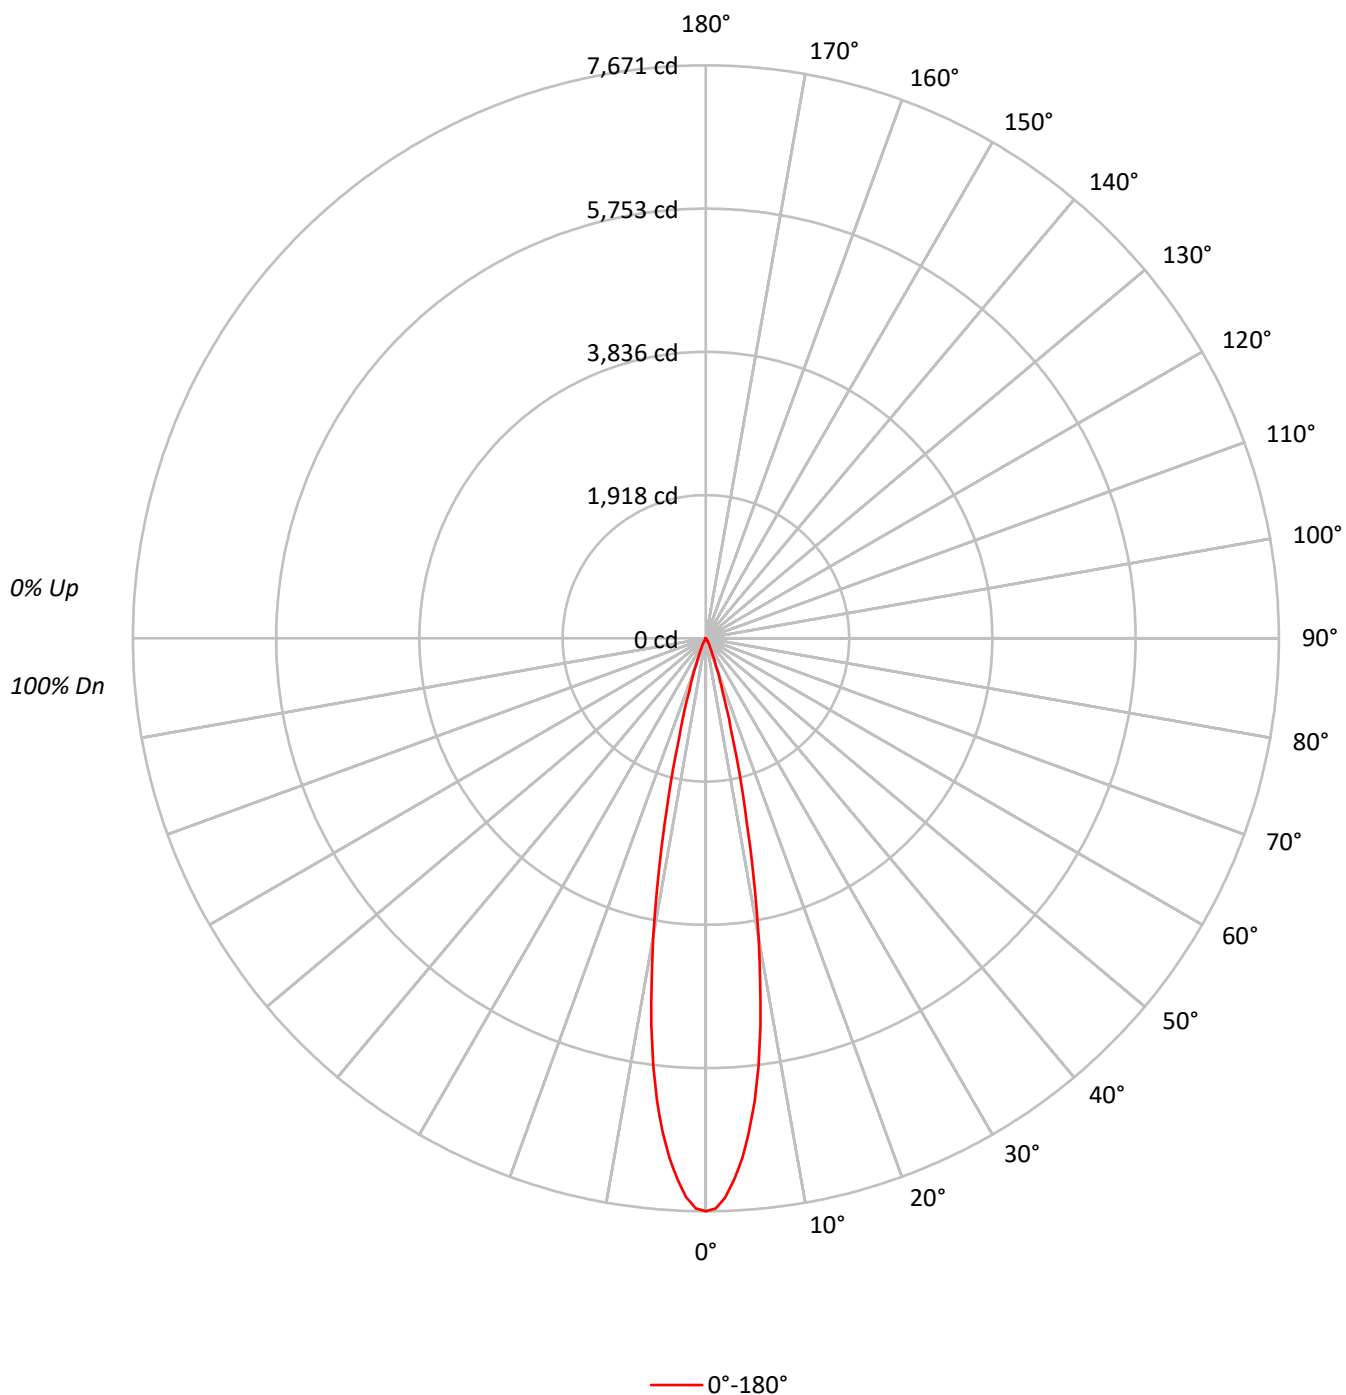

TEST NUMBER: P1246822

CATALOG NUMBER: P3A13R209024DE010 E3CB1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|-----|-----|-----|--|-----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |  | 20  |     |     |  | 20  |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |  | 30  |     |     |  | 10  |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  |  | 50  | 30  | 10  |  | 50  |
| RCR |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 |  | 106 | 106 | 106 |  | 102 |
| 1   | 116 | 114 | 112 | 110 | 113 | 112 | 110 | 109 | 108 | 106 | 105 |  | 104 | 103 | 102 |  | 101 |
| 2   | 112 | 109 | 106 | 104 | 110 | 108 | 105 | 103 | 104 | 103 | 101 |  | 102 | 100 | 99  |  | 99  |
| 3   | 109 | 105 | 102 | 100 | 108 | 104 | 101 | 99  | 102 | 99  | 97  |  | 99  | 98  | 96  |  | 97  |
| 4   | 107 | 102 | 99  | 96  | 105 | 101 | 98  | 96  | 99  | 97  | 94  |  | 97  | 95  | 93  |  | 96  |
| 5   | 104 | 99  | 96  | 93  | 103 | 98  | 95  | 93  | 97  | 94  | 92  |  | 95  | 93  | 91  |  | 94  |
| 6   | 102 | 97  | 93  | 91  | 101 | 96  | 93  | 90  | 95  | 92  | 90  |  | 94  | 91  | 89  |  | 93  |
| 7   | 100 | 94  | 91  | 88  | 99  | 94  | 91  | 88  | 93  | 90  | 88  |  | 92  | 89  | 87  |  | 91  |
| 8   | 98  | 92  | 89  | 86  | 97  | 92  | 89  | 86  | 91  | 88  | 86  |  | 90  | 88  | 86  |  | 89  |
| 9   | 96  | 90  | 87  | 85  | 95  | 90  | 87  | 85  | 89  | 86  | 84  |  | 89  | 86  | 84  |  | 88  |
| 10  | 94  | 89  | 85  | 83  | 93  | 88  | 85  | 83  | 88  | 85  | 83  |  | 87  | 84  | 83  |  | 86  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |         |
|-----|---------|
|     | 0°      |
| 0°  | 1682014 |
| 5°  | 1459935 |
| 10° | 902076  |
| 15° | 313328  |
| 20° | 96212   |
| 25° | 34018   |
| 30° | 12584   |
| 35° | 5059    |
| 40° | 2691    |
| 45° | 1054    |
| 50° | 580     |
| 55° | 650     |
| 60° | 746     |
| 65° | 467     |
| 70° | 577     |
| 75° | 763     |
| 80° | 0       |
| 85° | 0       |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1054 cd/sqm

TEST NUMBER: P1246822

CATALOG NUMBER: P3A13R209024DE010 E3CB1MW

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 550.4  | 50.8      |
| 10°-20°   | 436.7  | 40.3      |
| 20°-30°   | 75.6   | 7.0       |
| 30°-40°   | 13.7   | 1.3       |
| 40°-50°   | 3.1    | 0.3       |
| 50°-60°   | 1.5    | 0.1       |
| 60°-70°   | 1.0    | 0.1       |
| 70°-80°   | 0.8    | 0.1       |
| 80°-90°   | 0.0    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| <hr/>     |        |           |
| 0°-30°    | 1062.8 | 98.1      |
| 0°-40°    | 1076.6 | 99.4      |
| 0°-60°    | 1081.2 | 99.8      |
| 0°-90°    | 1083.0 | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 1083.0 | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 7671 |      |
| 5°  | 6632 | 550  |
| 15° | 1380 | 437  |
| 25° | 141  | 76   |
| 35° | 19   | 14   |
| 45° | 3    | 3    |
| 55° | 2    | 2    |
| 65° | 1    | 1    |
| 75° | 1    | 1    |
| 85° | 0    | 0    |
| 90° | 0    |      |

TEST NUMBER: P1246822

CATALOG NUMBER: P3A13R209024DE010 E3CB1MW

**CANDELA DISTRIBUTION (FULL):**

| 0°    |        |
|-------|--------|
| 0°    | 7670.6 |
| 1°    | 7633.8 |
| 2°    | 7488.0 |
| 3°    | 7254.0 |
| 4°    | 6979.7 |
| 5°    | 6632.5 |
| 6°    | 6234.7 |
| 7°    | 5771.8 |
| 8°    | 5244.6 |
| 9°    | 4652.3 |
| 10°   | 4051.3 |
| 12.5° | 2555.5 |
| 15°   | 1380.2 |
| 17.5° | 737.2  |
| 20°   | 412.3  |
| 22.5° | 235.7  |
| 25°   | 140.6  |
| 27.5° | 85.7   |
| 30°   | 49.7   |
| 32.5° | 29.1   |
| 35°   | 18.9   |
| 37.5° | 12.9   |
| 40°   | 9.4    |
| 42.5° | 6.0    |
| 45°   | 3.4    |
| 47.5° | 1.7    |
| 50°   | 1.7    |
| 52.5° | 1.7    |
| 55°   | 1.7    |
| 57.5° | 1.7    |
| 60°   | 1.7    |
| 62.5° | 0.9    |
| 65°   | 0.9    |
| 67.5° | 0.9    |
| 70°   | 0.9    |
| 72.5° | 0.9    |
| 75°   | 0.9    |
| 77.5° | 0.9    |
| 80°   | 0.0    |
| 82.5° | 0.0    |
| 85°   | 0.0    |
| 87.5° | 0.0    |
| 90°   | 0.0    |

(END OF REPORT)