

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1247725

Luminaire Tested: P3A20R509024D010 E3D1WMH

Issue Date: 1/29/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1247725  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2501-338-13)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/29/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3A20R509024D010 E3D1WMH  
Description: 3in Adjustable LED luminaire with, R50 optic, 2400K CCT AND, 90CRI , E3D1WMH TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 2071.0 lumens  
Efficiency: N/A  
Efficacy: 71.9 lumens/watt  
Spacing Criteria (0/90/45): 0.82 / 0.82 / 0.77  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct

Input Watts (W): 28.8  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1247725

CATALOG NUMBER: P3A20R509024D010 E3D1WMH

### Luminous Intensity Polar Plot

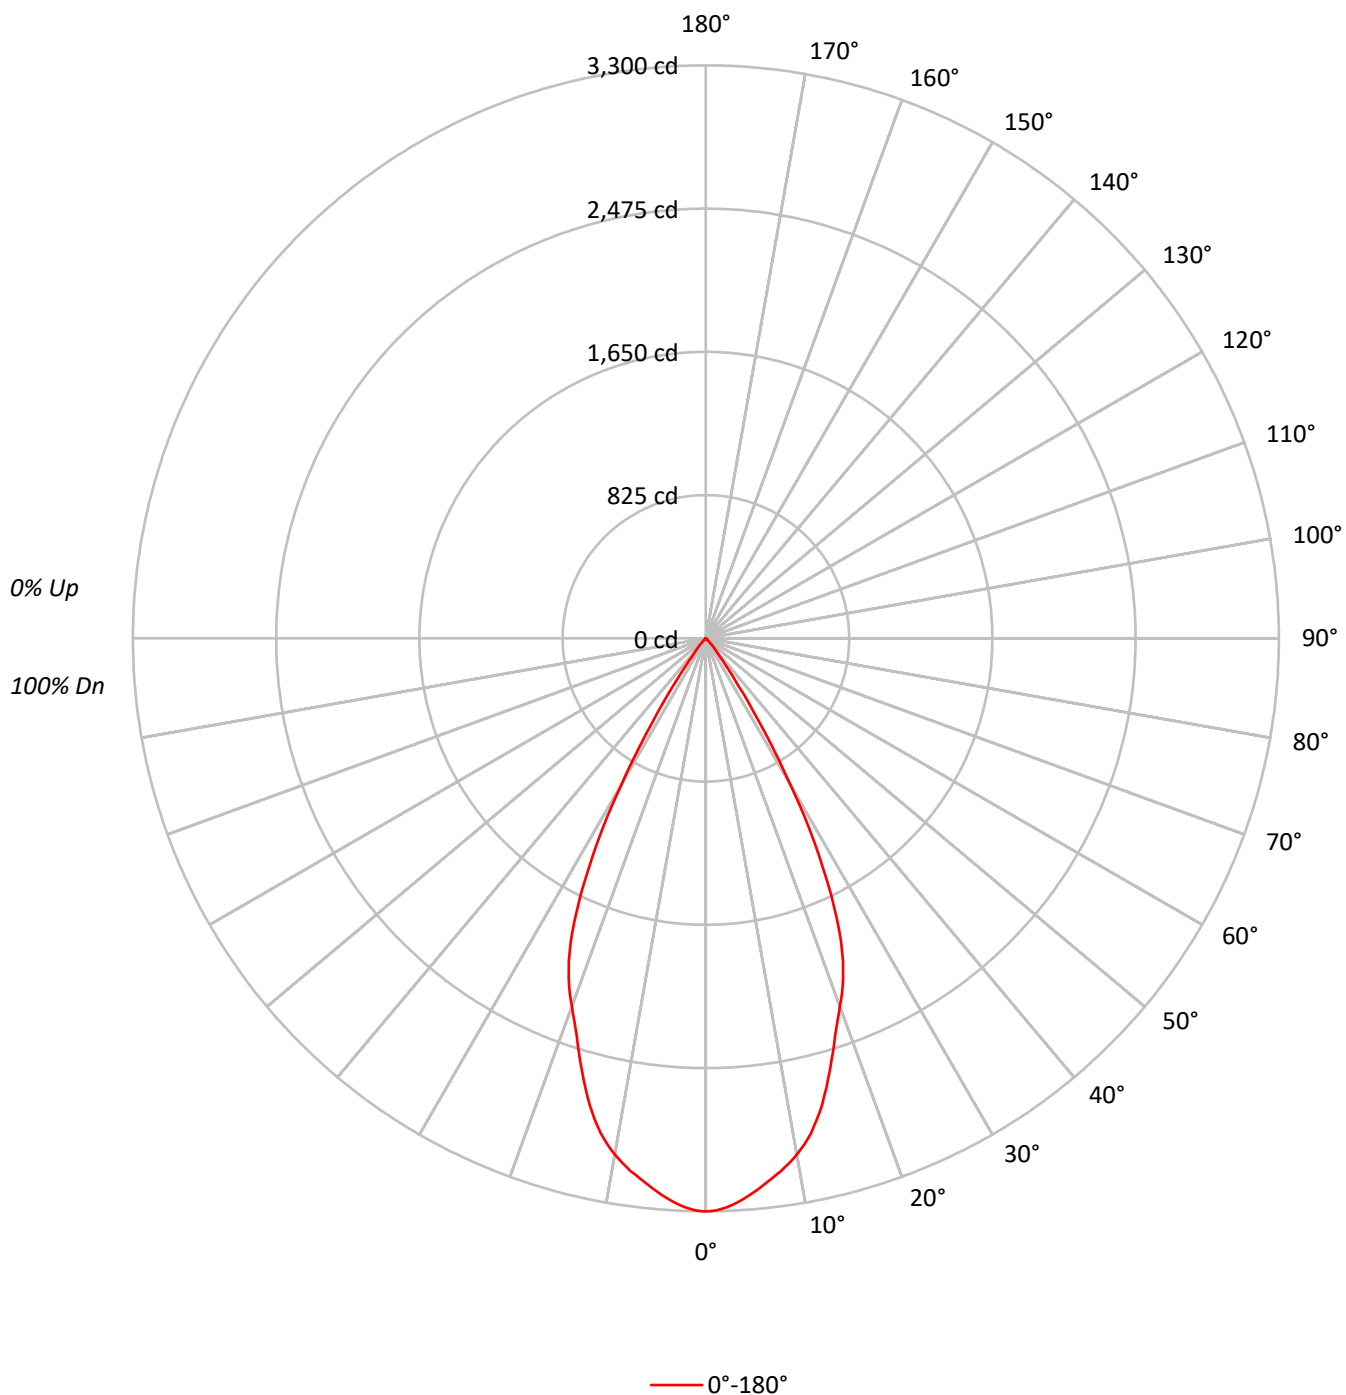

TEST NUMBER: P1247725

CATALOG NUMBER: P3A20R509024D010 E3D1WMH

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| RF  | 20  |     |     |     | 20  |     |     |     |     | 20  |     |     |     |     | 20  |     |     |     |     | 20  |
| RC  | 80  |     |     |     | 70  |     |     |     |     | 50  |     |     |     |     | 30  |     |     |     |     | 10  |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 102 | 102 | 100 |
| 1   | 114 | 112 | 109 | 107 | 112 | 110 | 108 | 106 | 105 | 104 | 102 | 102 | 101 | 99  | 98  | 97  | 97  | 97  | 97  | 95  |
| 2   | 109 | 105 | 101 | 98  | 107 | 103 | 100 | 97  | 100 | 97  | 95  | 97  | 95  | 93  | 94  | 93  | 91  | 91  | 91  | 90  |
| 3   | 105 | 99  | 95  | 91  | 103 | 98  | 94  | 90  | 95  | 92  | 89  | 93  | 90  | 88  | 91  | 88  | 86  | 86  | 86  | 85  |
| 4   | 100 | 94  | 89  | 85  | 99  | 92  | 88  | 85  | 90  | 87  | 84  | 88  | 85  | 83  | 87  | 84  | 82  | 82  | 82  | 80  |
| 5   | 96  | 89  | 84  | 80  | 94  | 88  | 83  | 79  | 86  | 82  | 79  | 84  | 81  | 78  | 83  | 80  | 77  | 77  | 77  | 76  |
| 6   | 92  | 84  | 79  | 75  | 91  | 83  | 78  | 75  | 82  | 78  | 74  | 81  | 77  | 74  | 79  | 76  | 73  | 73  | 73  | 72  |
| 7   | 88  | 80  | 75  | 71  | 87  | 79  | 74  | 71  | 78  | 74  | 70  | 77  | 73  | 70  | 76  | 72  | 70  | 70  | 70  | 68  |
| 8   | 84  | 76  | 71  | 67  | 83  | 76  | 71  | 67  | 75  | 70  | 67  | 74  | 69  | 66  | 73  | 69  | 66  | 66  | 66  | 65  |
| 9   | 81  | 73  | 67  | 64  | 80  | 72  | 67  | 64  | 71  | 67  | 63  | 70  | 66  | 63  | 70  | 66  | 63  | 63  | 63  | 62  |
| 10  | 78  | 69  | 64  | 61  | 77  | 69  | 64  | 61  | 68  | 64  | 60  | 67  | 63  | 60  | 67  | 63  | 60  | 60  | 60  | 59  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |        |
|-----|--------|
|     | 0°     |
| 0°  | 723736 |
| 5°  | 704467 |
| 10° | 672265 |
| 15° | 608607 |
| 20° | 526516 |
| 25° | 431904 |
| 30° | 248089 |
| 35° | 77069  |
| 40° | 20696  |
| 45° | 7257   |
| 50° | 1740   |
| 55° | 573    |
| 60° | 307    |
| 65° | 363    |
| 70° | 0      |
| 75° | 0      |
| 80° | 0      |
| 85° | 0      |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 7257 cd/sqm

TEST NUMBER: P1247725

CATALOG NUMBER: P3A20R509024D010 E3D1WMH

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 299.8  | 14.5      |
| 10°-20°   | 742.8  | 35.9      |
| 20°-30°   | 780.7  | 37.7      |
| 30°-40°   | 223.5  | 10.8      |
| 40°-50°   | 21.8   | 1.1       |
| 50°-60°   | 1.8    | 0.1       |
| 60°-70°   | 0.6    | 0.0       |
| 70°-80°   | 0.0    | 0.0       |
| 80°-90°   | 0.0    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| <hr/>     |        |           |
| 0°-30°    | 1823.3 | 88.0      |
| 0°-40°    | 2046.8 | 98.8      |
| 0°-60°    | 2070.4 | 100.0     |
| 0°-90°    | 2071.0 | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 2071.0 | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 3300 |      |
| 5°  | 3200 | 300  |
| 15° | 2681 | 743  |
| 25° | 1785 | 781  |
| 35° | 288  | 223  |
| 45° | 23   | 22   |
| 55° | 2    | 2    |
| 65° | 1    | 1    |
| 75° | 0    | 0    |
| 85° | 0    | 0    |
| 90° | 0    |      |

TEST NUMBER: P1247725

CATALOG NUMBER: P3A20R509024D010 E3D1WMH

**CANDELA DISTRIBUTION (FULL):**

| 0°    |        |
|-------|--------|
| 0°    | 3300.5 |
| 1°    | 3295.4 |
| 2°    | 3280.8 |
| 3°    | 3259.6 |
| 4°    | 3231.1 |
| 5°    | 3200.4 |
| 6°    | 3167.5 |
| 7°    | 3132.4 |
| 8°    | 3099.5 |
| 9°    | 3061.6 |
| 10°   | 3019.2 |
| 11°   | 2970.2 |
| 12°   | 2914.0 |
| 13°   | 2843.8 |
| 14°   | 2767.8 |
| 15°   | 2680.9 |
| 16°   | 2588.8 |
| 17°   | 2499.7 |
| 18°   | 2408.3 |
| 19°   | 2327.9 |
| 20°   | 2256.3 |
| 21°   | 2187.7 |
| 22°   | 2109.5 |
| 23°   | 2019.6 |
| 24°   | 1914.4 |
| 25°   | 1785.1 |
| 26°   | 1644.8 |
| 27°   | 1488.4 |
| 28°   | 1332.8 |
| 29°   | 1164.7 |
| 30°   | 979.8  |
| 31°   | 806.7  |
| 32°   | 647.4  |
| 32.5° | 578.0  |
| 33°   | 507.8  |
| 34°   | 389.5  |
| 35°   | 287.9  |
| 36°   | 211.2  |
| 37°   | 157.1  |
| 37.5° | 135.9  |
| 38°   | 117.6  |
| 39°   | 91.3   |
| 40°   | 72.3   |
| 42.5° | 40.9   |
| 45°   | 23.4   |



TEST NUMBER: P1247725

CATALOG NUMBER: P3A20R509024D010 E3D1WMH

**CANDELA DISTRIBUTION (continued):**

|       | 0°   |
|-------|------|
| 47.5° | 13.2 |
| 50°   | 5.1  |
| 52.5° | 2.2  |
| 55°   | 1.5  |
| 57.5° | 1.5  |
| 60°   | 0.7  |
| 62.5° | 0.7  |
| 65°   | 0.7  |
| 67.5° | 0.7  |
| 70°   | 0.0  |
| 72.5° | 0.0  |
| 75°   | 0.0  |
| 77.5° | 0.0  |
| 80°   | 0.0  |
| 82.5° | 0.0  |
| 85°   | 0.0  |
| 87.5° | 0.0  |
| 90°   | 0.0  |

(END OF REPORT)