

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1256638

Luminaire Tested: P3A05R359040DE010 E3PHLD1MW

Issue Date: 1/29/2026

Test Information

Test Method: LM-79-2019
Report Number: P1256638
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2510-583-20)
Test Lab: INNOVATION CENTER
Issue Date: 1/29/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: IRiS
Catalog Number: P3A05R359040DE010 E3PHLD1MW
Description: 3in Adjustable LED luminaire with, R35 optic, 4000K CCT AND, 90CRI , E3PHLD1MW TRIM
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 418.0 lumens
Efficiency: N/A
Efficacy: 58.1 lumens/watt
Spacing Criteria (0/90/45): 0.83 / 0.83 / 0.92
Luminous Opening: Circular (Dia: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 7.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1256638

CATALOG NUMBER: P3A05R359040DE010 E3PHLD1MW

Luminous Intensity Polar Plot

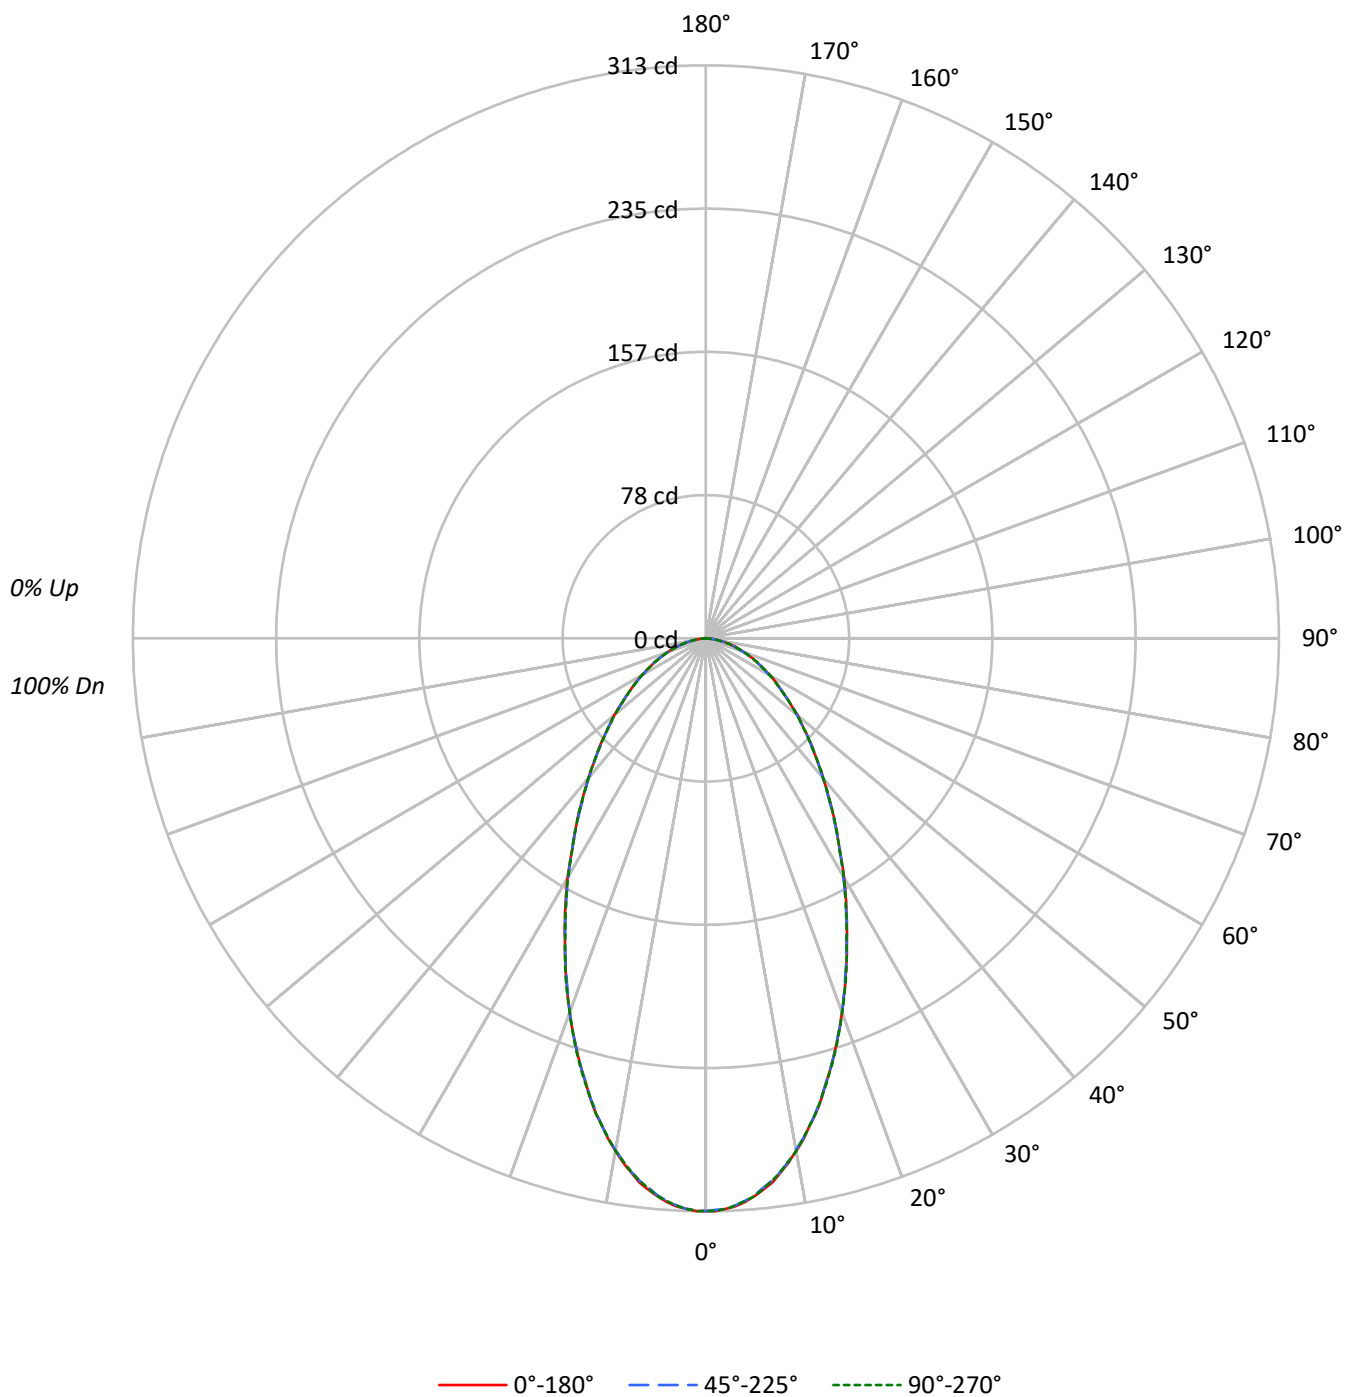

TEST NUMBER: P1256638

CATALOG NUMBER: P3A05R359040DE010 E3PHLD1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	111	107	103	100	108	105	101	99	100	98	95		97	95	93		93
2	103	96	90	85	100	94	89	84	90	86	82		87	84	81		84
3	95	86	79	74	93	85	78	73	82	76	72		79	75	71		77
4	88	78	71	65	86	77	70	65	75	68	64		72	67	63		70
5	82	71	64	58	80	70	63	58	68	62	57		66	61	56		65
6	77	65	58	52	75	65	57	52	63	56	51		61	55	51		60
7	72	60	53	47	71	60	52	47	58	52	47		57	51	46		55
8	68	56	48	43	66	55	48	43	54	47	43		53	47	43		52
9	64	52	45	40	63	51	44	40	50	44	39		49	44	39		48
10	60	49	42	37	59	48	41	37	47	41	37		46	41	36		45

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	68613	68613	68613
5°	67334	67202	67334
10°	63303	63192	63303
15°	57322	57322	57435
20°	50731	50731	50731
25°	44107	43986	43986
30°	38234	37981	38107
35°	32926	32792	32926
40°	28568	28425	28568
45°	25088	24933	24933
50°	22276	22072	22072
55°	19574	19574	19574
60°	17762	17499	17762
65°	15929	15929	15929
70°	14169	14169	14169
75°	12793	12370	12793
80°	10860	10860	10860
85°	6793	6793	6793

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 25088 cd/sqm

TEST NUMBER: P1256638

CATALOG NUMBER: P3A05R359040DE010 E3PHLD1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	28.5	6.8
10°-20°	70.4	16.9
20°-30°	83.7	20.0
30°-40°	76.9	18.4
40°-50°	62.4	14.9
50°-60°	46.2	11.0
60°-70°	30.5	7.3
70°-80°	15.8	3.8
80°-90°	3.6	0.8
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	182.6	43.7
0°-40°	259.5	62.1
0°-60°	368.1	88.1
0°-90°	418.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	418.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	313	313	313	313	313	
5°	306	305	305	305	306	29
15°	252	252	252	252	253	70
25°	182	182	182	182	182	84
35°	123	122	122	123	123	77
45°	81	80	80	80	80	63
55°	51	51	51	51	51	46
65°	31	31	31	31	31	31
75°	15	15	15	15	15	16
85°	3	3	3	3	3	4
90°	0	0	0	0	0	

TEST NUMBER: P1256638

CATALOG NUMBER: P3A05R359040DE010 E3PHLD1MW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	312.9	312.9	312.9	312.9	312.9
1°	312.9	312.3	312.3	312.3	312.9
2°	311.8	311.8	311.8	311.8	311.8
3°	310.7	310.2	310.2	310.2	310.2
4°	308.6	308.0	308.0	308.0	308.0
5°	305.9	305.3	305.3	305.3	305.9
6°	302.6	302.1	301.6	301.6	302.1
7°	299.4	298.3	298.3	298.3	298.3
8°	294.5	294.0	294.0	294.0	294.0
9°	289.7	288.6	289.2	289.2	289.2
10°	284.3	283.8	283.8	283.8	284.3
11°	278.9	278.4	278.4	277.8	278.4
12°	272.4	272.4	272.4	272.4	272.4
13°	266.5	266.0	266.0	266.0	266.5
14°	260.0	259.5	259.5	259.5	259.5
15°	252.5	252.5	252.5	252.5	253.0
17.5°	235.2	234.7	235.2	235.2	235.7
20°	217.4	216.9	217.4	217.4	217.4
22.5°	199.6	199.6	199.1	199.6	200.1
25°	182.3	181.8	181.8	182.3	181.8
27.5°	166.2	165.6	165.6	165.6	165.6
30°	151.0	150.0	150.0	150.5	150.5
32.5°	135.4	135.4	135.9	135.4	135.4
35°	123.0	122.5	122.5	123.0	123.0
37.5°	110.6	110.1	110.1	110.6	110.6
40°	99.8	99.8	99.3	99.8	99.8
42.5°	89.6	89.6	89.6	89.6	89.6
45°	80.9	80.4	80.4	80.4	80.4
47.5°	72.3	72.3	72.3	71.7	72.3
50°	65.3	64.7	64.7	64.7	64.7
52.5°	57.7	57.7	57.7	57.7	57.7
55°	51.2	51.2	51.2	51.2	51.2
57.5°	45.9	45.3	45.3	45.3	45.3
60°	40.5	40.5	39.9	40.5	40.5
62.5°	35.1	35.1	35.1	35.1	35.1
65°	30.7	30.7	30.7	30.7	30.7
67.5°	26.4	26.4	26.4	26.4	26.4
70°	22.1	22.1	22.1	22.1	22.1
72.5°	18.9	18.3	18.3	18.3	18.3
75°	15.1	15.1	14.6	15.1	15.1
77.5°	11.3	11.3	11.3	11.3	11.3
80°	8.6	8.6	8.6	8.1	8.6
82.5°	5.4	5.4	5.4	5.4	5.4
85°	2.7	2.7	2.7	2.7	2.7
87.5°	0.5	0.5	0.5	1.1	1.1



TEST NUMBER: P1256638
CATALOG NUMBER: P3A05R359040DE010 E3PHLD1MW

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
90°	0.0	0.0	0.0	0.0	0.0

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

IRiS

Report Number: SP1-2504-409-14

Test Date: 05/14/2025

Luminaire Tested: LD3A05R129040D010 E3D1H

Data in this report applies to families of products including LD3A

Test Information

Test Method: LM-79-2019
 Report Number: SP1-2504-409-14
 Test Lab: COOPER LIGHTING SOLUTIONS
 Photometer: SP1 - 76IN SPHERE
 Measurement Geometry: 4π
 Issue Date: 05/18/2025
 Manufacturer: COOPER LIGHTING SOLUTIONS
 Product Line: IRiS
 Catalog Number: **LD3A05R129040D010 E3D1H**
 Description: 3in Adjustable LED luminaire with, R12 optic, 4000K CCT AND, 90CRI LEDS, E3D1H TRIM

Spectral Parameters

CCT (K): 4015
 CIE u' : 0.2239
 CIE v' : 0.5033
 Duv: 0.0016
 CIE x: 0.3809
 CIE y: 0.3805
 CIE z: 0.2386
 Peak Wavelength (nm): 450
 Dominant Wavelength (nm): 578
 Purity: 28.51686
 Rf: 91.5
 Rg: 100.3

CRI (Ra): 92.3
 R1: 93.1
 R2: 93.8
 R3: 94.2
 R4: 94.2
 R5: 92.7
 R6: 91.9
 R7: 94.0
 R8: 84.8
 R9: 58.4
 R10: 85.3
 R11: 94.4
 R12: 74.9
 R13: 93.3
 R14: 96.5
 R15: 89.0



Test Conditions

Stabilization Time: 26M
 Operation Time: 1H 26M
 Sphere Temperature (°C): 24.9

REPORT NUMBER: SP1-2504-409-14

Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	IN0058	12/16/2024	6/16/2025
Power Meter	INXT2011004	1/21/2025	1/21/2026
AC Power Source	IN0063	10/22/2024	10/22/2025
DC Power Source	IN0208	10/22/2024	10/22/2025
Sphere Thermometer	IN0085	10/22/2024	10/22/2025
Room Thermometer	IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2504-409-14

CIE 1931 Chromaticity Diagram



CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles



Point lies inside the ANSI 4000K 4-step quadrangle

REPORT NUMBER: SP1-2504-409-14

Photopic Flux vs. Wavelength



Photopic Lumens: NR

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	385	NR	620	871	NR	750	49	NR	880	1	NR
365	0	NR	495	468	NR	625	849	NR	755	42	NR	885	1	NR
370	0	NR	500	547	NR	630	819	NR	760	36	NR	890	1	NR
375	0	NR	505	609	NR	635	784	NR	765	31	NR	895	1	NR
380	0	NR	510	652	NR	640	744	NR	770	27	NR	900	1	NR
385	1	NR	515	684	NR	645	697	NR	775	23	NR	905	0	NR
390	2	NR	520	702	NR	650	645	NR	780	20	NR	910	0	NR
395	4	NR	525	710	NR	655	594	NR	785	17	NR	915	0	NR
400	6	NR	530	718	NR	660	541	NR	790	14	NR	920	0	NR
405	9	NR	535	723	NR	665	491	NR	795	12	NR	925	0	NR
410	15	NR	540	729	NR	670	441	NR	800	11	NR	930	0	NR
415	26	NR	545	731	NR	675	395	NR	805	9	NR	935	0	NR
420	49	NR	550	731	NR	680	352	NR	810	8	NR	940	0	NR
425	95	NR	555	736	NR	685	312	NR	815	7	NR	945	0	NR
430	173	NR	560	740	NR	690	275	NR	820	6	NR	950	0	NR
435	305	NR	565	746	NR	695	241	NR	825	5	NR	955	0	NR
440	511	NR	570	757	NR	700	210	NR	830	4	NR	960	0	NR
445	811	NR	575	768	NR	705	184	NR	835	4	NR	965	0	NR
450	1000	NR	580	785	NR	710	159	NR	840	3	NR	970	0	NR
455	760	NR	585	803	NR	715	139	NR	845	3	NR	975	0	NR
460	496	NR	590	826	NR	720	120	NR	850	3	NR	980	0	NR
465	392	NR	595	848	NR	725	104	NR	855	2	NR	985	0	NR
470	302	NR	600	865	NR	730	89	NR	860	2	NR	990	0	NR
475	253	NR	605	879	NR	735	76	NR	865	2	NR	995	0	NR
480	269	NR	610	882	NR	740	65	NR	870	1	NR	1000	0	NR
485	319	NR	615	881	NR	745	55	NR	875	1	NR			

REPORT NUMBER: SP1-2504-409-14

Scotopic Flux vs. Wavelength



Scotopic Lumens: NR

S/P: 1.77

λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)	λ (nm)	Power W [^] /nm	Lumens (φ/nm)
360	0	NR	490	385	NR	620	871	NR	750	49	NR	880	1	NR
365	0	NR	495	468	NR	625	849	NR	755	42	NR	885	1	NR
370	0	NR	500	547	NR	630	819	NR	760	36	NR	890	1	NR
375	0	NR	505	609	NR	635	784	NR	765	31	NR	895	1	NR
380	0	NR	510	652	NR	640	744	NR	770	27	NR	900	1	NR
385	1	NR	515	684	NR	645	697	NR	775	23	NR	905	0	NR
390	2	NR	520	702	NR	650	645	NR	780	20	NR	910	0	NR
395	4	NR	525	710	NR	655	594	NR	785	17	NR	915	0	NR
400	6	NR	530	718	NR	660	541	NR	790	14	NR	920	0	NR
405	9	NR	535	723	NR	665	491	NR	795	12	NR	925	0	NR
410	15	NR	540	729	NR	670	441	NR	800	11	NR	930	0	NR
415	26	NR	545	731	NR	675	395	NR	805	9	NR	935	0	NR
420	49	NR	550	731	NR	680	352	NR	810	8	NR	940	0	NR
425	95	NR	555	736	NR	685	312	NR	815	7	NR	945	0	NR
430	173	NR	560	740	NR	690	275	NR	820	6	NR	950	0	NR
435	305	NR	565	746	NR	695	241	NR	825	5	NR	955	0	NR
440	511	NR	570	757	NR	700	210	NR	830	4	NR	960	0	NR
445	811	NR	575	768	NR	705	184	NR	835	4	NR	965	0	NR
450	1000	NR	580	785	NR	710	159	NR	840	3	NR	970	0	NR
455	760	NR	585	803	NR	715	139	NR	845	3	NR	975	0	NR
460	496	NR	590	826	NR	720	120	NR	850	3	NR	980	0	NR
465	392	NR	595	848	NR	725	104	NR	855	2	NR	985	0	NR
470	302	NR	600	865	NR	730	89	NR	860	2	NR	990	0	NR
475	253	NR	605	879	NR	735	76	NR	865	2	NR	995	0	NR
480	269	NR	610	882	NR	740	65	NR	870	1	NR	1000	0	NR
485	319	NR	615	881	NR	745	55	NR	875	1	NR			

REPORT NUMBER: SP1-2504-409-14

Melanopic Flux vs. Wavelength



Melanopic Lumens: NR

M/P: 3.62

λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)	λ (nm)	Power $\text{W}^{\wedge}/\text{nm}$	Lumens (ϕ/nm)
360	0	NR	490	385	NR	620	871	NR	750	49	NR	880	1	NR
365	0	NR	495	468	NR	625	849	NR	755	42	NR	885	1	NR
370	0	NR	500	547	NR	630	819	NR	760	36	NR	890	1	NR
375	0	NR	505	609	NR	635	784	NR	765	31	NR	895	1	NR
380	0	NR	510	652	NR	640	744	NR	770	27	NR	900	1	NR
385	1	NR	515	684	NR	645	697	NR	775	23	NR	905	0	NR
390	2	NR	520	702	NR	650	645	NR	780	20	NR	910	0	NR
395	4	NR	525	710	NR	655	594	NR	785	17	NR	915	0	NR
400	6	NR	530	718	NR	660	541	NR	790	14	NR	920	0	NR
405	9	NR	535	723	NR	665	491	NR	795	12	NR	925	0	NR
410	15	NR	540	729	NR	670	441	NR	800	11	NR	930	0	NR
415	26	NR	545	731	NR	675	395	NR	805	9	NR	935	0	NR
420	49	NR	550	731	NR	680	352	NR	810	8	NR	940	0	NR
425	95	NR	555	736	NR	685	312	NR	815	7	NR	945	0	NR
430	173	NR	560	740	NR	690	275	NR	820	6	NR	950	0	NR
435	305	NR	565	746	NR	695	241	NR	825	5	NR	955	0	NR
440	511	NR	570	757	NR	700	210	NR	830	4	NR	960	0	NR
445	811	NR	575	768	NR	705	184	NR	835	4	NR	965	0	NR
450	1000	NR	580	785	NR	710	159	NR	840	3	NR	970	0	NR
455	760	NR	585	803	NR	715	139	NR	845	3	NR	975	0	NR
460	496	NR	590	826	NR	720	120	NR	850	3	NR	980	0	NR
465	392	NR	595	848	NR	725	104	NR	855	2	NR	985	0	NR
470	302	NR	600	865	NR	730	89	NR	860	2	NR	990	0	NR
475	253	NR	605	879	NR	735	76	NR	865	2	NR	995	0	NR
480	269	NR	610	882	NR	740	65	NR	870	1	NR	1000	0	NR
485	319	NR	615	881	NR	745	55	NR	875	1	NR			

REPORT NUMBER: SP1-2504-409-14

TM-30-18
Summary
 $R_f = 91.5$
 $R_g = 100.3$
 CIE $R_a = 92.3$
 $R_9 = 58.4$

Color Vector Graphics


Individual Sample Fidelity Index ($R_{f,i}$)

CES01 = 85	CES26 = 91	CES51 = 99	CES76 = 84
CES02 = 61	CES27 = 93	CES52 = 97	CES77 = 88
CES03 = 31	CES28 = 95	CES53 = 95	CES78 = 80
CES04 = 69	CES29 = 92	CES54 = 96	CES79 = 96
CES05 = 49	CES30 = 99	CES55 = 95	CES80 = 92
CES06 = 50	CES31 = 93	CES56 = 94	CES81 = 89
CES07 = 42	CES32 = 88	CES57 = 94	CES82 = 96
CES08 = 41	CES33 = 95	CES58 = 94	CES83 = 97
CES09 = 29	CES34 = 92	CES59 = 98	CES84 = 94
CES10 = 74	CES35 = 95	CES60 = 94	CES85 = 84
CES11 = 57	CES36 = 85	CES61 = 94	CES86 = 87
CES12 = 63	CES37 = 94	CES62 = 92	CES87 = 91
CES13 = 43	CES38 = 94	CES63 = 92	CES88 = 96
CES14 = 74	CES39 = 98	CES64 = 93	CES89 = 87
CES15 = 71	CES40 = 94	CES65 = 88	CES90 = 97
CES16 = 47	CES41 = 99	CES66 = 90	CES91 = 75
CES17 = 49	CES42 = 91	CES67 = 89	CES92 = 79
CES18 = 56	CES43 = 91	CES68 = 89	CES93 = 88
CES19 = 71	CES44 = 99	CES69 = 91	CES94 = 80
CES20 = 66	CES45 = 94	CES70 = 86	CES95 = 83
CES21 = 85	CES46 = 95	CES71 = 81	CES96 = 91
CES22 = 78	CES47 = 95	CES72 = 94	CES97 = 93
CES23 = 91	CES48 = 95	CES73 = 79	CES98 = 93
CES24 = 90	CES49 = 93	CES74 = 94	CES99 = 91
CES25 = 71	CES50 = 99	CES75 = 81	



Color Rendition by Hue-Angle Bin



Measure Comparisons



(END OF REPORT)