

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1269025

Luminaire Tested: P3A05R309740DE010 E3D1LI

Issue Date: 1/29/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1269025  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2501-338-10)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/29/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3A05R309740DE010 E3D1LI  
Description: 3in Adjustable LED luminaire with, R30 optic, 4000K CCT AND, 97CRI , E3D1LI TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 612.0 lumens  
Efficiency: N/A  
Efficacy: 85.0 lumens/watt  
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.47  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct

Input Watts (W): 7.2  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1269025

CATALOG NUMBER: P3A05R309740DE010 E3D1LI

### Luminous Intensity Polar Plot

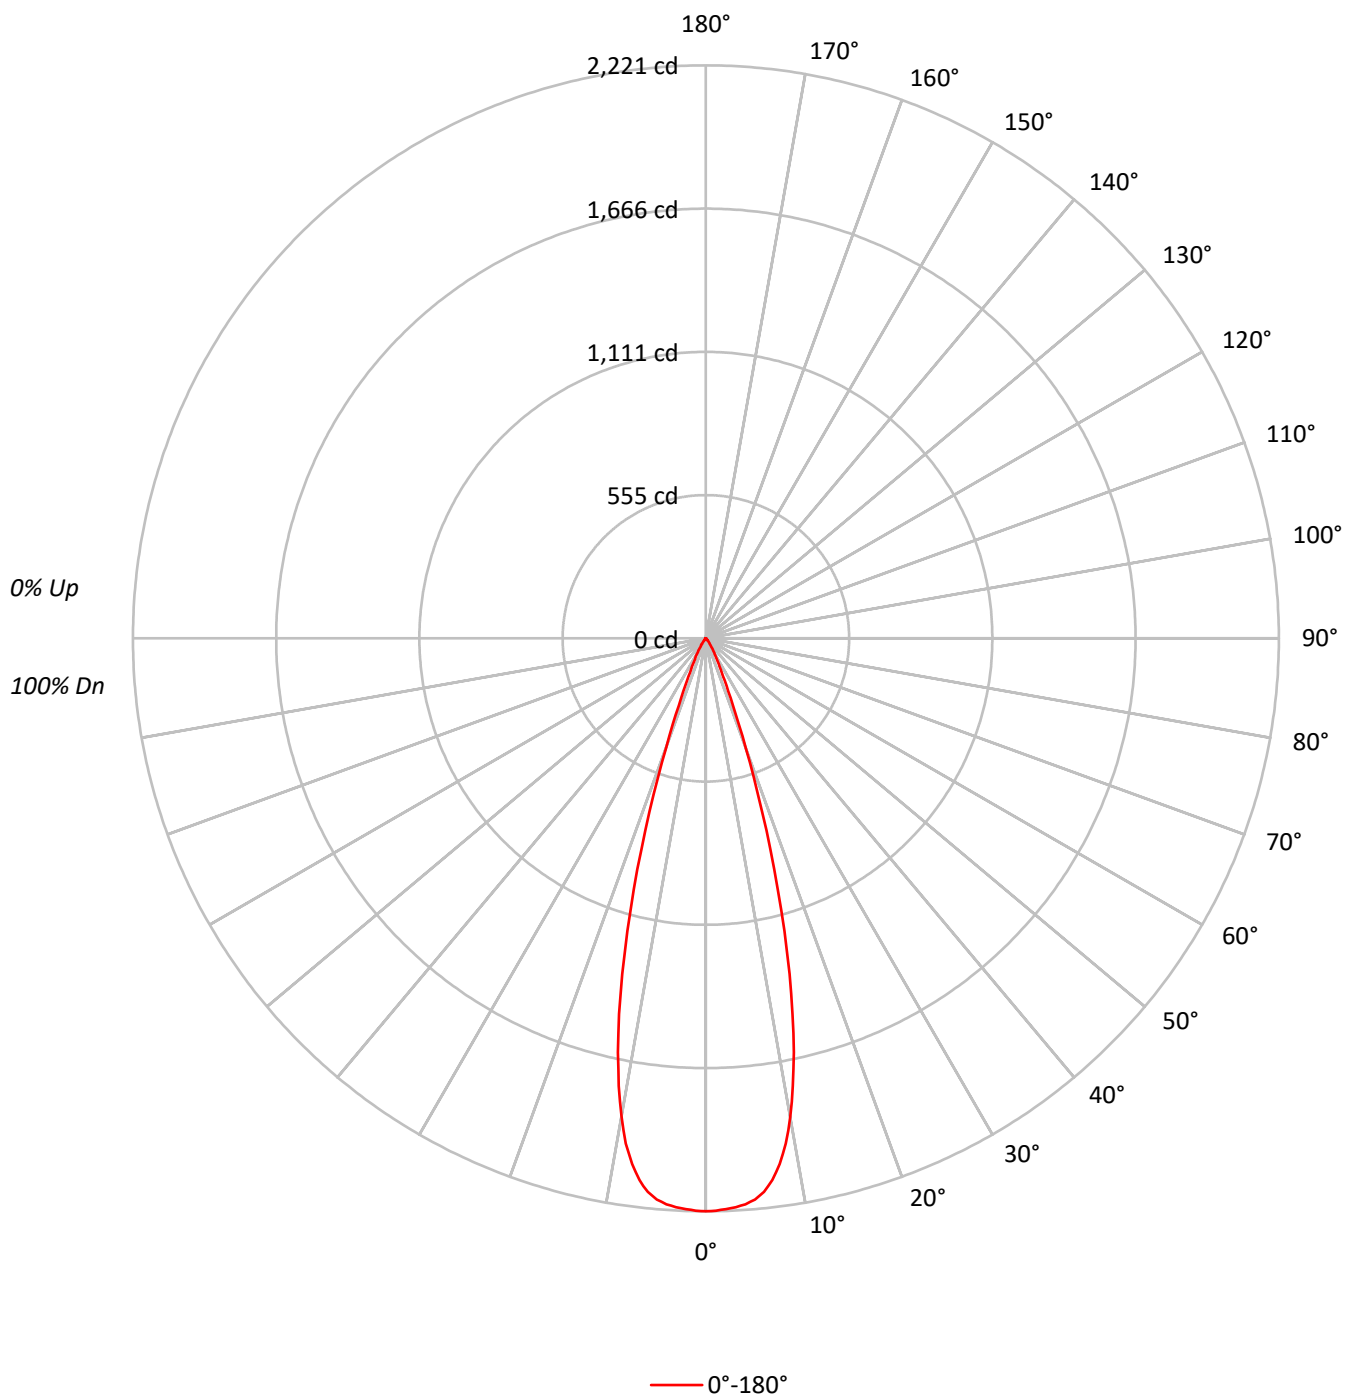

TEST NUMBER: P1269025

CATALOG NUMBER: P3A05R309740DE010 E3D1LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|
| RF  | 20  |     |     |     | 20  |     |     |     |     | 20  |     |     |     |     | 20  |     |     |     |    | 20 |
| RC  | 80  |     |     |     | 70  |     |     |     |     | 50  |     |     |     |     | 30  |     |     |     |    | 10 |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30 | 10 |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |    |    |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | 99 | 98 |
| 1   | 115 | 113 | 111 | 109 | 113 | 111 | 109 | 108 | 107 | 106 | 104 | 103 | 102 | 101 | 100 | 99  | 98  | 97  | 96 | 95 |
| 2   | 111 | 108 | 105 | 102 | 109 | 106 | 103 | 101 | 103 | 101 | 99  | 100 | 98  | 97  | 97  | 96  | 95  | 94  | 93 | 92 |
| 3   | 108 | 103 | 100 | 97  | 106 | 102 | 99  | 96  | 99  | 97  | 95  | 97  | 95  | 93  | 95  | 93  | 92  | 90  | 89 | 88 |
| 4   | 105 | 99  | 95  | 92  | 103 | 98  | 95  | 92  | 96  | 93  | 91  | 94  | 92  | 90  | 93  | 91  | 89  | 88  | 87 | 86 |
| 5   | 101 | 96  | 92  | 89  | 100 | 95  | 91  | 88  | 93  | 90  | 87  | 92  | 89  | 87  | 90  | 88  | 86  | 85  | 84 | 83 |
| 6   | 99  | 92  | 88  | 85  | 97  | 92  | 88  | 85  | 90  | 87  | 85  | 89  | 86  | 84  | 88  | 85  | 83  | 82  | 81 | 80 |
| 7   | 96  | 89  | 85  | 82  | 95  | 89  | 85  | 82  | 88  | 84  | 82  | 87  | 84  | 81  | 86  | 83  | 81  | 80  | 79 | 78 |
| 8   | 93  | 87  | 83  | 80  | 92  | 86  | 82  | 80  | 85  | 82  | 79  | 84  | 81  | 79  | 84  | 81  | 79  | 78  | 77 | 76 |
| 9   | 91  | 84  | 80  | 77  | 90  | 84  | 80  | 77  | 83  | 79  | 77  | 82  | 79  | 77  | 82  | 79  | 77  | 76  | 75 | 74 |
| 10  | 88  | 82  | 78  | 75  | 88  | 81  | 78  | 75  | 81  | 77  | 75  | 80  | 77  | 75  | 80  | 77  | 75  | 74  | 73 | 72 |

**AVERAGE LUMINANCE (cd/sqm):**

|     |        |
|-----|--------|
|     | 0°     |
| 0°  | 486935 |
| 5°  | 480584 |
| 10° | 419587 |
| 15° | 266698 |
| 20° | 105663 |
| 25° | 35300  |
| 30° | 16433  |
| 35° | 7442   |
| 40° | 2863   |
| 45° | 1395   |
| 50° | 409    |
| 55° | 191    |
| 60° | 88     |
| 65° | 104    |
| 70° | 0      |
| 75° | 0      |
| 80° | 0      |
| 85° | 0      |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1395 cd/sqm

TEST NUMBER: P1269025

CATALOG NUMBER: P3A05R309740DE010 E3D1LI

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 199.6  | 32.6      |
| 10°-20°   | 309.5  | 50.6      |
| 20°-30°   | 79.8   | 13.0      |
| 30°-40°   | 18.8   | 3.1       |
| 40°-50°   | 3.7    | 0.6       |
| 50°-60°   | 0.4    | 0.1       |
| 60°-70°   | 0.2    | 0.0       |
| 70°-80°   | 0.0    | 0.0       |
| 80°-90°   | 0.0    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| <hr/>     |        |           |
| 0°-30°    | 589.0  | 96.2      |
| 0°-40°    | 607.7  | 99.3      |
| 0°-60°    | 611.8  | 100.0     |
| 0°-90°    | 612.0  | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 612.0  | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 2221 |      |
| 5°  | 2183 | 200  |
| 15° | 1175 | 310  |
| 25° | 146  | 80   |
| 35° | 28   | 19   |
| 45° | 4    | 4    |
| 55° | 0    | 0    |
| 65° | 0    | 0    |
| 75° | 0    | 0    |
| 85° | 0    | 0    |
| 90° | 0    |      |

TEST NUMBER: P1269025

CATALOG NUMBER: P3A05R309740DE010 E3D1LI

**CANDELA DISTRIBUTION (FULL):**

| 0°    |        |
|-------|--------|
| 0°    | 2220.6 |
| 1°    | 2218.9 |
| 2°    | 2213.7 |
| 3°    | 2207.7 |
| 4°    | 2198.9 |
| 5°    | 2183.3 |
| 6°    | 2157.8 |
| 7°    | 2115.6 |
| 8°    | 2057.8 |
| 9°    | 1982.5 |
| 10°   | 1884.4 |
| 11°   | 1767.8 |
| 12°   | 1640.4 |
| 13°   | 1493.8 |
| 14°   | 1340.4 |
| 15°   | 1174.8 |
| 16°   | 1012.5 |
| 17°   | 856.2  |
| 18°   | 706.3  |
| 19°   | 568.7  |
| 20°   | 452.8  |
| 21°   | 356.4  |
| 22°   | 280.3  |
| 23°   | 221.9  |
| 24°   | 177.7  |
| 25°   | 145.9  |
| 26°   | 121.6  |
| 27°   | 103.3  |
| 28°   | 89.3   |
| 29°   | 76.5   |
| 30°   | 64.9   |
| 32.5° | 40.9   |
| 35°   | 27.8   |
| 37.5° | 17.3   |
| 40°   | 10.0   |
| 42.5° | 6.7    |
| 45°   | 4.5    |
| 47.5° | 2.6    |
| 50°   | 1.2    |
| 52.5° | 0.5    |
| 55°   | 0.5    |
| 57.5° | 0.2    |
| 60°   | 0.2    |
| 62.5° | 0.2    |
| 65°   | 0.2    |

TEST NUMBER: P1269025

CATALOG NUMBER: P3A05R309740DE010 E3D1LI

**CANDELA DISTRIBUTION (continued):**

|       | 0°  |
|-------|-----|
| 67.5° | 0.2 |
| 70°   | 0.0 |
| 72.5° | 0.0 |
| 75°   | 0.0 |
| 77.5° | 0.0 |
| 80°   | 0.0 |
| 82.5° | 0.0 |
| 85°   | 0.0 |
| 87.5° | 0.0 |
| 90°   | 0.0 |

(END OF REPORT)