Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: IRiS

Report Number: P1274147

Luminaire Tested: P3A13R509830DE010 E3DLP1MW

Issue Date: 1/30/2026

Test Information

Test Method:	LM-79-2019
Report Number:	P1274147
	TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-29)
Test Lab:	INNOVATION CENTER
Issue Date:	1/30/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	IRiS
Catalog Number:	P3A13R509830DE010 E3DLP1MW
Description:	3in Adjustable LED luminaire with, R50 optic, 3000K CCT AND, 98CRI , E3DLP1MW TRIM
Light Source:	-
Ballast/Driver:	-

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	536.0 lumens
Efficiency:	N/A
Efficacy:	37.0 lumens/watt
Spacing Criteria (0/90/45):	0.75 / 0.75 / 0.77
Luminous Opening:	Circular (Dia: 0.25' x H: 0')
CIE Type:	Direct
Input Watts (W):	14.5
Input Voltage (V):	NR
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	NR
Total Harmonic Distortion (THDi):	NR
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	24 FT

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1274147
CATALOG NUMBER: P3A13R509830DE010 E3DLP1MW

Luminous Intensity Polar Plot

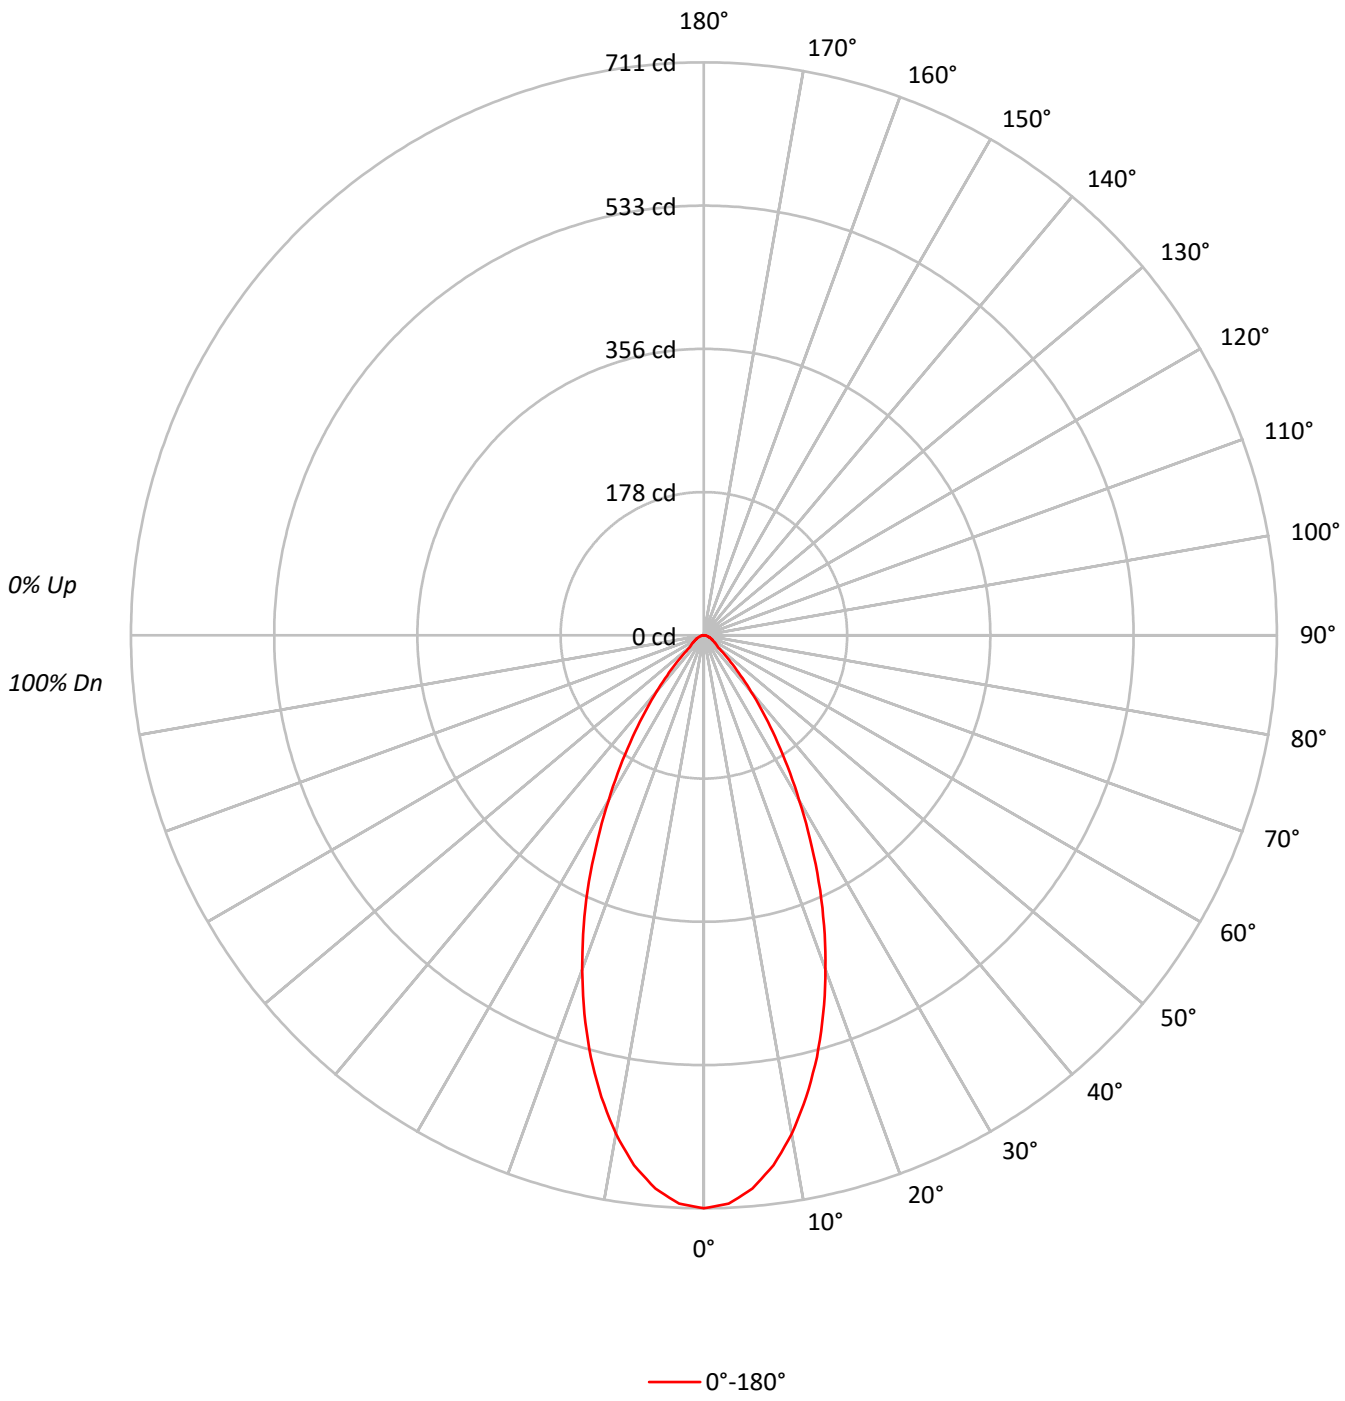

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1274147
CATALOG NUMBER: P3A13R509830DE010 E3DLP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20			20			20			20
RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	113	110	107	105	111	108	106	103	104	102	100	100	99	97	97	95	94	93
2	107	102	98	94	105	100	96	93	97	94	91	94	91	89	91	89	87	85
3	101	95	89	85	99	93	88	85	91	87	83	88	85	82	86	83	81	79
4	96	88	82	78	94	87	82	78	85	80	77	83	79	76	81	78	75	73
5	91	83	76	72	90	82	76	72	80	75	71	78	74	70	77	73	70	68
6	87	77	71	67	85	77	71	67	75	70	66	74	69	66	72	68	65	64
7	82	73	67	62	81	72	66	62	71	66	62	70	65	61	68	64	61	60
8	78	69	63	58	77	68	62	58	67	62	58	66	61	58	65	61	57	56
9	75	65	59	55	74	64	59	55	63	58	55	63	58	54	62	57	54	53
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	155887
5°	151706
10°	139877
15°	123020
20°	102932
25°	81610
30°	59883
35°	41171
40°	26163
45°	14637
50°	7914
55°	6652
60°	5745
65°	5292
70°	4680
75°	4321
80°	3662
85°	3774

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 14637 cd/sqm

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1274147
CATALOG NUMBER: P3A13R509830DE010 E3DLP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	63.8	11.9
10°-20°	150.1	28.0
20°-30°	153.5	28.6
30°-40°	97.3	18.2
40°-50°	38.7	7.2
50°-60°	15.7	2.9
60°-70°	10.1	1.9
70°-80°	5.2	1.0
80°-90°	1.6	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	367.4	68.5
0°-40°	464.8	86.7
0°-60°	519.2	96.9
0°-90°	536.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	536.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	711	
5°	689	64
15°	542	150
25°	337	154
35°	154	97
45°	47	39
55°	17	16
65°	10	10
75°	5	5
85°	2	2
90°	0	

TEST NUMBER: P1274147
CATALOG NUMBER: P3A13R509830DE010 E3DLP1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	710.9
2.5°	705.9
5°	689.2
7.5°	663.1
10°	628.2
12.5°	586.9
15°	541.9
17.5°	492.6
20°	441.1
22.5°	389.6
25°	337.3
27.5°	285.1
30°	236.5
32.5°	193.0
35°	153.8
37.5°	120.4
40°	91.4
42.5°	67.5
45°	47.2
47.5°	31.9
50°	23.2
52.5°	19.6
55°	17.4
57.5°	15.2
60°	13.1
62.5°	11.6
65°	10.2
67.5°	8.7
70°	7.3
72.5°	5.8
75°	5.1
77.5°	3.6
80°	2.9
82.5°	2.2
85°	1.5
87.5°	0.7
90°	0.0

(END OF REPORT)