

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1300307

Luminaire Tested: P3A17R30W2N902765DE010 E3D1WH_3000K

Issue Date: 1/29/2026

Test Information

Test Method: LM-79-2019
Report Number: P1300307
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2501-338-10)
Test Lab: INNOVATION CENTER
Issue Date: 1/29/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: IRiS
Catalog Number: P3A17R30W2N902765DE010 E3D1WH_3000K
Description: 3in Adjustable Tunable White LED luminaire with, R30 optic, 3000K CCT AND, 90CRI ,
E3D1WH TRIM
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1508.0 lumens
Efficiency: N/A
Efficacy: 77.7 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.47
Luminous Opening: Circular (Dia: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 19.4
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1300307

CATALOG NUMBER: P3A17R30W2N902765DE010 E3D1WH_3000K

Luminous Intensity Polar Plot

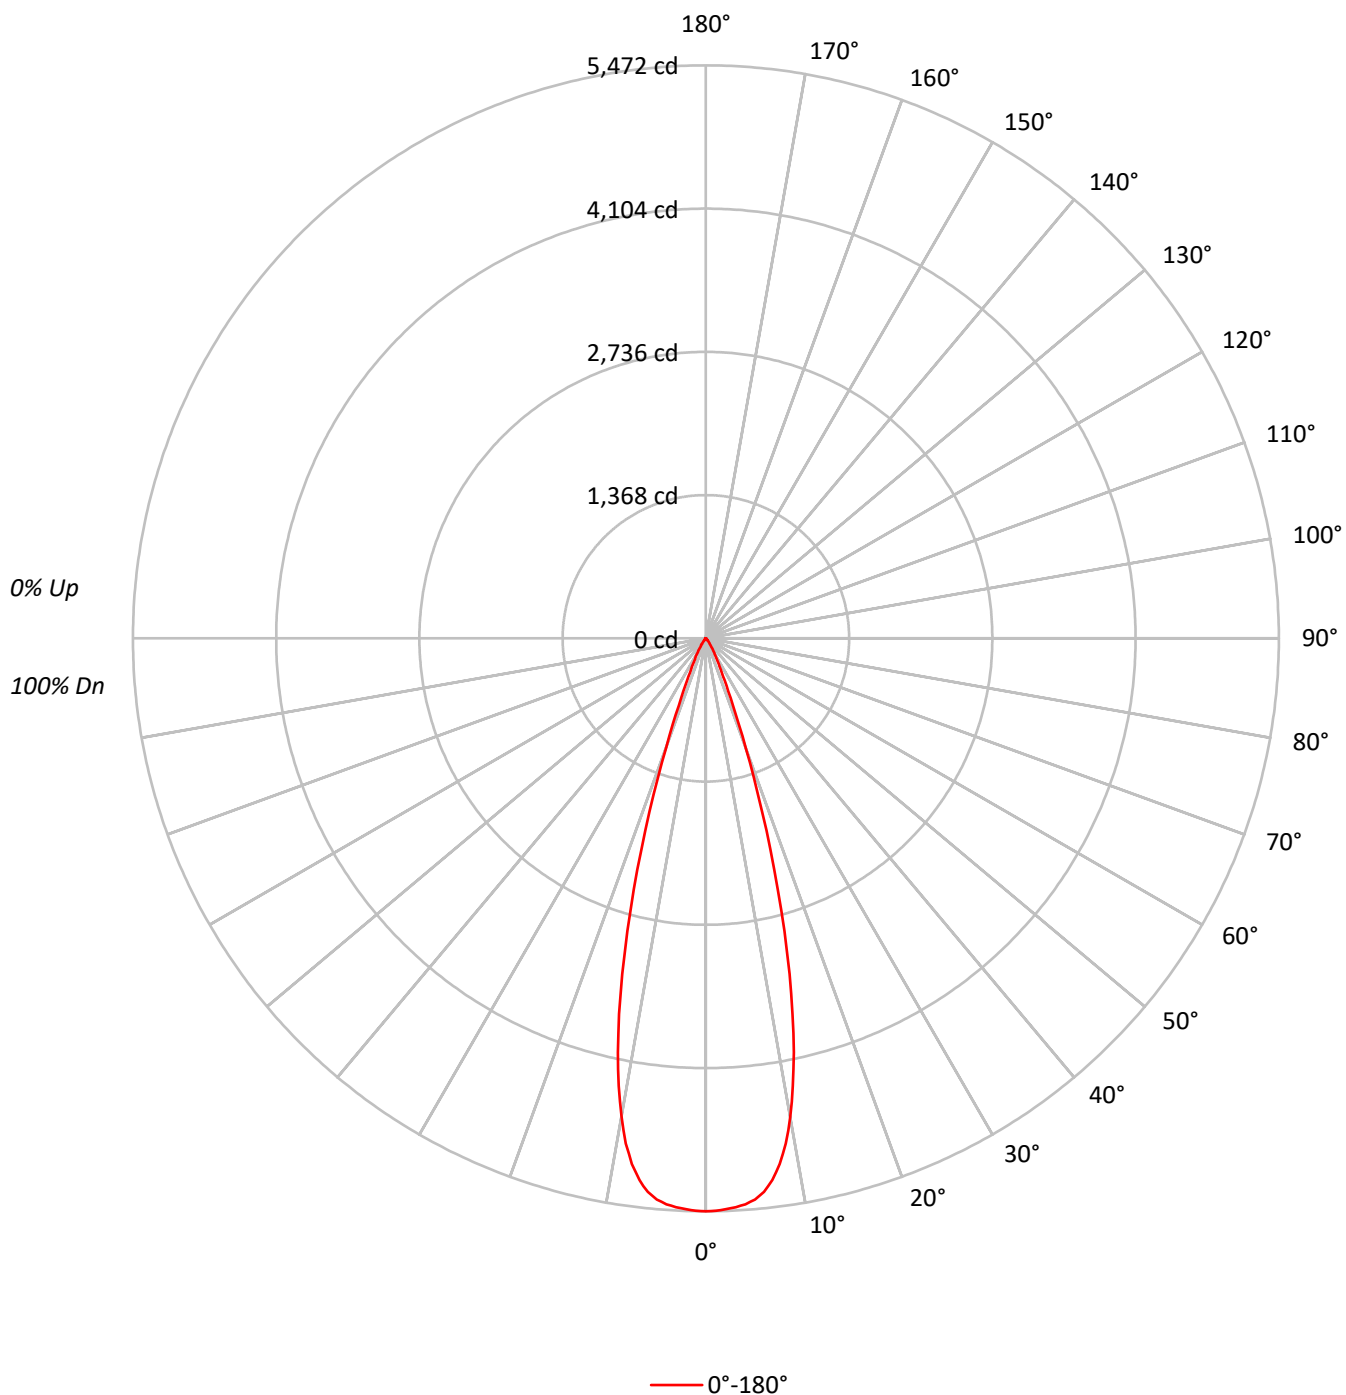



TEST NUMBER: P1300307

CATALOG NUMBER: P3A17R30W2N902765DE010 E3D1WH_3000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10			
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0		
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97		
2	111	108	105	102	109	106	103	101	103	101	99	100	98	97	97	96	95	94		
3	108	103	100	97	106	102	99	96	99	97	95	97	95	93	95	93	92	90		
4	105	99	95	92	103	98	95	92	96	93	91	94	92	90	93	91	89	88		
5	101	96	92	89	100	95	91	88	93	90	87	92	89	87	90	88	86	85		
6	99	92	88	85	97	92	88	85	90	87	85	89	86	84	88	85	83	82		
7	96	89	85	82	95	89	85	82	88	84	82	87	84	81	86	83	81	80		
8	93	87	83	80	92	86	82	80	85	82	79	84	81	79	84	81	79	78		
9	91	84	80	77	90	84	80	77	83	79	77	82	79	77	82	79	77	76		
10	88	82	78	75	88	81	78	75	81	77	75	80	77	75	80	77	75	74		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1199816
5°	1184170
10°	1033893
15°	657143
20°	260353
25°	86957
30°	40462
35°	18337
40°	7042
45°	3442
50°	989
55°	459
60°	263
65°	311
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3442 cd/sqm

TEST NUMBER: P1300307

CATALOG NUMBER: P3A17R30W2N902765DE010 E3D1WH_3000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	491.8	32.6
10°-20°	762.7	50.6
20°-30°	196.7	13.0
30°-40°	46.2	3.1
40°-50°	9.0	0.6
50°-60°	1.0	0.1
60°-70°	0.5	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1451.2	96.2
0°-40°	1497.4	99.3
0°-60°	1507.5	100.0
0°-90°	1508.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1508.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	5472	
5°	5380	492
15°	2895	763
25°	359	197
35°	68	46
45°	11	9
55°	1	1
65°	1	1
75°	0	0
85°	0	0
90°	0	

TEST NUMBER: P1300307

CATALOG NUMBER: P3A17R30W2N902765DE010 E3D1WH_3000K

CANDELA DISTRIBUTION (FULL):

0°	
0°	5471.6
1°	5467.5
2°	5454.6
3°	5440.0
4°	5418.3
5°	5379.7
6°	5317.0
7°	5212.8
8°	5070.6
9°	4885.0
10°	4643.3
11°	4355.8
12°	4042.1
13°	3680.9
14°	3302.7
15°	2894.7
16°	2494.9
17°	2109.7
18°	1740.3
19°	1401.4
20°	1115.7
21°	878.1
22°	690.8
23°	546.7
24°	437.9
25°	359.4
26°	299.7
27°	254.6
28°	220.1
29°	188.5
30°	159.8
32.5°	100.7
35°	68.5
37.5°	42.7
40°	24.6
42.5°	16.4
45°	11.1
47.5°	6.4
50°	2.9
52.5°	1.2
55°	1.2
57.5°	0.6
60°	0.6
62.5°	0.6
65°	0.6



TEST NUMBER: P1300307

CATALOG NUMBER: P3A17R30W2N902765DE010 E3D1WH_3000K

CANDELA DISTRIBUTION (continued):

	0°
67.5°	0.6
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)