

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1301494

Luminaire Tested: P3A17R50W2N902765DE010 E3CB1MB\_4000K

Issue Date: 1/30/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1301494  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-32)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3A17R50W2N902765DE010 E3CB1MB\_4000K  
Description: 3in Adjustable Tunable White LED luminaire with, R50 optic, 4000K CCT AND, 90CRI ,  
E3CB1MB TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 1659.0 lumens  
Efficiency: N/A  
Efficacy: 85.5 lumens/watt  
Spacing Criteria (0/90/45): 0.84 / 0.84 / 0.76  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct

Input Watts (W): 19.4  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1301494

CATALOG NUMBER: P3A17R50W2N902765DE010 E3CB1MB\_4000K

### Luminous Intensity Polar Plot

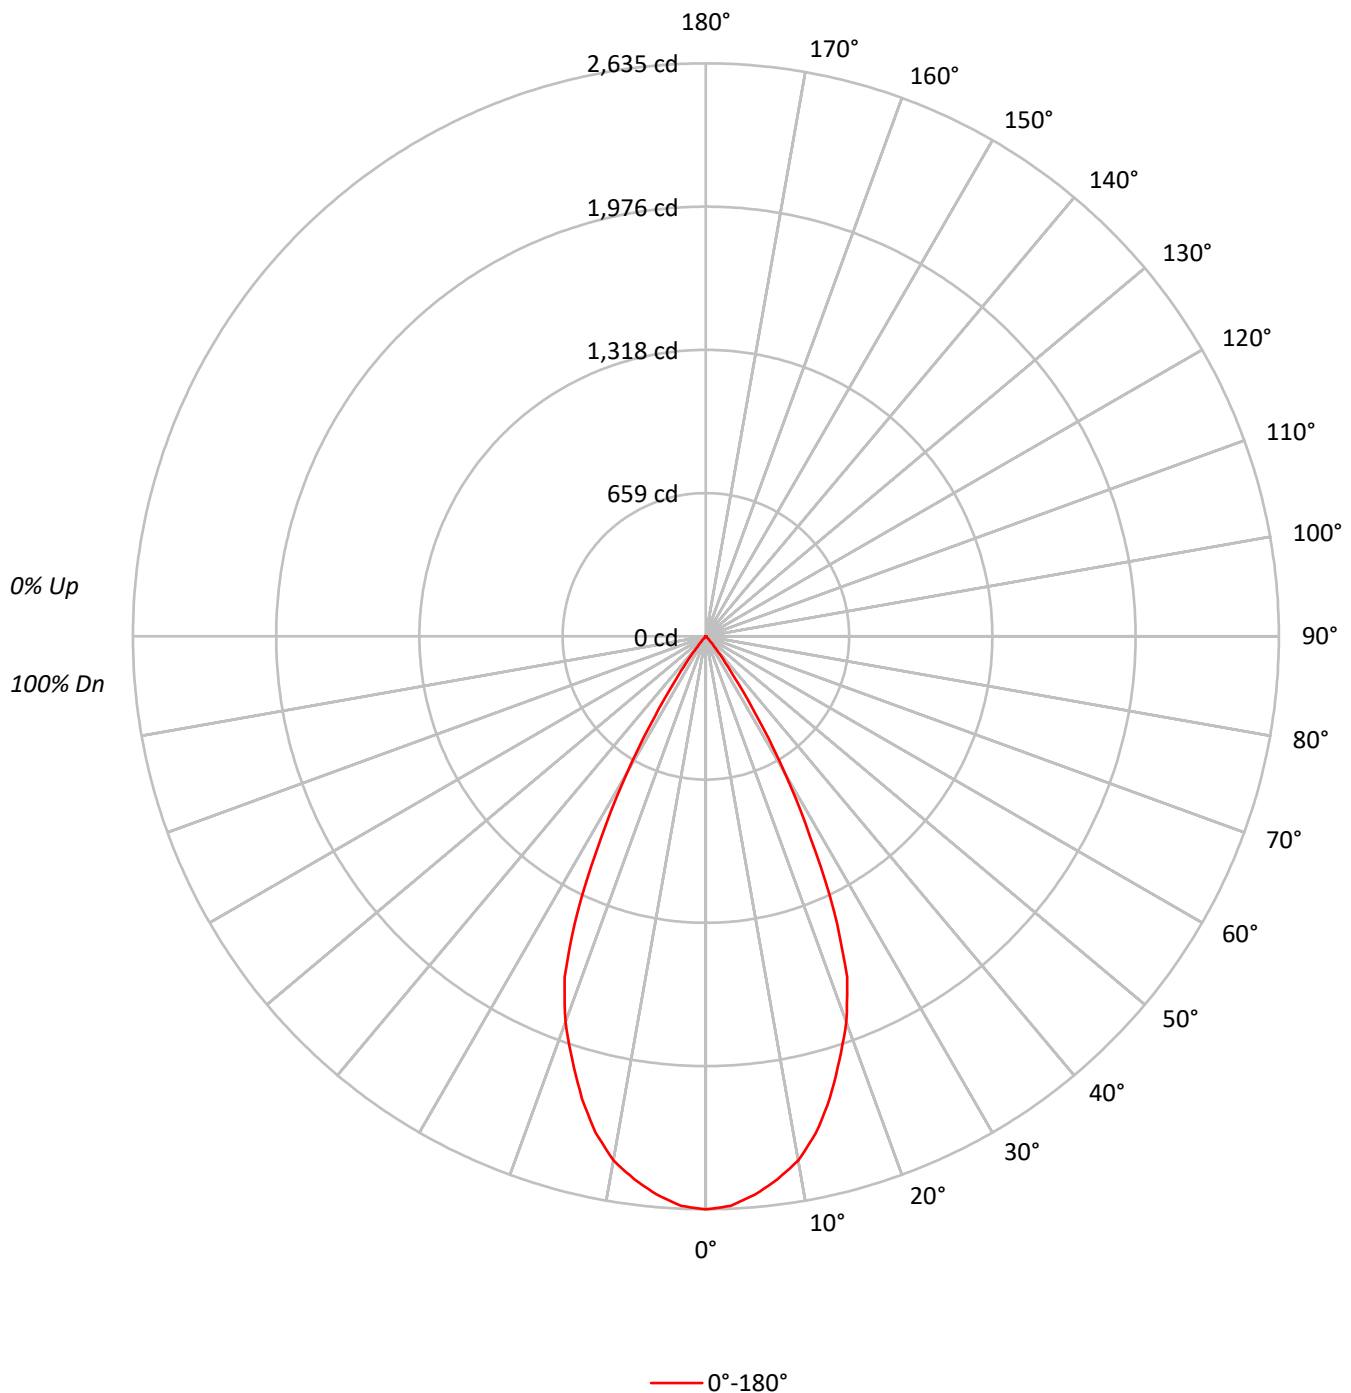



TEST NUMBER: P1301494

CATALOG NUMBER: P3A17R50W2N902765DE010 E3CB1MB\_4000K

### COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

|     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |  |  |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|--|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |     |     | 20  |     |  |  |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |     | 30  |     |     |     | 10  |     |  |  |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 50  | 30  | 10  | 0   |  |  |
| RCR |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |     |  |  |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 |  |  |
| 1   | 114 | 112 | 109 | 107 | 112 | 109 | 107 | 106 | 105 | 104 | 102 | 102 | 101 | 99  | 98  | 97  | 97  | 95  |  |  |
| 2   | 109 | 105 | 101 | 98  | 107 | 103 | 100 | 97  | 100 | 97  | 95  | 97  | 95  | 93  | 94  | 93  | 91  | 90  |  |  |
| 3   | 105 | 99  | 95  | 91  | 103 | 98  | 94  | 90  | 95  | 92  | 89  | 93  | 90  | 88  | 91  | 88  | 86  | 85  |  |  |
| 4   | 100 | 94  | 89  | 85  | 99  | 92  | 88  | 85  | 90  | 87  | 84  | 88  | 85  | 83  | 87  | 84  | 82  | 80  |  |  |
| 5   | 96  | 89  | 84  | 80  | 94  | 88  | 83  | 79  | 86  | 82  | 79  | 84  | 81  | 78  | 83  | 80  | 77  | 76  |  |  |
| 6   | 92  | 84  | 79  | 75  | 91  | 83  | 79  | 75  | 82  | 78  | 74  | 81  | 77  | 74  | 79  | 76  | 73  | 72  |  |  |
| 7   | 88  | 80  | 75  | 71  | 87  | 79  | 74  | 71  | 78  | 74  | 71  | 77  | 73  | 70  | 76  | 73  | 70  | 69  |  |  |
| 8   | 85  | 76  | 71  | 67  | 83  | 76  | 71  | 67  | 75  | 70  | 67  | 74  | 70  | 67  | 73  | 69  | 66  | 65  |  |  |
| 9   | 81  | 73  | 68  | 64  | 80  | 72  | 67  | 64  | 71  | 67  | 64  | 71  | 66  | 63  | 70  | 66  | 63  | 62  |  |  |
| 10  | 78  | 69  | 64  | 61  | 77  | 69  | 64  | 61  | 68  | 64  | 61  | 68  | 63  | 61  | 67  | 63  | 60  | 59  |  |  |

**AVERAGE LUMINANCE (cd/sqm):**

|     | 0°     |
|-----|--------|
| 0°  | 577783 |
| 5°  | 567443 |
| 10° | 544835 |
| 15° | 499617 |
| 20° | 440572 |
| 25° | 337689 |
| 30° | 183598 |
| 35° | 59080  |
| 40° | 13883  |
| 45° | 1892   |
| 50° | 1672   |
| 55° | 1873   |
| 60° | 1579   |
| 65° | 1868   |
| 70° | 1539   |
| 75° | 2033   |
| 80° | 1515   |
| 85° | 3019   |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle:  $85^\circ$

Luminance: 3019 cd/sqm

TEST NUMBER: P1301494

CATALOG NUMBER: P3A17R50W2N902765DE010 E3CB1MB\_4000K

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 241.9  | 14.6      |
| 10°-20°   | 611.8  | 36.9      |
| 20°-30°   | 612.7  | 36.9      |
| 30°-40°   | 172.3  | 10.4      |
| 40°-50°   | 10.4   | 0.6       |
| 50°-60°   | 3.9    | 0.2       |
| 60°-70°   | 3.1    | 0.2       |
| 70°-80°   | 2.1    | 0.1       |
| 80°-90°   | 0.8    | 0.0       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| <hr/>     |        |           |
| 0°-30°    | 1466.4 | 88.4      |
| 0°-40°    | 1638.6 | 98.8      |
| 0°-60°    | 1653.0 | 99.6      |
| 0°-90°    | 1659.0 | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 1659.0 | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 2635 |      |
| 5°  | 2578 | 242  |
| 15° | 2201 | 612  |
| 25° | 1396 | 613  |
| 35° | 221  | 172  |
| 45° | 6    | 10   |
| 55° | 5    | 4    |
| 65° | 4    | 3    |
| 75° | 2    | 2    |
| 85° | 1    | 1    |
| 90° | 0    |      |



TEST NUMBER: P1301494

CATALOG NUMBER: P3A17R50W2N902765DE010 E3CB1MB\_4000K

**CANDELA DISTRIBUTION (FULL):**

| 0°    |        |
|-------|--------|
| 0°    | 2634.9 |
| 2.5°  | 2621.5 |
| 5°    | 2577.9 |
| 7.5°  | 2518.5 |
| 10°   | 2446.9 |
| 12.5° | 2339.0 |
| 15°   | 2200.8 |
| 17.5° | 2041.9 |
| 20°   | 1888.0 |
| 22.5° | 1696.4 |
| 25°   | 1395.7 |
| 27.5° | 1039.2 |
| 30°   | 725.1  |
| 32.5° | 437.7  |
| 35°   | 220.7  |
| 37.5° | 104.3  |
| 40°   | 48.5   |
| 42.5° | 18.2   |
| 45°   | 6.1    |
| 47.5° | 4.9    |
| 50°   | 4.9    |
| 52.5° | 4.9    |
| 55°   | 4.9    |
| 57.5° | 3.6    |
| 60°   | 3.6    |
| 62.5° | 3.6    |
| 65°   | 3.6    |
| 67.5° | 2.4    |
| 70°   | 2.4    |
| 72.5° | 2.4    |
| 75°   | 2.4    |
| 77.5° | 1.2    |
| 80°   | 1.2    |
| 82.5° | 1.2    |
| 85°   | 1.2    |
| 87.5° | 0.0    |
| 90°   | 0.0    |

(END OF REPORT)