

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1288142

Luminaire Tested: P3A05R20W2N902750DE010 E3DL1MW\_4000K

Issue Date: 1/30/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1288142  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-7)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3A05R20W2N902750DE010 E3DL1MW\_4000K  
Description: 3in Adjustable Tunable White LED luminaire with, R20 optic, 4000K CCT AND, 90CRI ,  
E3DL1MW TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 415.0 lumens  
Efficiency: N/A  
Efficacy: 70.3 lumens/watt  
Spacing Criteria (0/90/45): 0.44 / 0.44 / 0.46  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct

Input Watts (W): 5.9  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1288142

CATALOG NUMBER: P3A05R20W2N902750DE010 E3DL1MW\_4000K

### Luminous Intensity Polar Plot

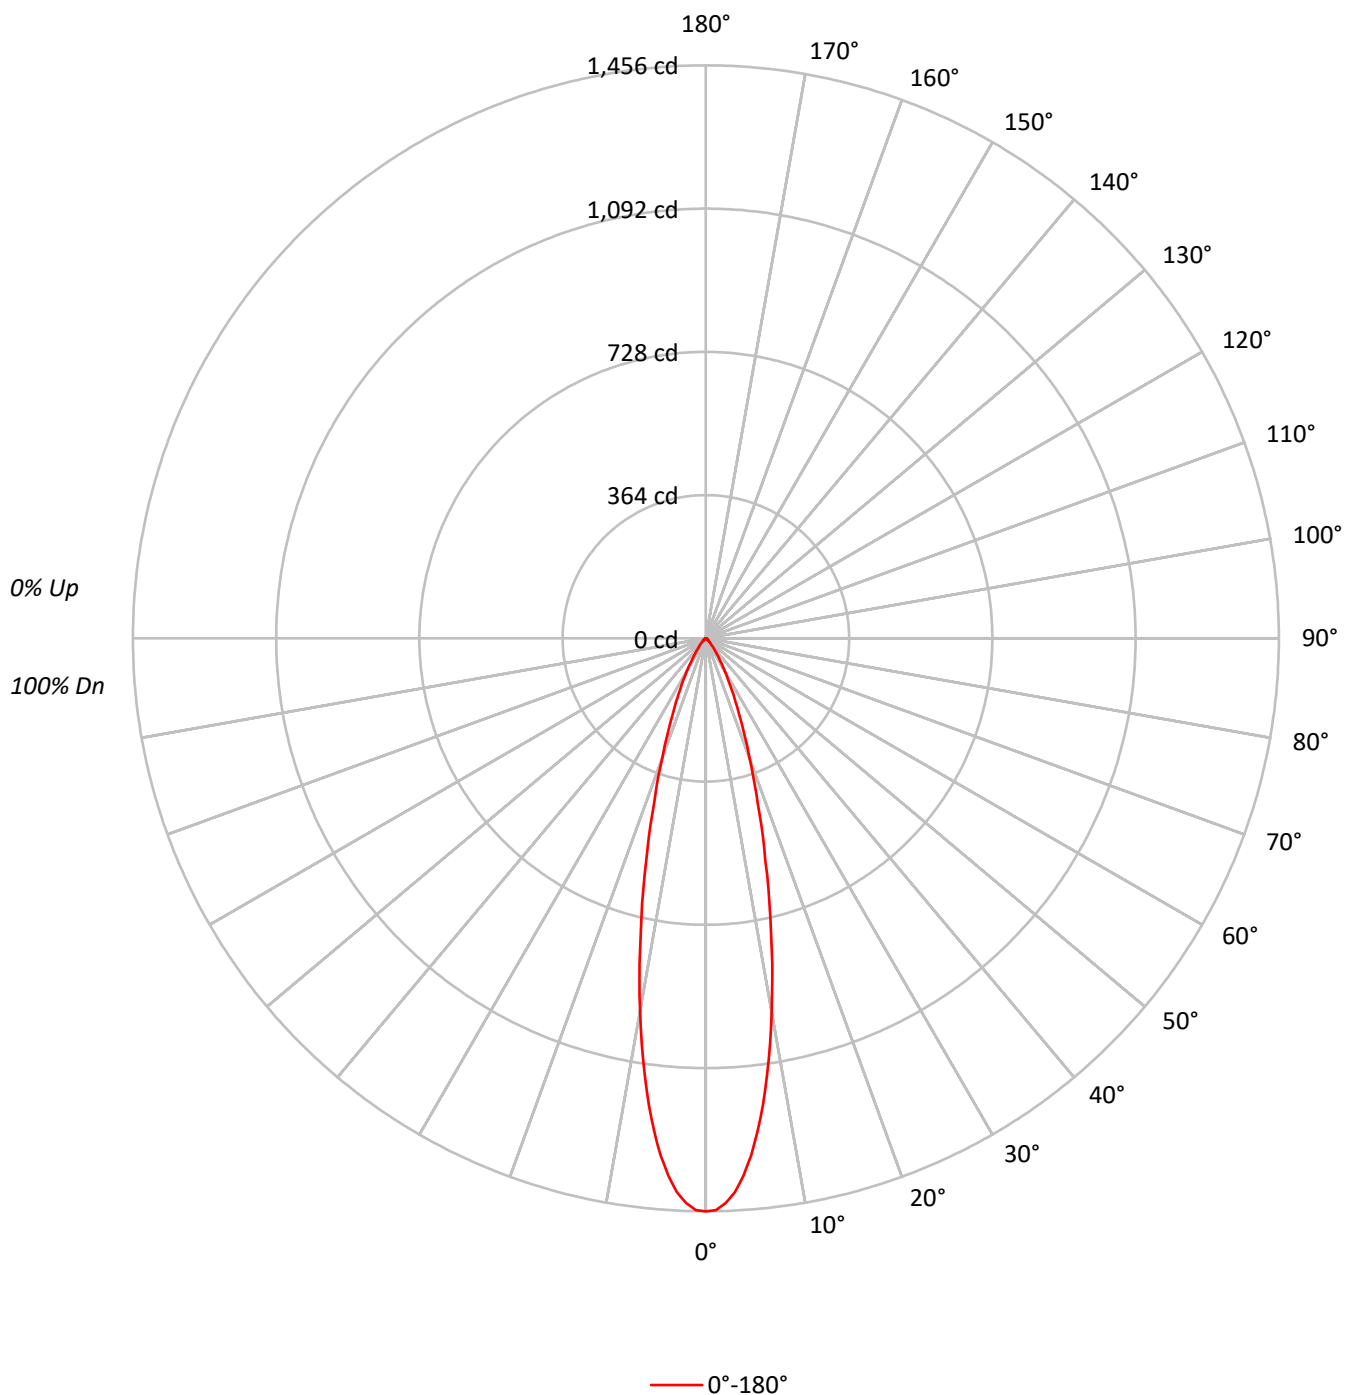

TEST NUMBER: P1288142

CATALOG NUMBER: P3A05R20W2N902750DE010 E3DL1MW\_4000K

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |     |     |  |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|-----|-----|-----|--|-----|-----|-----|--|-----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |  | 20  |     |     |  | 20  |     |     |  | 20  |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |  | 30  |     |     |  | 10  |     |     |  | 0   |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  |  | 50  | 30  | 10  |  | 50  | 30  | 10  |  | 0   |
| RCR |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |     |     |  |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 |  | 106 | 106 | 106 |  | 102 | 102 | 102 |  | 100 |
| 1   | 114 | 112 | 110 | 108 | 112 | 110 | 108 | 106 | 106 | 104 | 103 |  | 102 | 101 | 100 |  | 99  | 98  | 97  |  | 95  |
| 2   | 110 | 106 | 102 | 100 | 108 | 104 | 101 | 98  | 101 | 98  | 96  |  | 98  | 96  | 94  |  | 95  | 94  | 92  |  | 91  |
| 3   | 106 | 100 | 96  | 93  | 104 | 99  | 95  | 92  | 97  | 93  | 91  |  | 94  | 92  | 89  |  | 92  | 90  | 88  |  | 87  |
| 4   | 102 | 96  | 91  | 88  | 100 | 95  | 90  | 87  | 92  | 89  | 86  |  | 91  | 88  | 85  |  | 89  | 86  | 84  |  | 83  |
| 5   | 98  | 91  | 87  | 83  | 97  | 90  | 86  | 83  | 89  | 85  | 82  |  | 87  | 84  | 81  |  | 86  | 83  | 81  |  | 79  |
| 6   | 95  | 87  | 83  | 79  | 93  | 87  | 82  | 79  | 85  | 81  | 78  |  | 84  | 81  | 78  |  | 83  | 80  | 77  |  | 76  |
| 7   | 91  | 84  | 79  | 76  | 90  | 83  | 79  | 76  | 82  | 78  | 75  |  | 81  | 78  | 75  |  | 80  | 77  | 75  |  | 73  |
| 8   | 88  | 81  | 76  | 73  | 87  | 80  | 76  | 73  | 79  | 75  | 72  |  | 78  | 75  | 72  |  | 78  | 74  | 72  |  | 71  |
| 9   | 85  | 78  | 73  | 70  | 85  | 77  | 73  | 70  | 77  | 73  | 70  |  | 76  | 72  | 69  |  | 75  | 72  | 69  |  | 68  |
| 10  | 83  | 75  | 71  | 68  | 82  | 75  | 70  | 67  | 74  | 70  | 67  |  | 73  | 70  | 67  |  | 73  | 69  | 67  |  | 66  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |        |
|-----|--------|
|     | 0°     |
| 0°  | 319295 |
| 5°  | 290248 |
| 10° | 214514 |
| 15° | 132691 |
| 20° | 75770  |
| 25° | 43261  |
| 30° | 24257  |
| 35° | 13197  |
| 40° | 7242   |
| 45° | 3969   |
| 50° | 2320   |
| 55° | 1682   |
| 60° | 1579   |
| 65° | 1453   |
| 70° | 1282   |
| 75° | 1356   |
| 80° | 1010   |
| 85° | 1006   |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3969 cd/sqm

TEST NUMBER: P1288142

CATALOG NUMBER: P3A05R20W2N902750DE010 E3DL1MW\_4000K

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 114.2  | 27.5      |
| 10°-20°   | 163.0  | 39.3      |
| 20°-30°   | 85.1   | 20.5      |
| 30°-40°   | 32.9   | 7.9       |
| 40°-50°   | 10.7   | 2.6       |
| 50°-60°   | 4.2    | 1.0       |
| 60°-70°   | 2.8    | 0.7       |
| 70°-80°   | 1.6    | 0.4       |
| 80°-90°   | 0.5    | 0.1       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| <hr/>     |        |           |
| 0°-30°    | 362.3  | 87.3      |
| 0°-40°    | 395.2  | 95.2      |
| 0°-60°    | 410.0  | 98.8      |
| 0°-90°    | 415.0  | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 415.0  | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 1456 |      |
| 5°  | 1319 | 114  |
| 15° | 584  | 163  |
| 25° | 179  | 85   |
| 35° | 49   | 33   |
| 45° | 13   | 11   |
| 55° | 4    | 4    |
| 65° | 3    | 3    |
| 75° | 2    | 2    |
| 85° | 0    | 1    |
| 90° | 0    |      |

TEST NUMBER: P1288142

CATALOG NUMBER: P3A05R20W2N902750DE010 E3DL1MW\_4000K

**CANDELA DISTRIBUTION (FULL):**

| 0°    |        |
|-------|--------|
| 0°    | 1456.1 |
| 1°    | 1453.3 |
| 2°    | 1436.1 |
| 3°    | 1409.6 |
| 4°    | 1368.7 |
| 5°    | 1318.6 |
| 6°    | 1259.3 |
| 7°    | 1193.5 |
| 8°    | 1117.3 |
| 9°    | 1043.2 |
| 10°   | 963.4  |
| 12.5° | 765.7  |
| 15°   | 584.5  |
| 17.5° | 437.4  |
| 20°   | 324.7  |
| 22.5° | 240.5  |
| 25°   | 178.8  |
| 27.5° | 131.9  |
| 30°   | 95.8   |
| 32.5° | 69.4   |
| 35°   | 49.3   |
| 37.5° | 35.7   |
| 40°   | 25.3   |
| 42.5° | 18.0   |
| 45°   | 12.8   |
| 47.5° | 9.2    |
| 50°   | 6.8    |
| 52.5° | 5.2    |
| 55°   | 4.4    |
| 57.5° | 4.0    |
| 60°   | 3.6    |
| 62.5° | 3.2    |
| 65°   | 2.8    |
| 67.5° | 2.4    |
| 70°   | 2.0    |
| 72.5° | 2.0    |
| 75°   | 1.6    |
| 77.5° | 1.2    |
| 80°   | 0.8    |
| 82.5° | 0.8    |
| 85°   | 0.4    |
| 87.5° | 0.4    |
| 90°   | 0.0    |

(END OF REPORT)