

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1288363

Luminaire Tested: P3A05R25W2N902750DE010 E3CB1MMS\_4000K

Issue Date: 1/30/2026

**Test Information**


Test Method: LM-79-2019  
Report Number: P1288363  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-12)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3A05R25W2N902750DE010 E3CB1MMS\_4000K  
Description: 3in Adjustable Tunable White LED luminaire with, R25 optic, 4000K CCT AND, 90CRI ,  
E3CB1MMS TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 511.0 lumens  
Efficiency: N/A  
Efficacy: 86.6 lumens/watt  
Spacing Criteria (0/90/45): 0.45 / 0.45 / 0.41  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 5.9  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1288363  
CATALOG NUMBER: P3A05R25W2N902750DE010 E3CB1MMS\_4000K

### Luminous Intensity Polar Plot

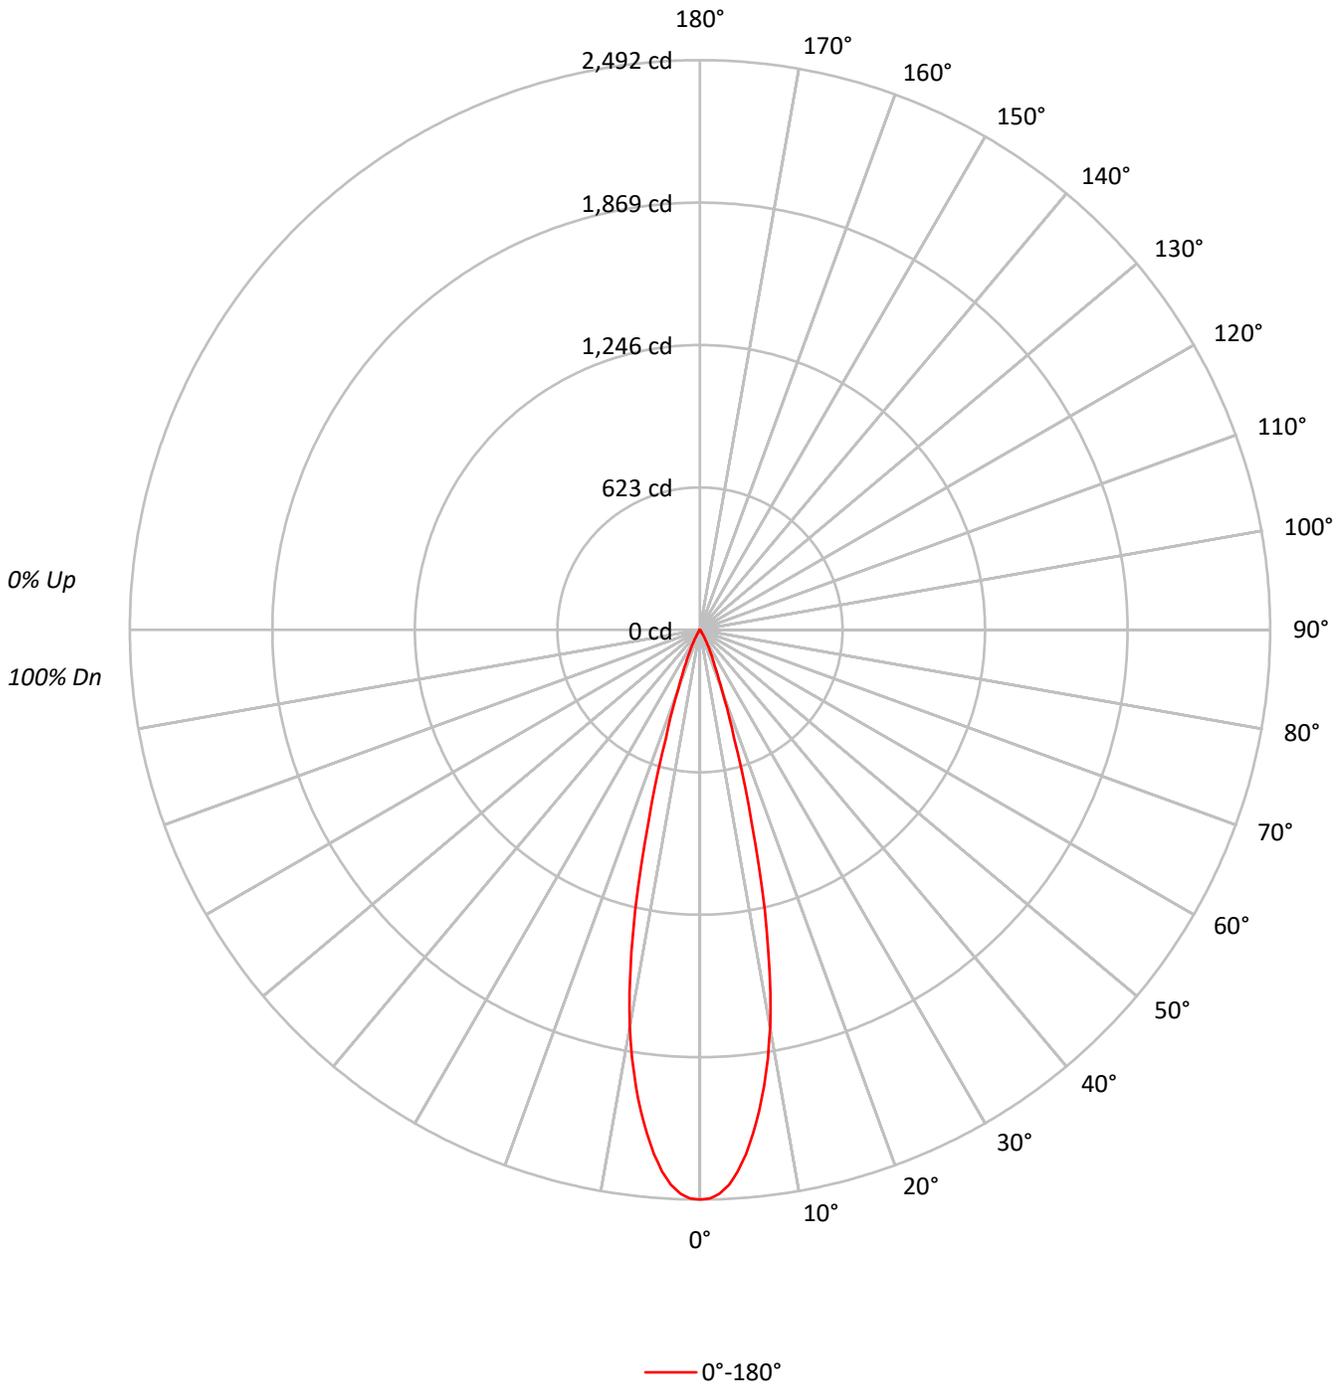



TEST NUMBER: P1288363

CATALOG NUMBER: P3A05R25W2N902750DE010 E3CB1MMS\_4000K

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	115	113	111	110	113	111	109	108	107	106	105	103	103	102	100	99	99	97
2	112	108	105	103	110	107	104	102	104	102	100	101	99	98	98	97	96	94
3	108	104	101	98	107	103	100	97	100	98	96	98	96	94	96	94	93	92
4	105	100	97	94	104	99	96	93	97	95	92	96	93	91	94	92	90	89
5	103	97	93	90	101	96	93	90	95	92	89	93	91	89	92	90	88	87
6	100	94	90	87	99	93	90	87	92	89	87	91	88	86	90	87	86	85
7	97	91	88	85	96	91	87	85	90	87	84	89	86	84	88	85	83	83
8	95	89	85	83	94	89	85	82	88	84	82	87	84	82	86	83	81	81
9	93	87	83	80	92	86	83	80	86	82	80	85	82	80	84	82	80	79
10	91	85	81	78	90	84	81	78	84	80	78	83	80	78	82	80	78	77

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	546338
5°	506712
10°	392956
15°	197050
20°	64732
25°	25743
30°	9647
35°	2784
40°	1260
45°	496
50°	409
55°	306
60°	351
65°	415
70°	256
75°	339
80°	505
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 80°  
 Luminance: 505 cd/sqm



TEST NUMBER: P1288363

CATALOG NUMBER: P3A05R25W2N902750DE010 E3CB1MMS\_4000K

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	202.5	39.6
10°-20°	241.6	47.3
20°-30°	54.5	10.7
30°-40°	8.8	1.7
40°-50°	1.6	0.3
50°-60°	0.8	0.2
60°-70°	0.7	0.1
70°-80°	0.4	0.1
80°-90°	0.1	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	498.5	97.6
0°-40°	507.3	99.3
0°-60°	509.7	99.8
0°-90°	511.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	511.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2492	
5°	2302	202
15°	868	242
25°	106	54
35°	10	9
45°	2	2
55°	1	1
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P1288363

CATALOG NUMBER: P3A05R25W2N902750DE010 E3CB1MMS\_4000K


**CANDELA DISTRIBUTION (FULL):**

0°	
0°	2491.5
1°	2487.5
2°	2467.4
3°	2430.5
4°	2374.7
5°	2302.0
6°	2215.3
7°	2121.3
8°	2013.7
9°	1896.1
10°	1764.8
11°	1613.5
12°	1439.2
13°	1257.0
14°	1061.5
15°	868.0
17.5°	494.6
20°	277.4
22.5°	167.4
25°	106.4
27.5°	65.4
30°	38.1
32.5°	20.1
35°	10.4
37.5°	6.8
40°	4.4
42.5°	2.8
45°	1.6
47.5°	1.2
50°	1.2
52.5°	1.2
55°	0.8
57.5°	0.8
60°	0.8
62.5°	0.8
65°	0.8
67.5°	0.8
70°	0.4
72.5°	0.4
75°	0.4
77.5°	0.4
80°	0.4
82.5°	0.0
85°	0.0
87.5°	0.0



TEST NUMBER: P1288363  
CATALOG NUMBER: P3A05R25W2N902750DE010 E3CB1MMS\_4000K

CANDELA DISTRIBUTION (continued):



(END OF REPORT)