

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1289597

Luminaire Tested: P3A05R40W2N902765DE010 E3DL1MW\_3000K

Issue Date: 1/30/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1289597  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-23)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3A05R40W2N902765DE010 E3DL1MW\_3000K  
Description: 3in Adjustable Tunable White LED luminaire with, R40 optic, 3000K CCT AND, 90CRI ,  
E3DL1MW TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 461.0 lumens  
Efficiency: N/A  
Efficacy: 78.1 lumens/watt  
Spacing Criteria (0/90/45): 0.65 / 0.65 / 0.63  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct

Input Watts (W): 5.9  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1289597

CATALOG NUMBER: P3A05R40W2N902765DE010 E3DL1MW\_3000K

### Luminous Intensity Polar Plot

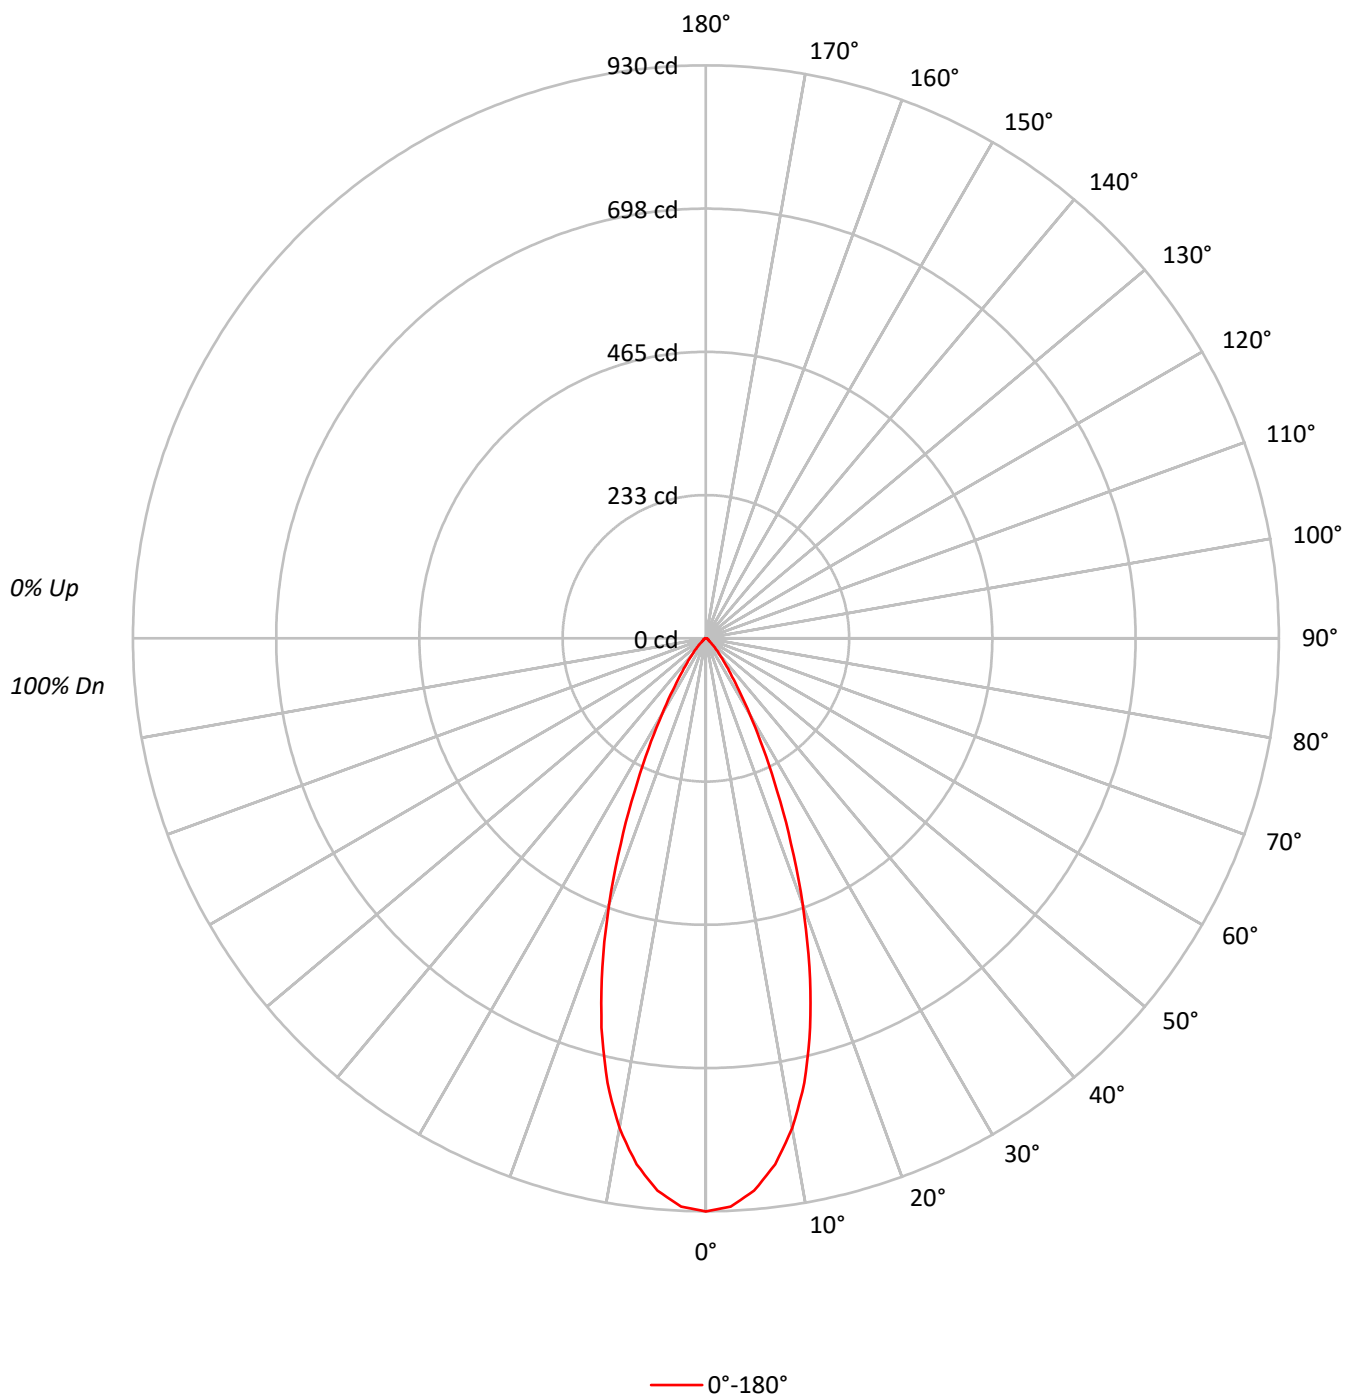



TEST NUMBER: P1289597

CATALOG NUMBER: P3A05R40W2N902765DE010 E3DL1MW\_3000K

### COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

|     |     |     |     |     |  |     |     |     |     |  |     |     |     |  |     |     |     |  |     |     |     |  |     |  |  |   |
|-----|-----|-----|-----|-----|--|-----|-----|-----|-----|--|-----|-----|-----|--|-----|-----|-----|--|-----|-----|-----|--|-----|--|--|---|
| RF  | 20  |     |     |     |  | 20  |     |     |     |  | 20  |     |     |  |     | 20  |     |  |     |     | 20  |  |     |  |  |   |
| RC  | 80  |     |     |     |  | 70  |     |     |     |  | 50  |     |     |  |     | 30  |     |  |     |     | 10  |  |     |  |  | 0 |
| RW  | 70  | 50  | 30  | 10  |  | 70  | 50  | 30  | 10  |  | 50  | 30  | 10  |  | 50  | 30  | 10  |  | 50  | 30  | 10  |  | 0   |  |  |   |
| RCR |     |     |     |     |  |     |     |     |     |  |     |     |     |  |     |     |     |  |     |     |     |  |     |  |  |   |
| 0   | 119 | 119 | 119 | 119 |  | 116 | 116 | 116 | 116 |  | 111 | 111 | 111 |  | 106 | 106 | 106 |  | 102 | 102 | 102 |  | 100 |  |  |   |
| 1   | 114 | 111 | 109 | 107 |  | 112 | 109 | 107 | 105 |  | 105 | 104 | 102 |  | 102 | 100 | 99  |  | 98  | 97  | 96  |  | 94  |  |  |   |
| 2   | 109 | 105 | 101 | 98  |  | 107 | 103 | 100 | 97  |  | 100 | 97  | 95  |  | 97  | 95  | 93  |  | 94  | 92  | 91  |  | 89  |  |  |   |
| 3   | 104 | 99  | 94  | 91  |  | 102 | 97  | 93  | 90  |  | 95  | 91  | 88  |  | 92  | 89  | 87  |  | 90  | 88  | 86  |  | 84  |  |  |   |
| 4   | 100 | 93  | 88  | 85  |  | 98  | 92  | 88  | 84  |  | 90  | 86  | 83  |  | 88  | 85  | 82  |  | 86  | 84  | 81  |  | 80  |  |  |   |
| 5   | 96  | 88  | 83  | 79  |  | 94  | 87  | 83  | 79  |  | 86  | 82  | 78  |  | 84  | 81  | 78  |  | 83  | 80  | 77  |  | 76  |  |  |   |
| 6   | 92  | 84  | 79  | 75  |  | 91  | 83  | 78  | 75  |  | 82  | 77  | 74  |  | 81  | 77  | 74  |  | 79  | 76  | 73  |  | 72  |  |  |   |
| 7   | 88  | 80  | 75  | 71  |  | 87  | 79  | 74  | 71  |  | 78  | 74  | 71  |  | 77  | 73  | 70  |  | 76  | 73  | 70  |  | 69  |  |  |   |
| 8   | 85  | 76  | 71  | 68  |  | 84  | 76  | 71  | 67  |  | 75  | 70  | 67  |  | 74  | 70  | 67  |  | 73  | 69  | 67  |  | 65  |  |  |   |
| 9   | 82  | 73  | 68  | 64  |  | 81  | 73  | 68  | 64  |  | 72  | 67  | 64  |  | 71  | 67  | 64  |  | 70  | 66  | 64  |  | 63  |  |  |   |
| 10  | 78  | 70  | 65  | 62  |  | 78  | 70  | 65  | 61  |  | 69  | 64  | 61  |  | 68  | 64  | 61  |  | 67  | 64  | 61  |  | 60  |  |  |   |

**AVERAGE LUMINANCE (cd/sqm):**

|     | 0°     |
|-----|--------|
| 0°  | 203997 |
| 5°  | 198062 |
| 10° | 179734 |
| 15° | 148491 |
| 20° | 107109 |
| 25° | 66246  |
| 30° | 35879  |
| 35° | 18524  |
| 40° | 10076  |
| 45° | 5644   |
| 50° | 2831   |
| 55° | 2103   |
| 60° | 1930   |
| 65° | 1868   |
| 70° | 1795   |
| 75° | 1694   |
| 80° | 1515   |
| 85° | 1006   |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°

Vertical Angle:  $45^\circ$

Luminance: 5644 cd/sqm

TEST NUMBER: P1289597

CATALOG NUMBER: P3A05R40W2N902765DE010 E3DL1MW\_3000K

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 82.9   | 18.0      |
| 10°-20°   | 178.1  | 38.6      |
| 20°-30°   | 127.1  | 27.6      |
| 30°-40°   | 46.8   | 10.1      |
| 40°-50°   | 14.7   | 3.2       |
| 50°-60°   | 5.1    | 1.1       |
| 60°-70°   | 3.6    | 0.8       |
| 70°-80°   | 2.1    | 0.5       |
| 80°-90°   | 0.6    | 0.1       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| <hr/>     |        |           |
| 0°-30°    | 388.2  | 84.2      |
| 0°-40°    | 434.9  | 94.3      |
| 0°-60°    | 454.8  | 98.6      |
| 0°-90°    | 461.0  | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 461.0  | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°  | Flux |
|-----|-----|------|
| 0°  | 930 |      |
| 5°  | 900 | 83   |
| 15° | 654 | 178  |
| 25° | 274 | 127  |
| 35° | 69  | 47   |
| 45° | 18  | 15   |
| 55° | 6   | 5    |
| 65° | 4   | 4    |
| 75° | 2   | 2    |
| 85° | 0   | 1    |
| 90° | 0   |      |



TEST NUMBER: P1289597

CATALOG NUMBER: P3A05R40W2N902765DE010 E3DL1MW\_3000K

**CANDELA DISTRIBUTION (FULL):**

| 0°    |       |
|-------|-------|
| 0°    | 930.3 |
| 2.5°  | 923.1 |
| 5°    | 899.8 |
| 7.5°  | 861.0 |
| 10°   | 807.2 |
| 12.5° | 738.8 |
| 15°   | 654.1 |
| 17.5° | 559.1 |
| 20°   | 459.0 |
| 22.5° | 360.5 |
| 25°   | 273.8 |
| 27.5° | 201.0 |
| 30°   | 141.7 |
| 32.5° | 99.3  |
| 35°   | 69.2  |
| 37.5° | 49.1  |
| 40°   | 35.2  |
| 42.5° | 25.3  |
| 45°   | 18.2  |
| 47.5° | 12.3  |
| 50°   | 8.3   |
| 52.5° | 5.9   |
| 55°   | 5.5   |
| 57.5° | 5.1   |
| 60°   | 4.4   |
| 62.5° | 4.0   |
| 65°   | 3.6   |
| 67.5° | 3.2   |
| 70°   | 2.8   |
| 72.5° | 2.4   |
| 75°   | 2.0   |
| 77.5° | 1.6   |
| 80°   | 1.2   |
| 82.5° | 0.8   |
| 85°   | 0.4   |
| 87.5° | 0.4   |
| 90°   | 0.0   |

(END OF REPORT)