

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1291757

Luminaire Tested: P3A09R15W2N902765DE010 E3DL1MW\_3000K

Issue Date: 1/30/2026

**Test Information**

Test Method: LM-79-2019  
Report Number: P1291757  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-3)  
Test Lab: INNOVATION CENTER  
Issue Date: 1/30/2026  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: IRiS  
Catalog Number: P3A09R15W2N902765DE010 E3DL1MW\_3000K  
Description: 3in Adjustable Tunable White LED luminaire with, R15 optic, 3000K CCT AND, 90CRI ,  
E3DL1MW TRIM  
Light Source: -  
Ballast/Driver: -

**Summary**


Lumens per Lamp: N/A  
Luminaire Lumens: 605.0 lumens  
Efficiency: N/A  
Efficacy: 67.2 lumens/watt  
Spacing Criteria (0/90/45): 0.4 / 0.4 / 0.43  
Luminous Opening: Circular (Dia: 0.25' x H: 0')  
CIE Type: Direct

Input Watts (W): 9  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P1291757

CATALOG NUMBER: P3A09R15W2N902765DE010 E3DL1MW\_3000K

### Luminous Intensity Polar Plot

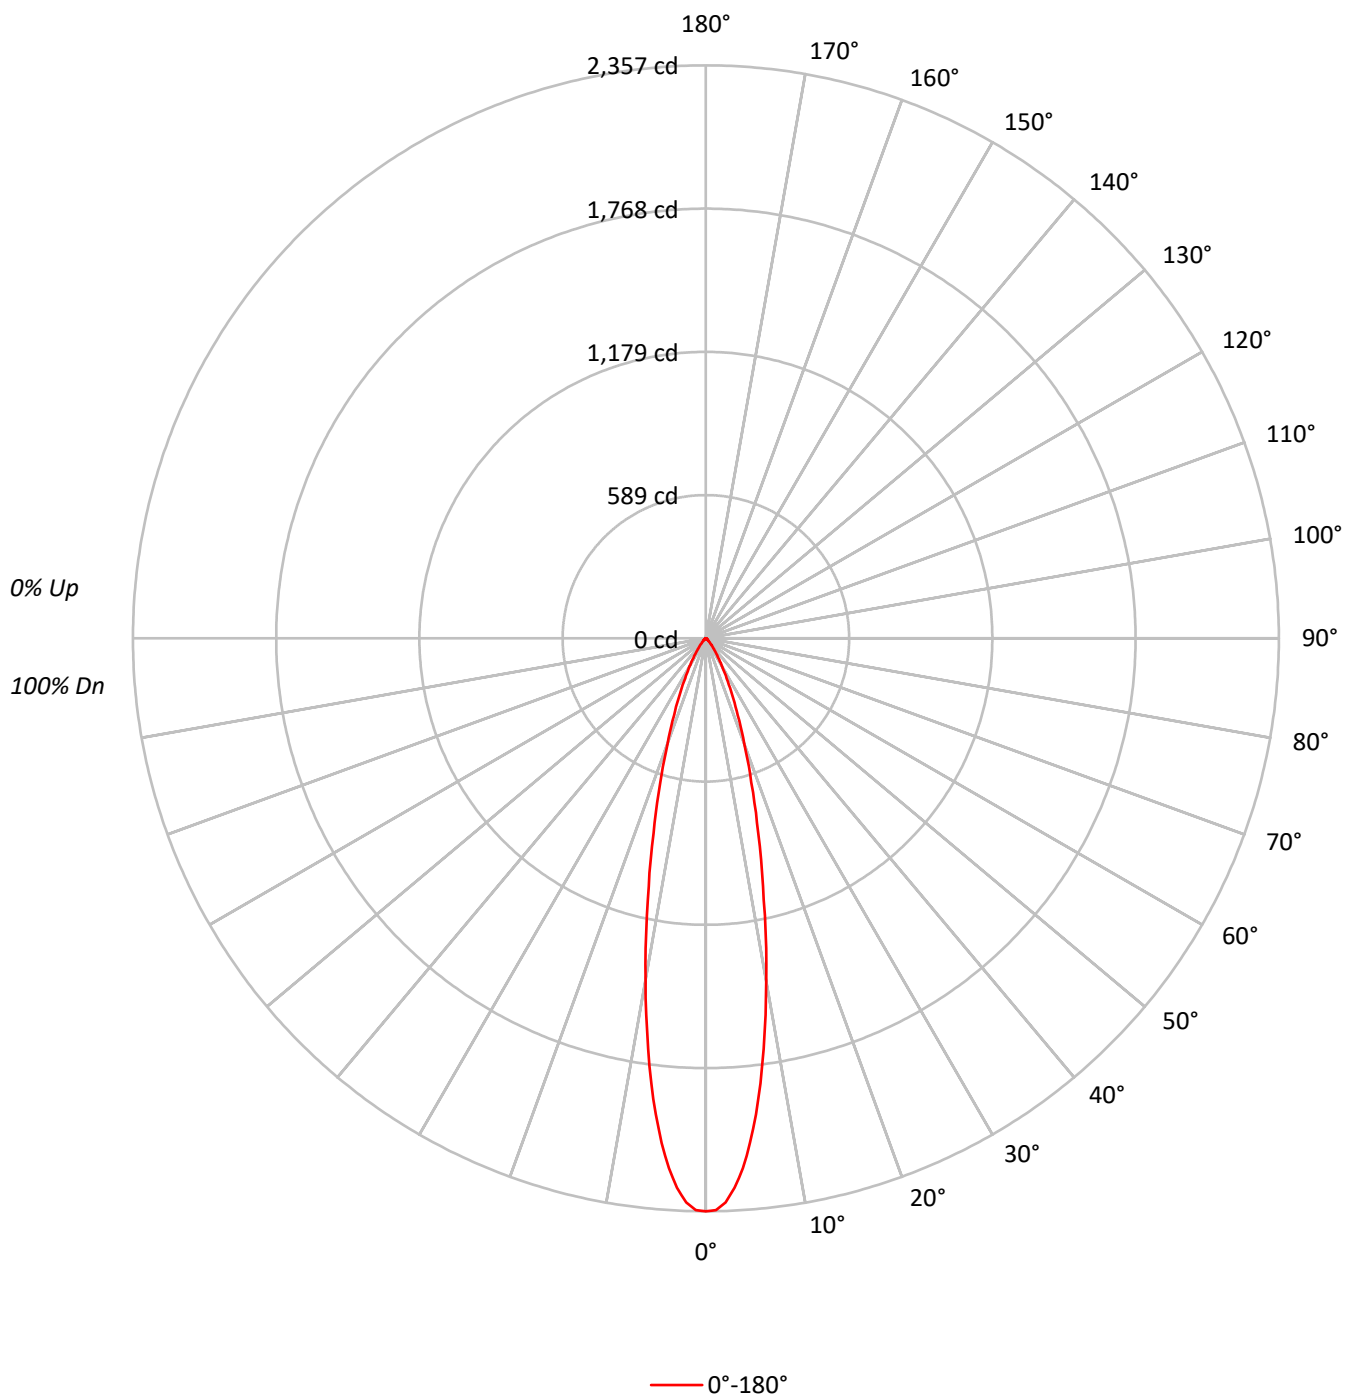

TEST NUMBER: P1291757

CATALOG NUMBER: P3A09R15W2N902765DE010 E3DL1MW\_3000K

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

|     |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |     |     |  |     |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|-----|-----|-----|--|-----|-----|-----|--|-----|
| RF  | 20  |     |     |     | 20  |     |     |     | 20  |     |     |  | 20  |     |     |  | 20  |     |     |  | 20  |
| RC  | 80  |     |     |     | 70  |     |     |     | 50  |     |     |  | 30  |     |     |  | 10  |     |     |  | 0   |
| RW  | 70  | 50  | 30  | 10  | 70  | 50  | 30  | 10  | 50  | 30  | 10  |  | 50  | 30  | 10  |  | 50  | 30  | 10  |  | 0   |
| RCR |     |     |     |     |     |     |     |     |     |     |     |  |     |     |     |  |     |     |     |  |     |
| 0   | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 |  | 106 | 106 | 106 |  | 102 | 102 | 102 |  | 100 |
| 1   | 114 | 112 | 110 | 108 | 112 | 110 | 108 | 106 | 106 | 104 | 103 |  | 102 | 101 | 100 |  | 99  | 98  | 97  |  | 95  |
| 2   | 110 | 106 | 103 | 100 | 108 | 104 | 101 | 99  | 101 | 99  | 97  |  | 98  | 96  | 95  |  | 96  | 94  | 93  |  | 91  |
| 3   | 106 | 101 | 97  | 93  | 104 | 99  | 96  | 93  | 97  | 94  | 91  |  | 94  | 92  | 90  |  | 92  | 90  | 88  |  | 87  |
| 4   | 102 | 96  | 92  | 88  | 100 | 95  | 91  | 88  | 93  | 89  | 87  |  | 91  | 88  | 86  |  | 89  | 87  | 85  |  | 83  |
| 5   | 98  | 92  | 87  | 84  | 97  | 91  | 87  | 83  | 89  | 85  | 83  |  | 88  | 84  | 82  |  | 86  | 83  | 81  |  | 80  |
| 6   | 95  | 88  | 83  | 80  | 94  | 87  | 83  | 80  | 86  | 82  | 79  |  | 85  | 81  | 79  |  | 83  | 80  | 78  |  | 77  |
| 7   | 92  | 85  | 80  | 77  | 91  | 84  | 80  | 76  | 83  | 79  | 76  |  | 82  | 78  | 76  |  | 81  | 78  | 75  |  | 74  |
| 8   | 89  | 81  | 77  | 74  | 88  | 81  | 77  | 73  | 80  | 76  | 73  |  | 79  | 75  | 73  |  | 78  | 75  | 73  |  | 72  |
| 9   | 86  | 79  | 74  | 71  | 85  | 78  | 74  | 71  | 77  | 73  | 71  |  | 77  | 73  | 70  |  | 76  | 73  | 70  |  | 69  |
| 10  | 84  | 76  | 71  | 68  | 83  | 76  | 71  | 68  | 75  | 71  | 68  |  | 74  | 71  | 68  |  | 74  | 70  | 68  |  | 67  |

**AVERAGE LUMINANCE (cd/sqm):**

|     |        |
|-----|--------|
|     | 0°     |
| 0°  | 516823 |
| 5°  | 458771 |
| 10° | 318587 |
| 15° | 188401 |
| 20° | 107296 |
| 25° | 61334  |
| 30° | 33929  |
| 35° | 18096  |
| 40° | 10019  |
| 45° | 5427   |
| 50° | 3377   |
| 55° | 2676   |
| 60° | 2281   |
| 65° | 2127   |
| 70° | 1859   |
| 75° | 1949   |
| 80° | 1515   |
| 85° | 1510   |

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
Vertical Angle: 45°  
Luminance: 5427 cd/sqm

TEST NUMBER: P1291757

CATALOG NUMBER: P3A09R15W2N902765DE010 E3DL1MW\_3000K

**ZONAL LUMENS:**

| Zone      | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10°    | 177.2  | 29.3      |
| 10°-20°   | 233.9  | 38.7      |
| 20°-30°   | 120.4  | 19.9      |
| 30°-40°   | 45.2   | 7.5       |
| 40°-50°   | 14.8   | 2.4       |
| 50°-60°   | 6.4    | 1.1       |
| 60°-70°   | 4.0    | 0.7       |
| 70°-80°   | 2.4    | 0.4       |
| 80°-90°   | 0.7    | 0.1       |
| 90°-100°  | 0.0    | 0.0       |
| 100°-110° | 0.0    | 0.0       |
| 110°-120° | 0.0    | 0.0       |
| 120°-130° | 0.0    | 0.0       |
| 130°-140° | 0.0    | 0.0       |
| 140°-150° | 0.0    | 0.0       |
| 150°-160° | 0.0    | 0.0       |
| 160°-170° | 0.0    | 0.0       |
| 170°-180° | 0.0    | 0.0       |
| <hr/>     |        |           |
| 0°-30°    | 531.6  | 87.9      |
| 0°-40°    | 576.8  | 95.3      |
| 0°-60°    | 597.9  | 98.8      |
| 0°-90°    | 605.0  | 100.0     |
| 90°-120°  | 0.0    | 0.0       |
| 90°-150°  | 0.0    | 0.0       |
| 90°-180°  | 0.0    | 0.0       |
| 0°-180°   | 605.0  | 100.0     |

**CANDELA DISTRIBUTION:**

|     | 0°   | Flux |
|-----|------|------|
| 0°  | 2357 |      |
| 5°  | 2084 | 177  |
| 15° | 830  | 234  |
| 25° | 254  | 120  |
| 35° | 68   | 45   |
| 45° | 18   | 15   |
| 55° | 7    | 6    |
| 65° | 4    | 4    |
| 75° | 2    | 2    |
| 85° | 1    | 1    |
| 90° | 0    |      |

TEST NUMBER: P1291757

CATALOG NUMBER: P3A09R15W2N902765DE010 E3DL1MW\_3000K

**CANDELA DISTRIBUTION (FULL):**

| 0°    |        |
|-------|--------|
| 0°    | 2356.9 |
| 1°    | 2352.3 |
| 2°    | 2321.4 |
| 3°    | 2262.5 |
| 4°    | 2185.0 |
| 5°    | 2084.2 |
| 6°    | 1969.9 |
| 7°    | 1844.6 |
| 8°    | 1705.3 |
| 9°    | 1567.8 |
| 10°   | 1430.8 |
| 12.5° | 1100.9 |
| 15°   | 829.9  |
| 17.5° | 621.3  |
| 20°   | 459.8  |
| 22.5° | 343.3  |
| 25°   | 253.5  |
| 27.5° | 184.8  |
| 30°   | 134.0  |
| 32.5° | 95.0   |
| 35°   | 67.6   |
| 37.5° | 48.4   |
| 40°   | 35.0   |
| 42.5° | 25.1   |
| 45°   | 17.5   |
| 47.5° | 12.8   |
| 50°   | 9.9    |
| 52.5° | 8.2    |
| 55°   | 7.0    |
| 57.5° | 5.8    |
| 60°   | 5.2    |
| 62.5° | 4.7    |
| 65°   | 4.1    |
| 67.5° | 3.5    |
| 70°   | 2.9    |
| 72.5° | 2.9    |
| 75°   | 2.3    |
| 77.5° | 1.7    |
| 80°   | 1.2    |
| 82.5° | 1.2    |
| 85°   | 0.6    |
| 87.5° | 0.0    |
| 90°   | 0.0    |

(END OF REPORT)