

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1294136

Luminaire Tested: P3A09R55W2N902750DE010 E3DL1H_3000K

Issue Date: 1/30/2026

Test Information

Test Method: LM-79-2019
Report Number: P1294136
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2601-647-35)
Test Lab: INNOVATION CENTER
Issue Date: 1/30/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: IRiS
Catalog Number: P3A09R55W2N902750DE010 E3DL1H_3000K
Description: 3in Adjustable Tunable White LED luminaire with, R55 optic, 3000K CCT AND, 90CRI ,
E3DL1H TRIM
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 635.0 lumens
Efficiency: N/A
Efficacy: 70.6 lumens/watt
Spacing Criteria (0/90/45): 0.83 / 0.83 / 0.81
Luminous Opening: Circular (Dia: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1294136

CATALOG NUMBER: P3A09R55W2N902750DE010 E3DL1H_3000K

Luminous Intensity Polar Plot

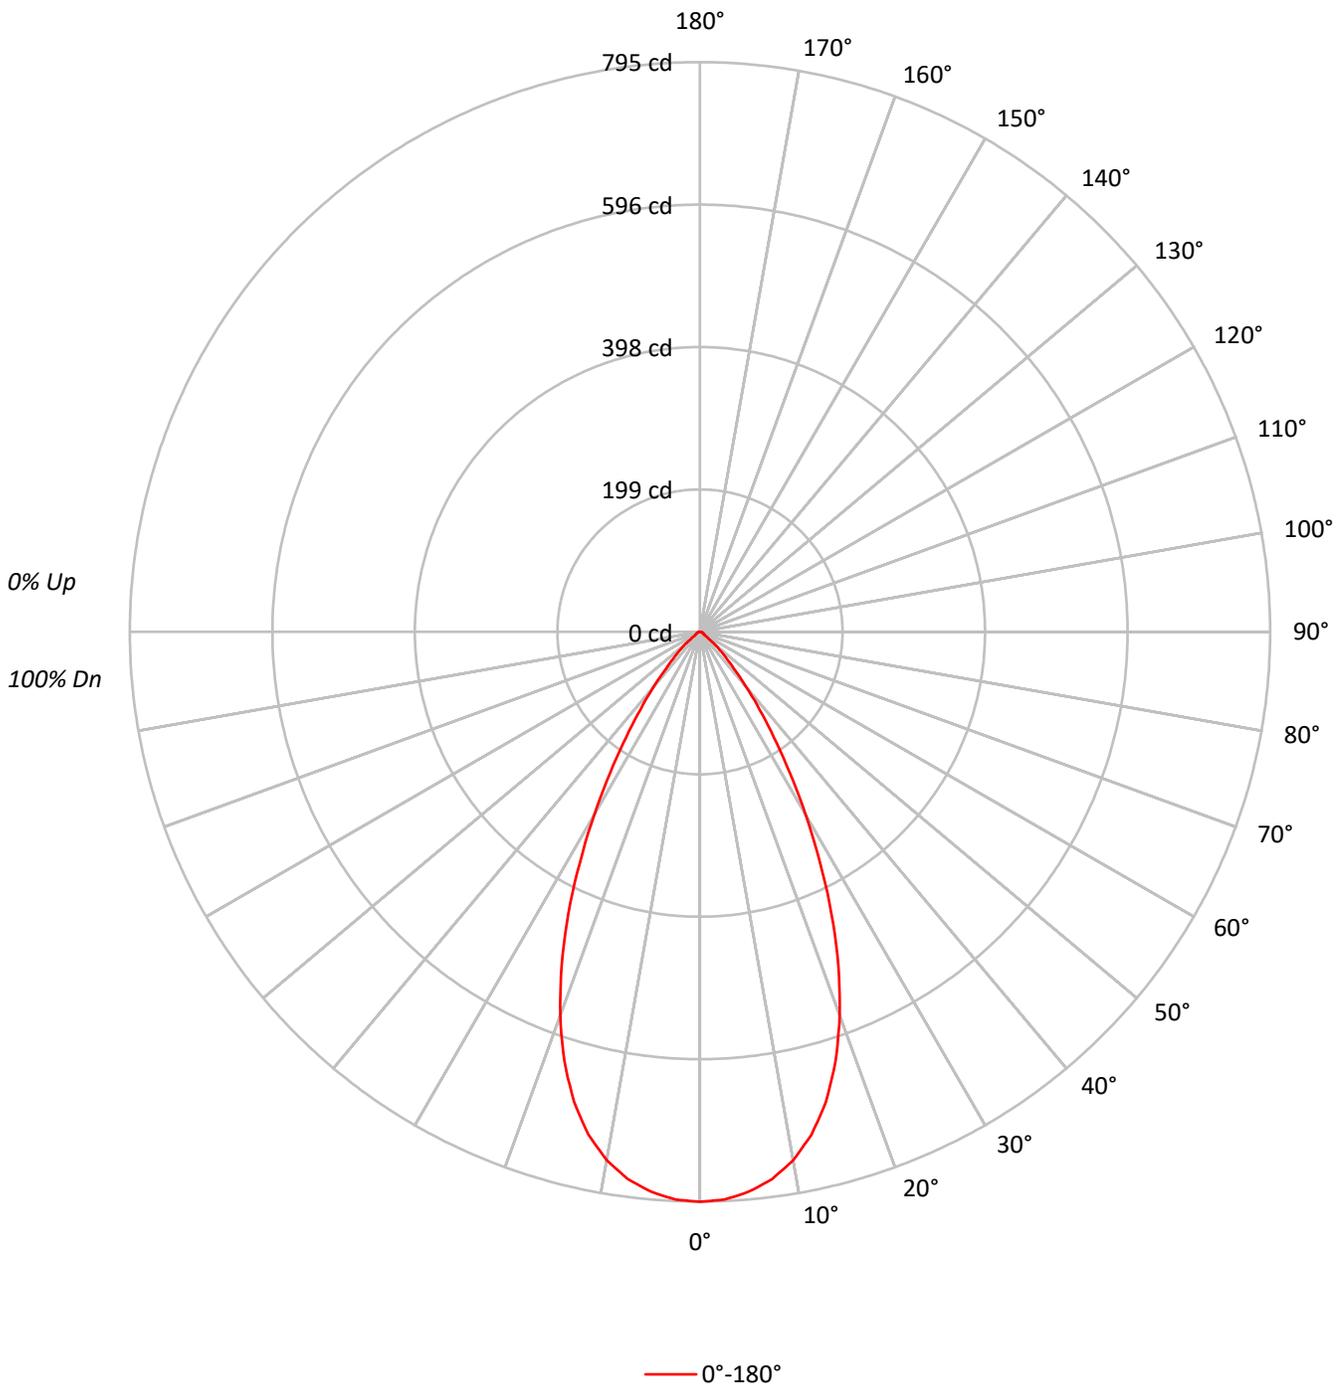



TEST NUMBER: P1294136

CATALOG NUMBER: P3A09R55W2N902750DE010 E3DL1H_3000K

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 73.7 | 11.6 |
| 10°-20° | 187.7 | 29.6 |
| 20°-30° | 196.7 | 31.0 |
| 30°-40° | 114.7 | 18.1 |
| 40°-50° | 42.9 | 6.8 |
| 50°-60° | 10.1 | 1.6 |
| 60°-70° | 5.2 | 0.8 |
| 70°-80° | 3.1 | 0.5 |
| 80°-90° | 0.9 | 0.1 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 458.1 | 72.1 |
| 0°-40° | 572.8 | 90.2 |
| 0°-60° | 625.9 | 98.6 |
| 0°-90° | 635.0 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 635.0 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|-----|------|
| 0° | 795 | |
| 5° | 784 | 74 |
| 15° | 679 | 188 |
| 25° | 434 | 197 |
| 35° | 179 | 115 |
| 45° | 52 | 43 |
| 55° | 8 | 10 |
| 65° | 5 | 5 |
| 75° | 3 | 3 |
| 85° | 1 | 1 |
| 90° | 0 | |



TEST NUMBER: P1294136

CATALOG NUMBER: P3A09R55W2N902750DE010 E3DL1H_3000K

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|-------|
| 0° | 795.2 |
| 2.5° | 792.8 |
| 5° | 784.1 |
| 7.5° | 770.1 |
| 10° | 748.6 |
| 12.5° | 718.3 |
| 15° | 678.7 |
| 17.5° | 628.6 |
| 20° | 569.7 |
| 22.5° | 503.9 |
| 25° | 434.0 |
| 27.5° | 362.3 |
| 30° | 294.2 |
| 32.5° | 232.4 |
| 35° | 179.4 |
| 37.5° | 136.3 |
| 40° | 100.8 |
| 42.5° | 72.2 |
| 45° | 52.4 |
| 47.5° | 37.9 |
| 50° | 25.6 |
| 52.5° | 14.6 |
| 55° | 8.2 |
| 57.5° | 7.0 |
| 60° | 6.4 |
| 62.5° | 5.8 |
| 65° | 5.2 |
| 67.5° | 4.7 |
| 70° | 4.1 |
| 72.5° | 3.5 |
| 75° | 2.9 |
| 77.5° | 2.3 |
| 80° | 1.7 |
| 82.5° | 1.2 |
| 85° | 0.6 |
| 87.5° | 0.6 |
| 90° | 0.0 |

(END OF REPORT)