

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1305548

Luminaire Tested: P3SQAS05R159024DE010 E3SQPH1MB

Issue Date: 1/29/2026

Test Information

Test Method: LM-79-2019
Report Number: P1305548
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2510-583-1)
Test Lab: INNOVATION CENTER
Issue Date: 1/29/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: IRiS
Catalog Number: P3SQAS05R159024DE010 E3SQPH1MB
Description: 3in Adjustable LED luminaire with, R15 optic, 2400K CCT AND, 90CRI , E3SQPH1MB TRIM
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 442.0 lumens
Efficiency: N/A
Efficacy: 61.4 lumens/watt
Spacing Criteria (0/90/45): 0.28 / 0.29 / 0.28
Luminous Opening: Rectangular (W 0.25' x L: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 7.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1305548

CATALOG NUMBER: P3SQAS05R159024DE010 E3SQPH1MB

Luminous Intensity Polar Plot

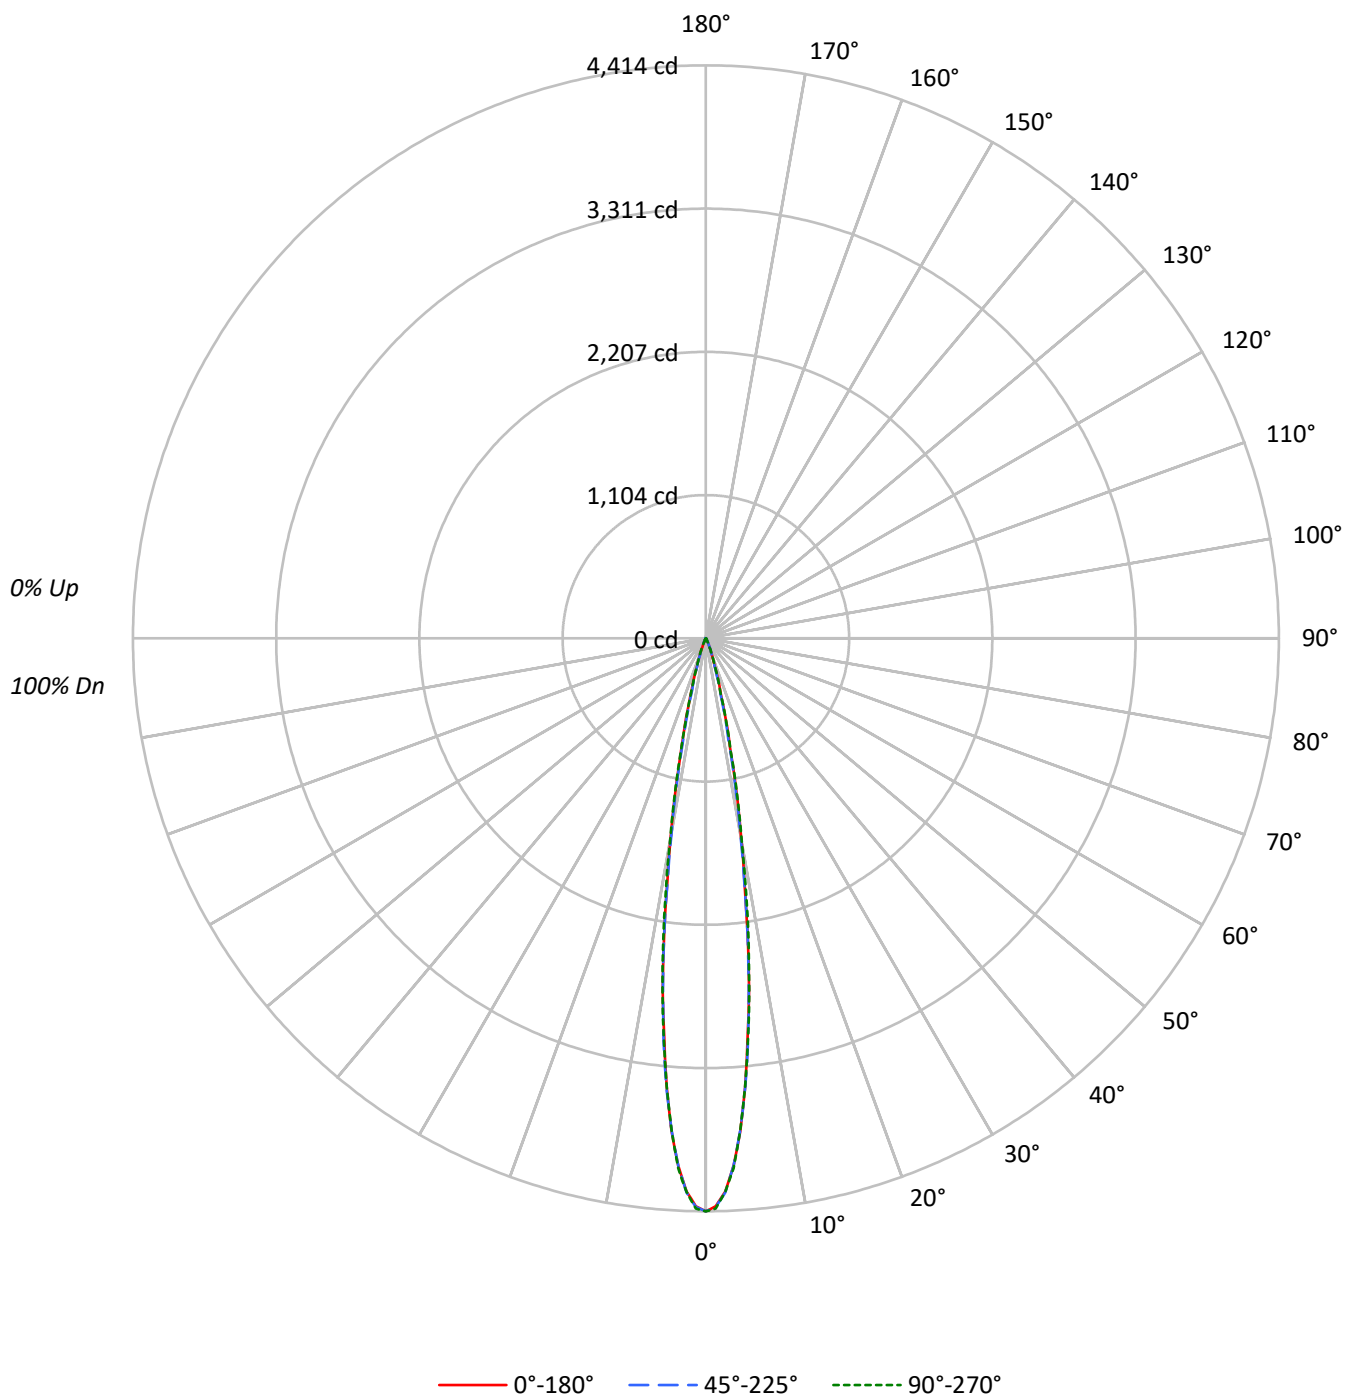

TEST NUMBER: P1305548

CATALOG NUMBER: P3SQAS05R159024DE010 E3SQPH1MB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102
1	116	114	112	111	113	112	110	109	108	107	106		104	104	103		101
2	113	110	107	105	111	108	106	104	105	104	102		102	101	100		100
3	110	107	104	101	109	105	103	100	103	101	99		101	99	97		99
4	108	104	100	98	106	103	100	98	101	98	96		99	97	95		97
5	106	101	98	95	104	100	97	95	99	96	94		97	95	94		96
6	104	99	96	93	103	98	95	93	97	94	92		96	94	92		95
7	102	97	94	91	101	96	93	91	95	93	91		94	92	90		94
8	100	95	92	90	99	95	92	90	94	91	89		93	91	89		92
9	98	93	90	88	98	93	90	88	92	90	88		92	89	88		91
10	97	92	89	87	96	92	89	87	91	88	87		90	88	86		90

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	760225	760225	760225
5°	599671	601278	599135
10°	274351	267163	280157
15°	81571	72817	79913
20°	24229	23496	25439
25°	6879	8912	7981
30°	2466	2645	2367
35°	925	841	841
40°	405	202	292
45°	219	97	219
50°	107	0	107
55°	120	0	120
60°	0	0	0
65°	0	0	0
70°	0	0	0
75°	0	0	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 47.5°

Luminance: 229 cd/sqm

TEST NUMBER: P1305548

CATALOG NUMBER: P3SQAS05R159024DE010 E3SQPH1MB

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	266.7	60.3
10°-20°	148.1	33.5
20°-30°	23.6	5.3
30°-40°	3.1	0.7
40°-50°	0.4	0.1
50°-60°	0.1	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	438.3	99.2
0°-40°	441.4	99.9
0°-60°	442.0	100.0
0°-90°	442.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	442.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4414	4414	4414	4414	4414	
5°	3469	3498	3478	3463	3466	266
15°	458	452	408	434	448	151
25°	36	41	47	47	42	22
35°	4	4	4	4	4	3
45°	1	1	0	0	1	1
55°	0	0	0	0	0	0
65°	0	0	0	0	0	0
75°	0	0	0	0	0	0
85°	0	0	0	0	0	0
90°	0	0	0	0	0	

TEST NUMBER: P1305548

CATALOG NUMBER: P3SQAS05R159024DE010 E3SQPH1MB

CANDELA DISTRIBUTION (FULL):

	0°	5°	15°	25°	35°	45°	55°	65°	75°	85°	90°
0°	4414.2	4414.2	4414.2	4414.2	4414.2	4414.2	4414.2	4414.2	4414.2	4414.2	4414.2
1°	4376.2	4381.1	4387.3	4381.5	4376.2	4381.1	4374.5	4375.3	4370.0	4381.5	4394.3
2°	4264.8	4271.0	4267.5	4259.5	4271.9	4272.8	4259.1	4252.4	4251.6	4263.1	4267.5
3°	4067.7	4081.8	4082.3	4079.6	4075.6	4067.7	4053.5	4062.8	4050.0	4042.0	4087.1
4°	3805.5	3817.9	3832.5	3822.8	3793.6	3796.3	3805.5	3774.2	3775.9	3794.1	3795.4
5°	3468.7	3506.3	3508.0	3494.3	3471.4	3478.0	3471.4	3462.5	3465.6	3477.1	3465.6
6°	3072.2	3114.6	3083.2	3113.3	3106.7	3115.1	3117.3	3108.0	3114.6	3107.6	3105.3
7°	2729.6	2697.3	2701.8	2689.4	2702.6	2711.5	2716.8	2700.9	2713.7	2734.0	2739.8
8°	2304.8	2295.5	2286.2	2308.3	2302.2	2312.8	2319.4	2337.1	2336.2	2342.4	2362.7
9°	1900.3	1914.0	1922.4	1903.0	1919.8	1887.1	1898.6	1945.9	1933.5	1945.9	1982.1
10°	1568.8	1579.9	1567.5	1567.0	1549.4	1527.7	1526.4	1544.1	1581.2	1610.4	1602.0
12.5°	865.5	875.2	876.6	875.7	843.9	808.1	814.7	828.8	851.8	861.5	877.5
15°	457.5	457.1	461.9	448.2	431.4	408.4	410.2	429.7	446.9	451.3	448.2
17.5°	234.7	235.6	239.1	235.6	217.9	220.1	225.0	227.2	237.4	241.4	239.1
20°	132.2	132.6	132.2	133.5	126.4	128.2	134.4	134.8	137.0	139.2	138.8
22.5°	75.6	76.0	78.7	77.8	76.0	78.2	79.6	81.8	82.7	81.8	84.4
25°	36.2	36.7	36.7	42.0	44.6	46.9	47.7	46.9	46.0	42.4	42.0
27.5°	20.8	20.8	21.7	22.1	23.0	27.0	26.5	22.1	18.6	18.6	19.0
30°	12.4	11.9	11.9	12.4	12.8	13.3	12.4	11.9	11.9	12.4	11.9
32.5°	7.5	7.5	7.5	7.1	7.1	6.6	6.6	7.5	7.5	7.5	7.5
35°	4.4	4.4	4.4	4.4	4.0	4.0	4.0	4.4	4.4	4.0	4.0
37.5°	2.7	2.7	2.7	2.2	2.2	1.8	2.2	2.2	2.2	2.2	2.2
40°	1.8	1.8	1.3	1.3	0.9	0.9	0.9	1.3	1.3	1.3	1.3
42.5°	1.3	1.3	0.9	0.9	0.4	0.4	0.4	0.9	0.9	0.9	0.9
45°	0.9	0.9	0.9	0.4	0.4	0.4	0.4	0.4	0.4	0.9	0.9
47.5°	0.9	0.9	0.4	0.4	0.0	0.0	0.0	0.4	0.4	0.4	0.4
50°	0.4	0.4	0.4	0.0	0.0	0.0	0.0	0.0	0.4	0.4	0.4
52.5°	0.4	0.4	0.4	0.0	0.0	0.0	0.0	0.0	0.4	0.4	0.4
55°	0.4	0.4	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.4	0.4
57.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
60°	0.0	0.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
62.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
65°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
67.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
70°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
72.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
75°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)