

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: IRiS

Report Number: P1306137

Luminaire Tested: P3SQAS17R559024DE010 E3SQCD1MMS

Issue Date: 1/29/2026

Test Information

Test Method: LM-79-2019
Report Number: P1306137
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2510-583-28)
Test Lab: INNOVATION CENTER
Issue Date: 1/29/2026
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: IRiS
Catalog Number: P3SQAS17R559024DE010 E3SQCD1MMS
Description: 3in Adjustable LED luminaire with, R55 optic, 2400K CCT AND, 90CRI , E3SQCD1MMS TRIM
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1480.0 lumens
Efficiency: N/A
Efficacy: 69.8 lumens/watt
Spacing Criteria (0/90/45): 0.93 / 0.93 / 0.81
Luminous Opening: Rectangular (W 0.25' x L: 0.25' x H: 0')
CIE Type: Direct

Input Watts (W): 21.2
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P1306137

CATALOG NUMBER: P3SQAS17R559024DE010 E3SQCD1MMS

Luminous Intensity Polar Plot

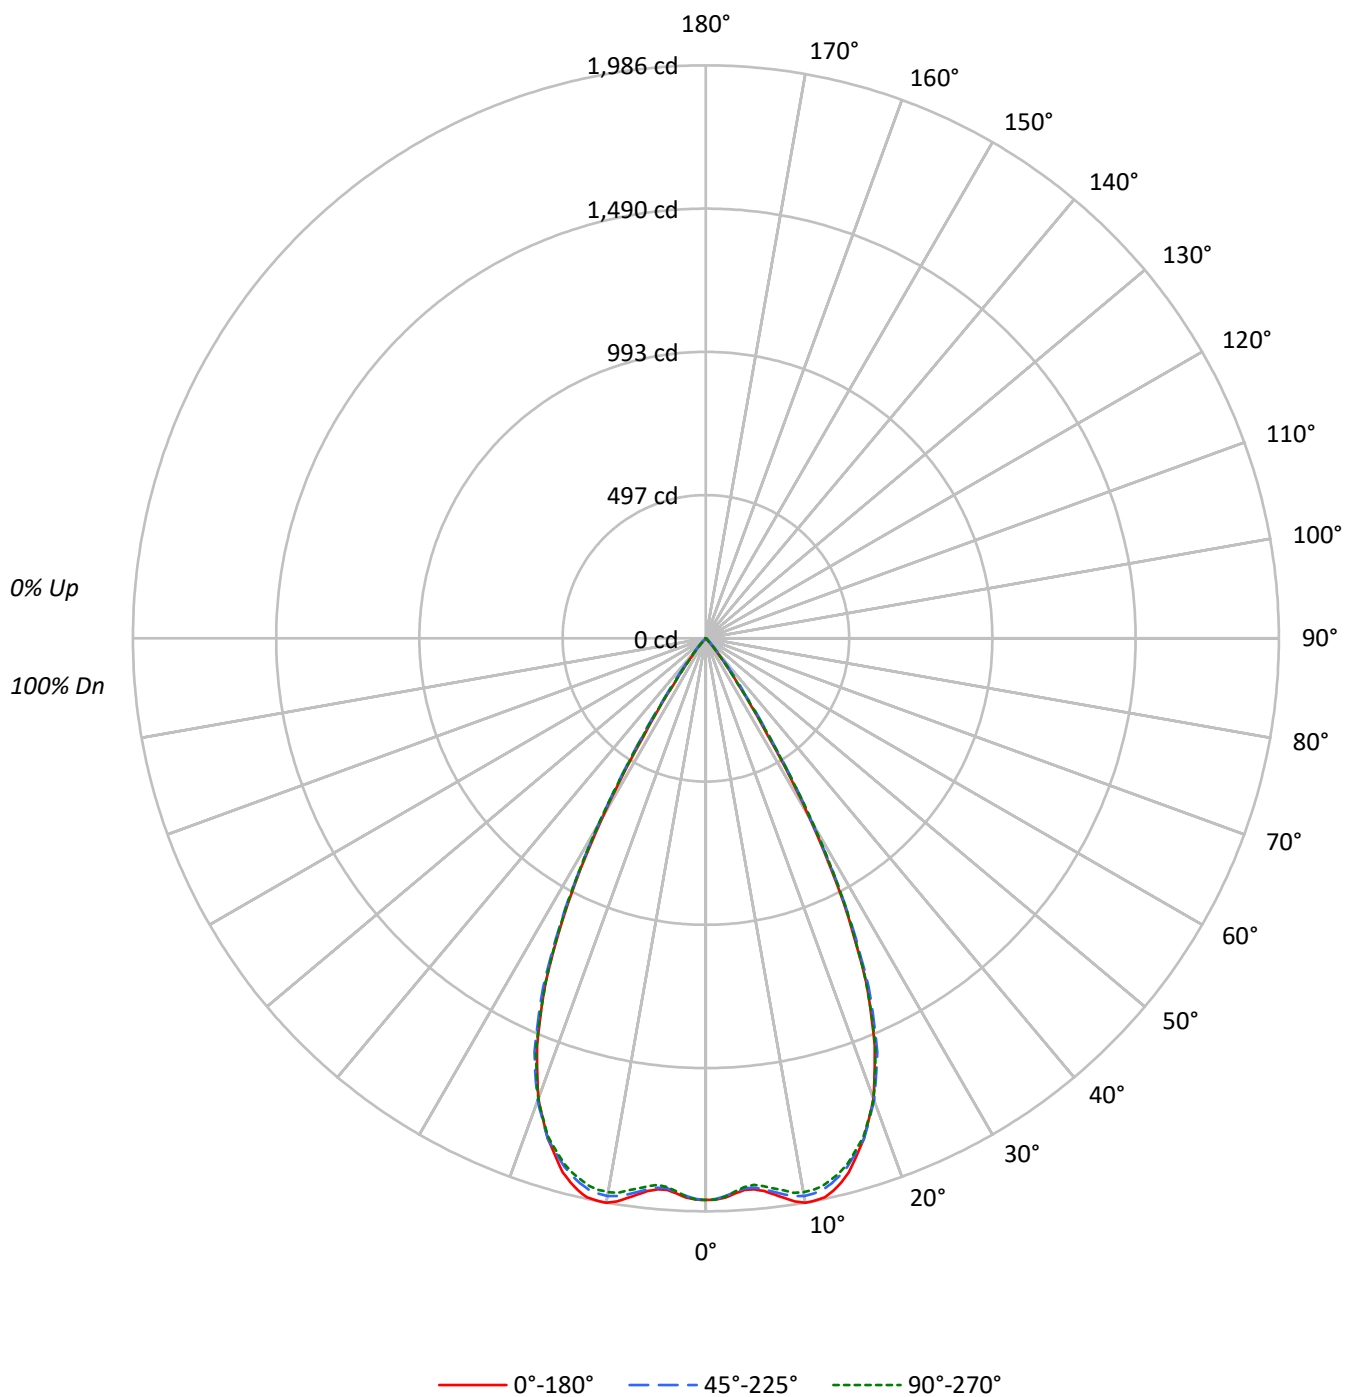

TEST NUMBER: P1306137

CATALOG NUMBER: P3SQAS17R559024DE010 E3SQCD1MMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10			0
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	114	112	109	107	112	109	107	106	105	104	102		102	100	99		98	97	96	95
2	109	105	101	98	107	103	100	97	100	97	95		97	95	93		94	93	91	89
3	104	99	94	91	103	97	93	90	95	91	89		92	90	87		90	88	86	84
4	100	93	88	84	98	92	87	84	90	86	83		88	85	82		86	83	81	80
5	96	88	83	79	94	87	82	79	85	81	78		84	80	77		82	79	77	75
6	91	83	78	74	90	83	78	74	81	77	74		80	76	73		79	75	73	71
7	87	79	74	70	86	79	73	70	77	73	69		76	72	69		75	72	69	67
8	84	75	70	66	83	75	70	66	74	69	66		73	69	65		72	68	65	64
9	80	72	66	63	79	71	66	63	70	66	62		69	65	62		69	65	62	61
10	77	68	63	59	76	68	63	59	67	62	59		66	62	59		66	62	59	58

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	335266	335266	335266
5°	331447	330461	328698
10°	347398	343218	340840
15°	341619	337982	336769
20°	311165	312430	311385
25°	249638	253534	249638
30°	143283	146902	148036
35°	40851	49218	42049
40°	10477	15063	10724
45°	1096	5261	828
50°	0	911	0
55°	0	0	0
60°	0	0	0
65°	0	0	0
70°	0	0	0
75°	0	0	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 5261 cd/sqm

TEST NUMBER: P1306137

CATALOG NUMBER: P3SQAS17R559024DE010 E3SQCD1MMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.8	12.5
10°-20°	527.4	35.6
20°-30°	580.9	39.3
30°-40°	173.4	11.7
40°-50°	13.3	0.9
50°-60°	0.1	0.0
60°-70°	0.0	0.0
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1293.2	87.4
0°-40°	1466.6	99.1
0°-60°	1480.0	100.0
0°-90°	1480.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1480.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1947	1947	1947	1947	1947	
5°	1917	1914	1912	1904	1901	186
15°	1916	1902	1896	1888	1889	531
25°	1314	1314	1334	1332	1314	575
35°	194	207	234	214	200	161
45°	4	11	22	11	3	9
55°	0	0	0	0	0	0
65°	0	0	0	0	0	0
75°	0	0	0	0	0	0
85°	0	0	0	0	0	0
90°	0	0	0	0	0	

TEST NUMBER: P1306137

CATALOG NUMBER: P3SQAS17R559024DE010 E3SQCD1MMS

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1946.7	1946.7	1946.7	1946.7	1946.7
1°	1945.6	1945.6	1943.3	1942.2	1945.6
2°	1939.9	1939.9	1934.2	1933.1	1936.5
3°	1927.4	1926.3	1921.7	1918.3	1920.6
4°	1917.2	1914.9	1911.5	1905.8	1906.9
5°	1917.2	1913.8	1911.5	1903.5	1901.3
6°	1926.3	1924.0	1919.4	1911.5	1909.2
7°	1942.2	1937.6	1933.1	1922.8	1920.6
8°	1959.2	1955.8	1946.7	1936.5	1931.9
9°	1976.3	1968.3	1956.9	1946.7	1945.6
10°	1986.5	1975.1	1962.6	1950.1	1949.0
11°	1985.3	1975.1	1960.3	1949.0	1947.8
12°	1980.8	1966.0	1953.5	1939.9	1941.0
13°	1964.9	1951.3	1938.8	1928.5	1926.3
14°	1943.3	1930.8	1919.4	1909.2	1910.3
15°	1916.0	1902.4	1895.6	1887.6	1888.8
17.5°	1819.4	1816.0	1819.4	1810.3	1813.7
20°	1697.8	1694.4	1704.7	1700.1	1699.0
22.5°	1528.5	1533.0	1552.4	1546.7	1536.5
25°	1313.7	1313.7	1334.2	1331.9	1313.7
27.5°	1034.2	1042.1	1054.6	1060.3	1046.7
30°	720.5	738.7	738.7	750.0	744.4
32.5°	402.3	440.9	450.0	455.7	433.0
35°	194.3	206.8	234.1	213.6	200.0
37.5°	93.2	98.9	126.1	102.3	95.5
40°	46.6	53.4	67.0	55.7	47.7
42.5°	19.3	28.4	35.2	28.4	19.3
45°	4.5	11.4	21.6	11.4	3.4
47.5°	0.0	1.1	10.2	2.3	0.0
50°	0.0	0.0	3.4	0.0	0.0
52.5°	0.0	0.0	0.0	0.0	0.0
55°	0.0	0.0	0.0	0.0	0.0
57.5°	0.0	0.0	0.0	0.0	0.0
60°	0.0	0.0	0.0	0.0	0.0
62.5°	0.0	0.0	0.0	0.0	0.0
65°	0.0	0.0	0.0	0.0	0.0
67.5°	0.0	0.0	0.0	0.0	0.0
70°	0.0	0.0	0.0	0.0	0.0
72.5°	0.0	0.0	0.0	0.0	0.0
75°	0.0	0.0	0.0	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0



TEST NUMBER: P1306137

CATALOG NUMBER: P3SQAS17R559024DE010 E3SQCD1MMS

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
90°	0.0	0.0	0.0	0.0	0.0

(END OF REPORT)