Signify Classified - Internal

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: METALUX

Report Number: P1559270

Luminaire Tested: 22CGTX-50-B2750-W2D2-3500K

Issue Date: 8/30/2026

Report Generated By 670265710 / DESKTOP-98SHLC4

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-2019
Report Number:	P1559270
	TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G3-2510-581-48)
Test Lab:	COOPER LIGHTING SOLUTIONS
Issue Date:	8/30/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	METALUX
Catalog Number:	22CGTX-50-B2750-W2D2-3500K
Description:	2X2 5000 LUMEN CGTX TROFFER WITH BIO UP LEDS AT 3500K CCT WITH FROSTED SMOOTH l
Light Source:	3500K CCT, 80 CRI LEDS
Ballast/Driver:	-

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	5319.5 lumens
Efficiency:	N/A
Efficacy:	103.5 lumens/watt
Spacing Criteria (0/90/45):	1.28 / 1.28 / 1.4
Luminous Opening:	Rectangular (W 2' x L: 2' x H: 0')
CIE Type:	Direct
Input Watts (W):	51.4
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	NR
Total Harmonic Distortion (THDi):	NR
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	24 FT




Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1559270
CATALOG NUMBER: 22CGTX-50-B2750-W2D2-3500K

Luminous Intensity Polar Plot

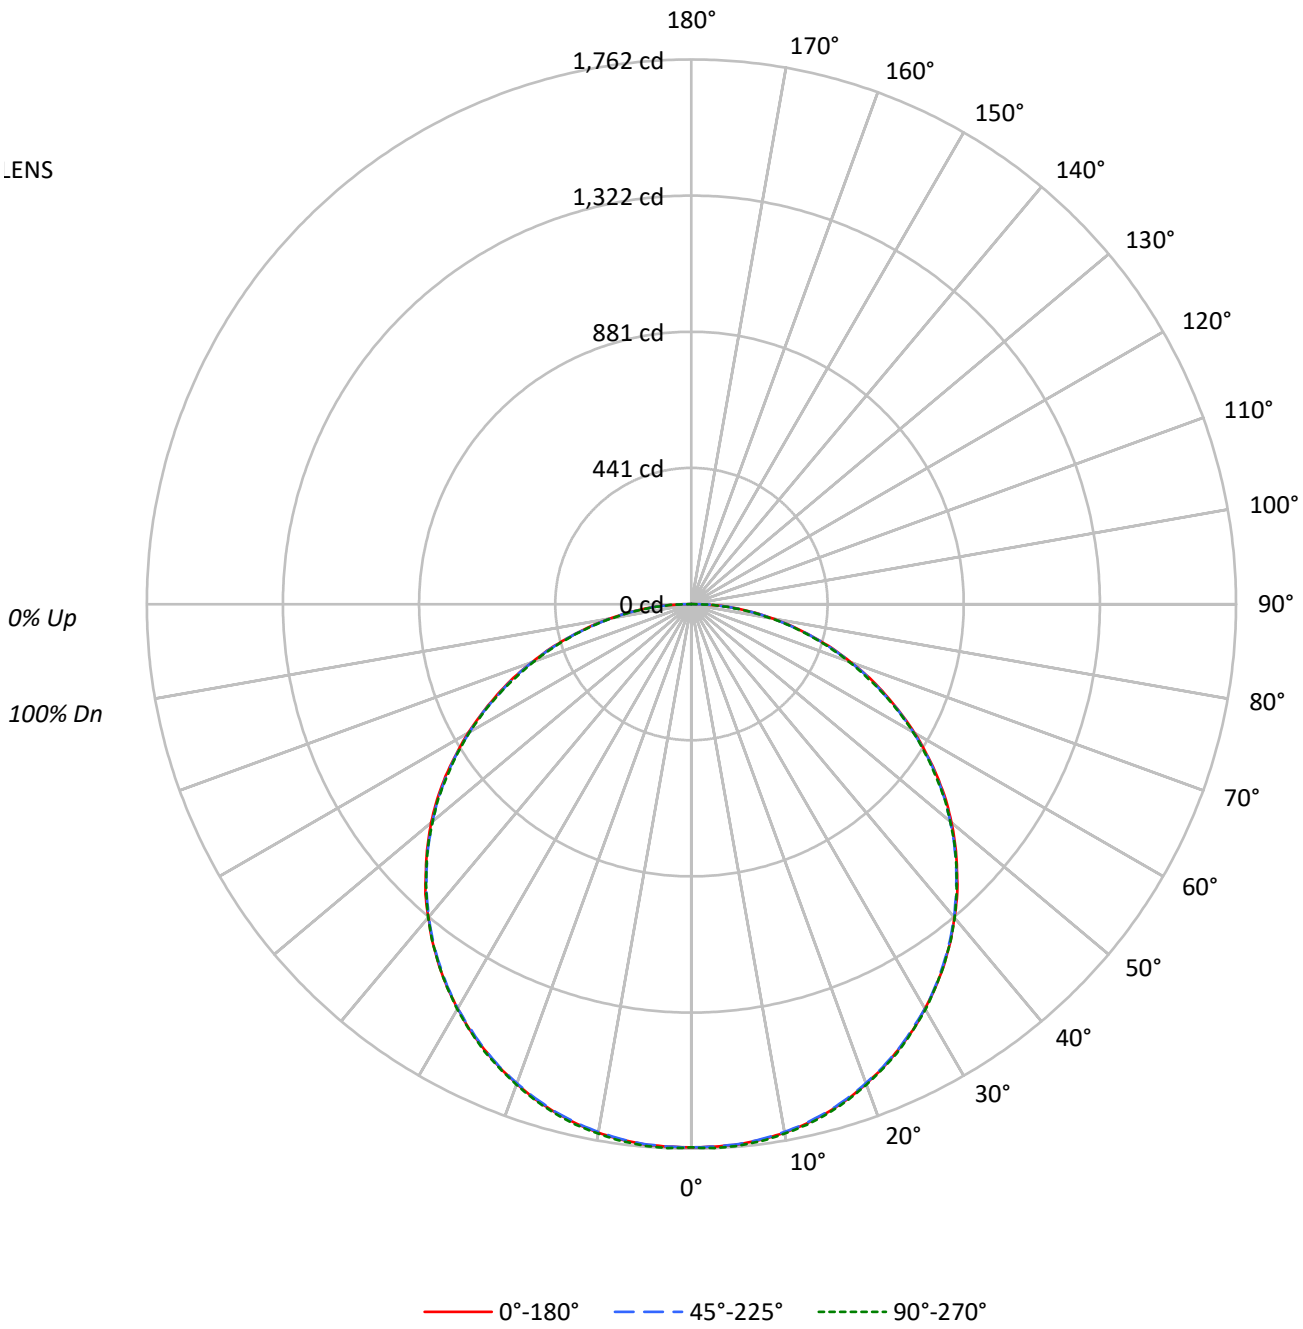

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1559270
CATALOG NUMBER: 22CGTX-50-B2750-W2D2-3500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20			20			20			20
RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	108	103	99	94	105	101	97	93	97	93	90	93	90	87	89	87	85	82
2	98	89	82	76	95	87	81	75	84	78	74	81	76	72	78	74	70	68
3	89	78	70	63	87	77	69	62	74	67	61	71	65	60	68	63	59	57
4	81	69	60	53	79	68	59	53	65	58	52	63	56	51	61	55	51	48
5	75	62	52	46	73	60	52	45	58	51	45	56	50	44	54	49	44	42
6	69	55	46	40	67	54	46	39	53	45	39	51	44	39	49	43	38	36
7	64	50	41	35	62	49	41	35	48	40	35	46	39	34	45	39	34	32
8	59	46	37	31	58	45	37	31	44	36	31	42	36	31	41	35	30	28
9	56	42	34	28	54	41	33	28	40	33	28	39	32	28	38	32	27	26
10	52	39	31	25	51	38	30	25	37	30	25	36	30	25	35	29	25	23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4730	4730	4730
5°	4740	4737	4751
10°	4745	4740	4753
15°	4742	4737	4753
20°	4730	4724	4739
25°	4716	4713	4728
30°	4697	4697	4706
35°	4680	4670	4680
40°	4650	4643	4654
45°	4623	4612	4615
50°	4600	4575	4575
55°	4554	4535	4516
60°	4491	4464	4458
65°	4408	4369	4362
70°	4303	4303	4247
75°	4207	4186	4134
80°	4113	4065	3987
85°	4174	3989	3924

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 4623 cd/sqm

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1559270
CATALOG NUMBER: 22CGTX-50-B2750-W2D2-3500K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	166.9	3.1
10°-20°	480.4	9.0
20°-30°	732.3	13.8
30°-40°	890.6	16.7
40°-50°	935.9	17.6
50°-60°	863.2	16.2
60°-70°	681.4	12.8
70°-80°	425.1	8.0
80°-90°	143.7	2.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1379.6	25.9
0°-40°	2270.2	42.7
0°-60°	4069.3	76.5
0°-90°	5319.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5319.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1758	1758	1758	1758	1758	
5°	1755	1753	1754	1756	1759	167
15°	1702	1700	1700	1703	1706	481
25°	1588	1588	1587	1590	1592	732
35°	1425	1424	1422	1424	1425	891
45°	1215	1215	1212	1212	1213	938
55°	971	966	967	966	963	867
65°	692	691	686	687	685	685
75°	405	405	403	399	398	429
85°	135	133	129	128	127	148
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1559270
CATALOG NUMBER: 22CGTX-50-B2750-W2D2-3500K

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1757.7	1757.7	1757.7	1757.7	*1757.7*
2.5°	*1756.7*	*1755.7*	*1756.7*	*1759.7*	*1761.7*
5°	1754.7	1752.7	1753.7	1755.7	*1758.7*
7.5°	1747.6	1745.6	1745.6	1749.6	*1751.6*
10°	1736.5	1734.5	1734.5	1737.5	*1739.5*
12.5°	1721.4	1720.4	1719.4	1722.4	*1725.4*
15°	1702.2	1700.2	1700.2	1703.2	*1706.2*
17.5°	1680.0	1678.0	1677.0	1680.0	*1683.0*
20°	1651.8	1650.7	1649.7	1653.8	*1654.8*
22.5°	1622.5	1621.5	1620.5	1623.5	*1624.5*
25°	1588.2	1588.2	1587.2	1590.2	*1592.2*
27.5°	1552.9	1550.9	1548.8	1552.9	*1553.9*
30°	1511.5	1512.5	1511.5	1512.5	*1514.5*
32.5°	1470.1	1469.1	1468.1	1470.1	*1470.1*
35°	1424.7	1423.7	1421.7	1423.7	*1424.7*
37.5°	1376.3	1374.3	1373.3	1375.3	*1376.3*
40°	1323.8	1323.8	1321.8	1323.8	*1324.8*
42.5°	1273.4	1271.4	1267.3	1267.3	*1269.3*
45°	1214.9	1214.9	1211.8	1211.8	*1212.8*
47.5°	1158.3	1157.3	1153.3	1154.3	*1155.3*
50°	1098.8	1095.8	1092.8	1091.8	*1092.8*
52.5°	1036.3	1033.2	1031.2	1030.2	*1031.2*
55°	970.7	965.6	966.6	965.6	*962.6*
57.5°	902.1	899.0	899.0	896.0	*896.0*
60°	834.5	832.4	829.4	827.4	*828.4*
62.5°	762.8	761.8	759.8	757.8	*756.8*
65°	692.2	691.2	686.1	687.1	*685.1*
67.5°	623.6	620.5	618.5	612.5	*610.5*
70°	546.9	548.9	546.9	542.8	*539.8*
72.5°	478.3	476.3	474.2	470.2	*469.2*
75°	404.6	404.6	402.6	398.6	*397.6*
77.5°	337.0	337.0	331.0	327.9	*328.9*
80°	265.4	266.4	262.3	259.3	*257.3*
82.5°	200.8	199.8	195.7	193.7	*193.7*
85°	135.2	133.2	129.2	128.1	*127.1*
87.5°	73.7	70.6	68.6	68.6	*68.6*
90°	0.0	0.0	0.0	0.0	*0.0*

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

TEST NUMBER: P1559270
CATALOG NUMBER: 22CGTX-50-B2750-W2D2-3500K

CIE UGR TABLE:

Reflectances:											
	Ceiling	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
	Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
	Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	17.44	19.11	17.81	19.43	19.74	17.41	19.08	17.78	19.40	19.71
	3H	19.43	20.94	19.80	21.27	21.63	19.36	20.88	19.74	21.21	21.56
	4H	20.22	21.65	20.62	22.00	22.37	20.14	21.58	20.54	21.92	22.30
	6H	20.87	22.20	21.28	22.57	22.96	20.78	22.11	21.19	22.47	22.86
	8H	21.12	22.39	21.54	22.78	23.18	21.01	22.28	21.44	22.67	23.07
	12H	21.31	22.53	21.74	22.91	23.34	21.19	22.41	21.62	22.79	23.22
4H	2H	18.11	19.55	18.51	19.89	20.27	18.09	19.52	18.49	19.87	20.25
	3H	20.33	21.54	20.74	21.94	22.34	20.28	21.49	20.69	21.88	22.28
	4H	21.27	22.37	21.70	22.78	23.21	21.20	22.30	21.63	22.71	23.14
	6H	22.07	23.04	22.52	23.47	23.93	21.98	22.94	22.43	23.38	23.83
	8H	22.38	23.28	22.84	23.72	24.19	22.27	23.18	22.73	23.62	24.08
	12H	22.64	23.45	23.12	23.93	24.39	22.51	23.33	22.99	23.80	24.27
8H	4H	21.64	22.55	22.10	22.99	23.45	21.58	22.49	22.04	22.93	23.39
	6H	22.60	23.35	23.09	23.84	24.31	22.51	23.26	23.00	23.75	24.22
	8H	23.00	23.68	23.51	24.19	24.67	22.90	23.58	23.41	24.08	24.57
	12H	23.36	23.96	23.87	24.45	25.01	23.24	23.84	23.74	24.33	24.89
12H	4H	21.70	22.51	22.18	22.98	23.45	21.64	22.45	22.12	22.93	23.40
	6H	22.68	23.36	23.19	23.87	24.35	22.60	23.28	23.11	23.78	24.27
	8H	23.16	23.76	23.67	24.25	24.81	23.06	23.66	23.57	24.15	24.71

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2510-581-8-R2

Test Date: 02/03/2026

Luminaire Tested: 24CGTX-45-B2750-W2D-3500K

Data in this report applies to families of products including 24CGTX-45-UNV


Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.05

Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2510-581-8-R2
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	07/28/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	Metalux
Catalog Number:	**24CGTX-45-B2750-W2D-3500K**
Description:	*THIS IS A REVISION OF REPORT SP1-2510-581-8-R2 TO UPDATE THE CATALOG INFORMATION*2X4 CGTX 4500 lumen with BioUp Boards - 3500K

Spectral Parameters

CCT (K):	3407	CRI (Ra):	90.6		
CIE u':	0.2428	R1:	93.7	R9:	86.5
CIE v':	0.4992	R2:	90.5	R10:	82.1
Duv:	-0.0104	R3:	90.2	R11:	96.0
CIE x:	0.3996	R4:	96.7	R12:	75.0
CIE y:	0.3651	R5:	92.5	R13:	92.1
CIE z:	0.2353	R6:	83.5	R14:	96.1
Peak Wavelength (nm):	630	R7:	88.1	R15:	95.7
Dominant Wavelength (nm):	587	R8:	89.8		
Purity:	29.46494				
Rf:	90.9				
Rg:	99.5				

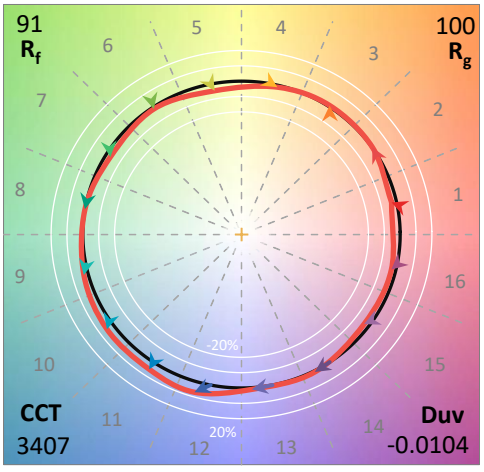


Test Conditions

Stabilization Time:	20M
Operation Time:	1H 20M
Sphere Temperature (°C):	25.1


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	12/16/2025	6/16/2026
Power Meter	XITRON INXT2011004	10/21/2025	10/21/2026
AC Power Source	CHROMA 61603 IN0063	10/21/2025	10/21/2026
DC Power Source	AGILENT E3634A IN0208	10/21/2025	10/21/2026
Sphere Thermometer	ONSET IN0085	10/21/2025	10/21/2026
Room Thermometer	ONSET IN0046	10/21/2025	10/21/2026

REPORT NUMBER: SP1-2510-581-8-R2

CIE 1931 Chromaticity Diagram

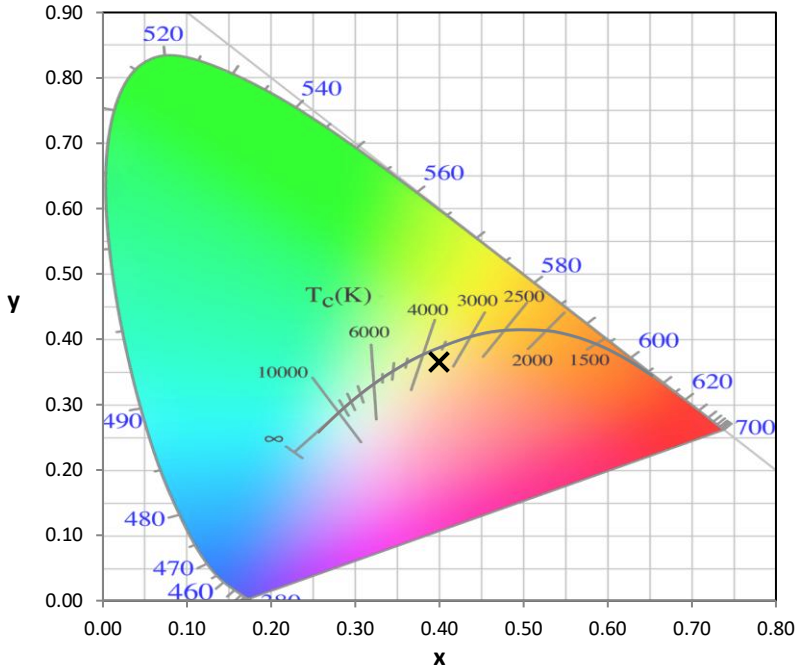

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

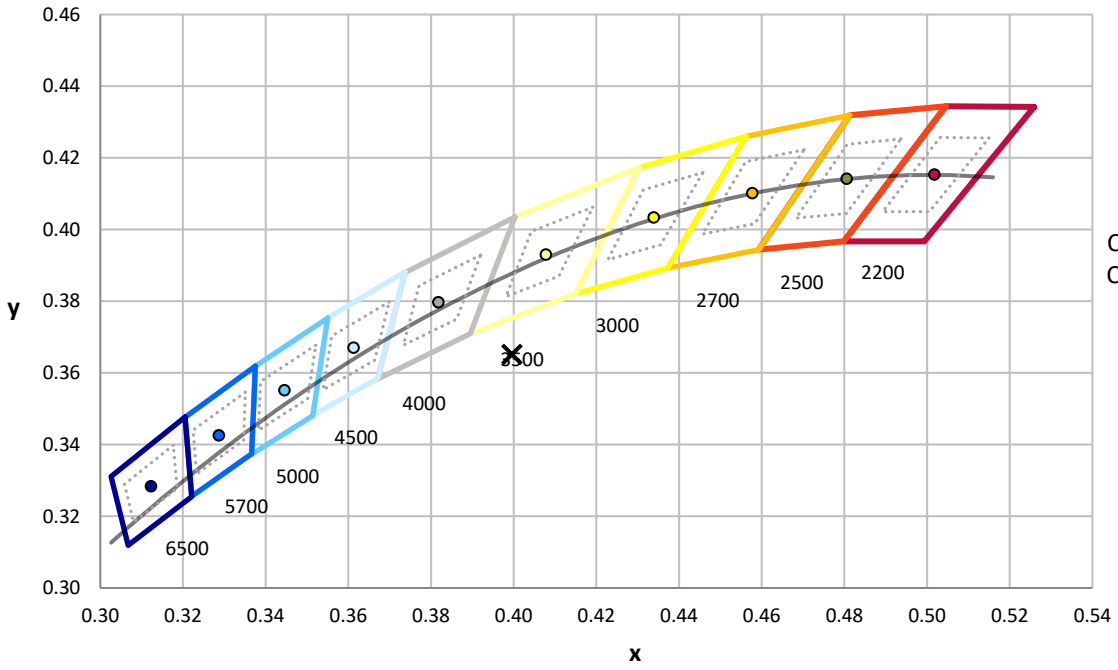


CCT = 3407K
CIE x = 0.3996
CIE y = 0.3651
Duv = -0.0104

Point lies outside the range

REPORT NUMBER: SP1-2510-581-8-R2

Photopic Flux vs. Wavelength

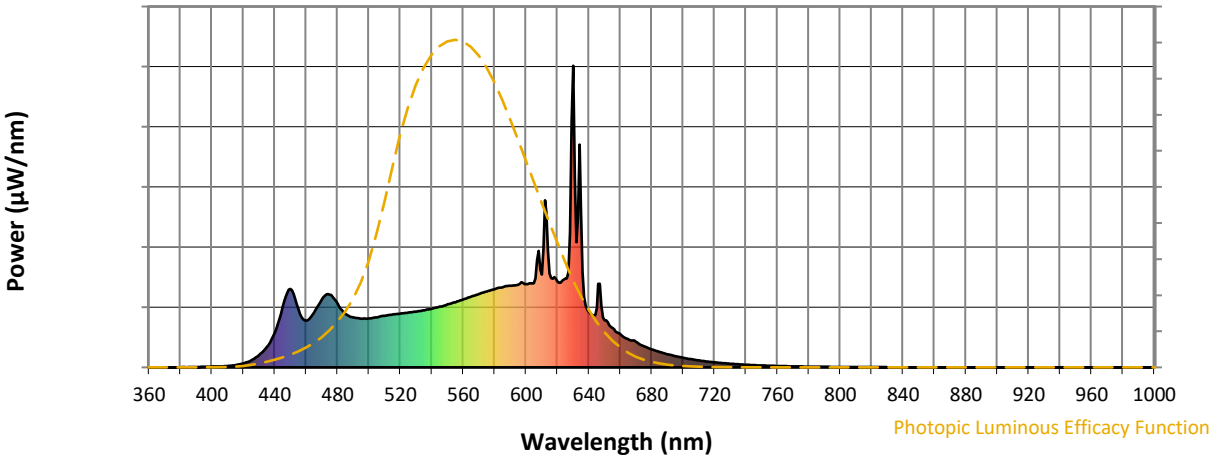


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	165	NR	620	285	NR	750	6	NR	880	0	NR
365	0	NR	495	161	NR	625	293	NR	755	5	NR	885	0	NR
370	0	NR	500	162	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	166	NR	635	530	NR	765	4	NR	895	0	NR
380	0	NR	510	171	NR	640	184	NR	770	3	NR	900	0	NR
385	1	NR	515	175	NR	645	198	NR	775	3	NR	905	0	NR
390	1	NR	520	178	NR	650	156	NR	780	2	NR	910	0	NR
395	2	NR	525	182	NR	655	131	NR	785	2	NR	915	0	NR
400	3	NR	530	185	NR	660	110	NR	790	2	NR	920	0	NR
405	3	NR	535	189	NR	665	93	NR	795	2	NR	925	0	NR
410	5	NR	540	194	NR	670	85	NR	800	1	NR	930	0	NR
415	8	NR	545	201	NR	675	70	NR	805	1	NR	935	0	NR
420	13	NR	550	209	NR	680	60	NR	810	1	NR	940	0	NR
425	23	NR	555	216	NR	685	51	NR	815	1	NR	945	0	NR
430	40	NR	560	225	NR	690	44	NR	820	1	NR	950	0	NR
435	68	NR	565	234	NR	695	37	NR	825	1	NR	955	0	NR
440	114	NR	570	243	NR	700	32	NR	830	1	NR	960	0	NR
445	200	NR	575	251	NR	705	27	NR	835	1	NR	965	0	NR
450	260	NR	580	259	NR	710	23	NR	840	0	NR	970	0	NR
455	194	NR	585	266	NR	715	19	NR	845	0	NR	975	0	NR
460	155	NR	590	271	NR	720	17	NR	850	0	NR	980	0	NR
465	182	NR	595	273	NR	725	14	NR	855	0	NR	985	0	NR
470	226	NR	600	276	NR	730	12	NR	860	0	NR	990	0	NR
475	241	NR	605	279	NR	735	10	NR	865	0	NR	995	0	NR
480	211	NR	610	307	NR	740	9	NR	870	0	NR	1000	0	NR
485	177	NR	615	311	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2510-581-8-R2

Scotopic Flux vs. Wavelength

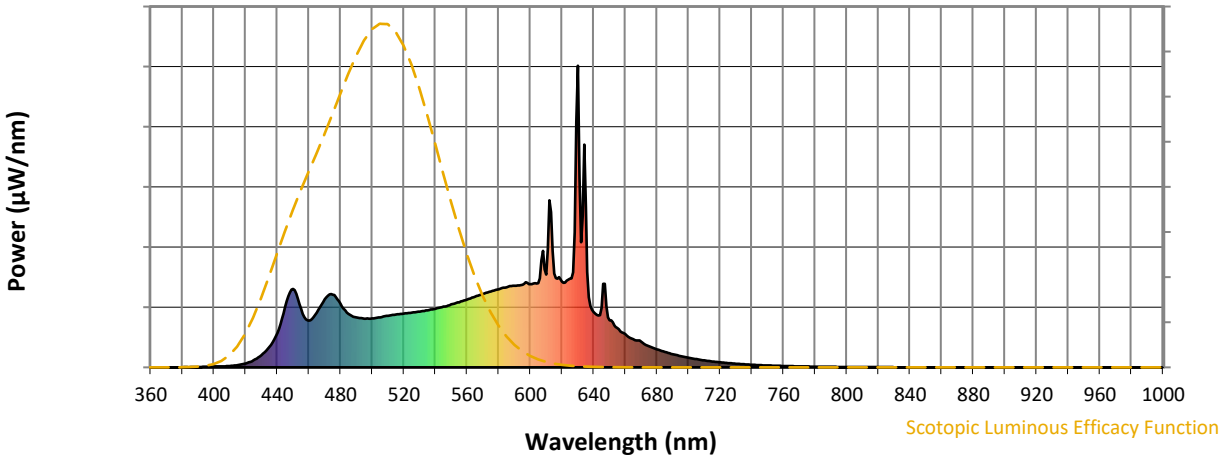


Scotopic Lumens: NR **S/P: 1.78**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	165	NR	620	285	NR	750	6	NR	880	0	NR
365	0	NR	495	161	NR	625	293	NR	755	5	NR	885	0	NR
370	0	NR	500	162	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	166	NR	635	530	NR	765	4	NR	895	0	NR
380	0	NR	510	171	NR	640	184	NR	770	3	NR	900	0	NR
385	1	NR	515	175	NR	645	198	NR	775	3	NR	905	0	NR
390	1	NR	520	178	NR	650	156	NR	780	2	NR	910	0	NR
395	2	NR	525	182	NR	655	131	NR	785	2	NR	915	0	NR
400	3	NR	530	185	NR	660	110	NR	790	2	NR	920	0	NR
405	3	NR	535	189	NR	665	93	NR	795	2	NR	925	0	NR
410	5	NR	540	194	NR	670	85	NR	800	1	NR	930	0	NR
415	8	NR	545	201	NR	675	70	NR	805	1	NR	935	0	NR
420	13	NR	550	209	NR	680	60	NR	810	1	NR	940	0	NR
425	23	NR	555	216	NR	685	51	NR	815	1	NR	945	0	NR
430	40	NR	560	225	NR	690	44	NR	820	1	NR	950	0	NR
435	68	NR	565	234	NR	695	37	NR	825	1	NR	955	0	NR
440	114	NR	570	243	NR	700	32	NR	830	1	NR	960	0	NR
445	200	NR	575	251	NR	705	27	NR	835	1	NR	965	0	NR
450	260	NR	580	259	NR	710	23	NR	840	0	NR	970	0	NR
455	194	NR	585	266	NR	715	19	NR	845	0	NR	975	0	NR
460	155	NR	590	271	NR	720	17	NR	850	0	NR	980	0	NR
465	182	NR	595	273	NR	725	14	NR	855	0	NR	985	0	NR
470	226	NR	600	276	NR	730	12	NR	860	0	NR	990	0	NR
475	241	NR	605	279	NR	735	10	NR	865	0	NR	995	0	NR
480	211	NR	610	307	NR	740	9	NR	870	0	NR	1000	0	NR
485	177	NR	615	311	NR	745	7	NR	875	0	NR			

REPORT NUMBER: SP1-2510-581-8-R2

Melanopic Flux vs. Wavelength

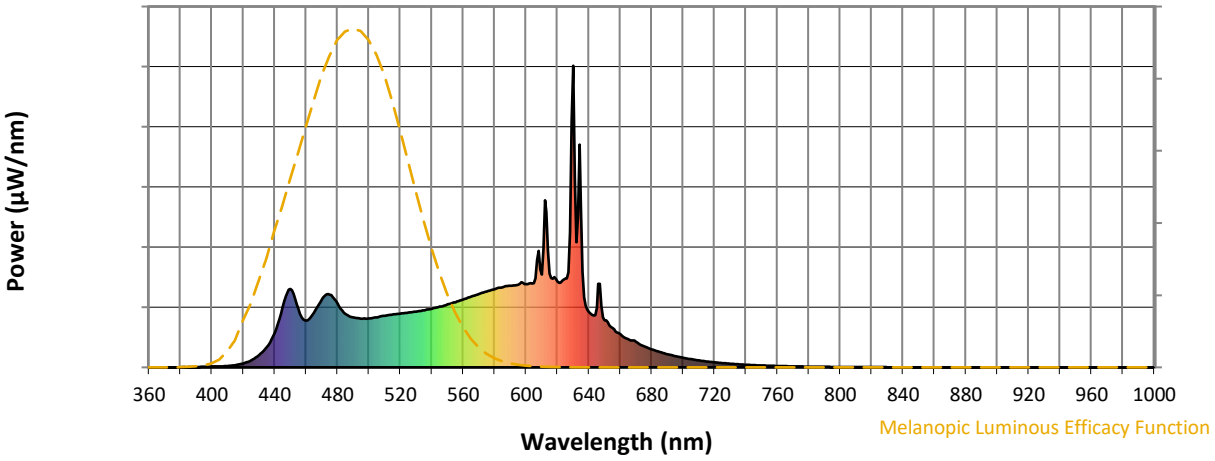

Melanopic Lumens: NR **M/P: 3.85**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	165	NR	620	285	NR	750	6	NR	880	0	NR
365	0	NR	495	161	NR	625	293	NR	755	5	NR	885	0	NR
370	0	NR	500	162	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	166	NR	635	530	NR	765	4	NR	895	0	NR
380	0	NR	510	171	NR	640	184	NR	770	3	NR	900	0	NR
385	1	NR	515	175	NR	645	198	NR	775	3	NR	905	0	NR
390	1	NR	520	178	NR	650	156	NR	780	2	NR	910	0	NR
395	2	NR	525	182	NR	655	131	NR	785	2	NR	915	0	NR
400	3	NR	530	185	NR	660	110	NR	790	2	NR	920	0	NR
405	3	NR	535	189	NR	665	93	NR	795	2	NR	925	0	NR
410	5	NR	540	194	NR	670	85	NR	800	1	NR	930	0	NR
415	8	NR	545	201	NR	675	70	NR	805	1	NR	935	0	NR
420	13	NR	550	209	NR	680	60	NR	810	1	NR	940	0	NR
425	23	NR	555	216	NR	685	51	NR	815	1	NR	945	0	NR
430	40	NR	560	225	NR	690	44	NR	820	1	NR	950	0	NR
435	68	NR	565	234	NR	695	37	NR	825	1	NR	955	0	NR
440	114	NR	570	243	NR	700	32	NR	830	1	NR	960	0	NR
445	200	NR	575	251	NR	705	27	NR	835	1	NR	965	0	NR
450	260	NR	580	259	NR	710	23	NR	840	0	NR	970	0	NR
455	194	NR	585	266	NR	715	19	NR	845	0	NR	975	0	NR
460	155	NR	590	271	NR	720	17	NR	850	0	NR	980	0	NR
465	182	NR	595	273	NR	725	14	NR	855	0	NR	985	0	NR
470	226	NR	600	276	NR	730	12	NR	860	0	NR	990	0	NR
475	241	NR	605	279	NR	735	10	NR	865	0	NR	995	0	NR
480	211	NR	610	307	NR	740	9	NR	870	0	NR	1000	0	NR
485	177	NR	615	311	NR	745	7	NR	875	0	NR			


REPORT NUMBER: SP1-2510-581-8-R2

TM-30-18


Summary


R_f = 90.9
R_g = 99.5
CIE R_a = 90.6
R_9 = 86.5


Spectral Power Distribution Comparison

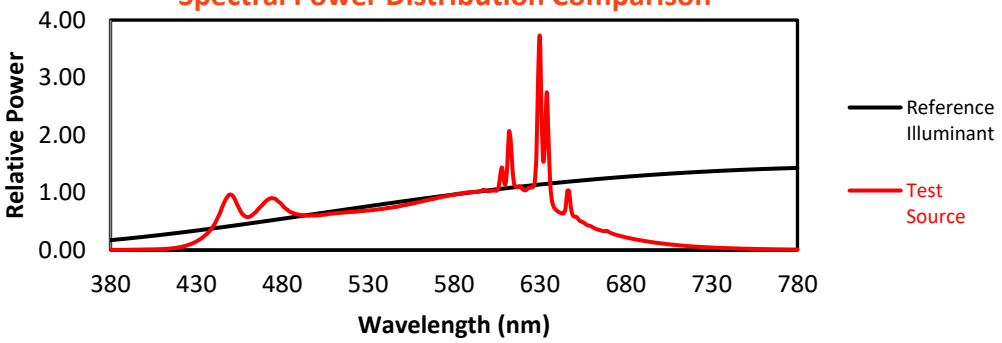


Color Vector Graphics

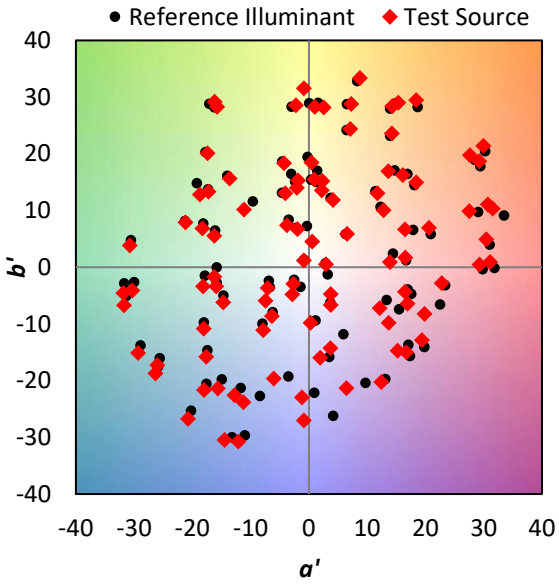

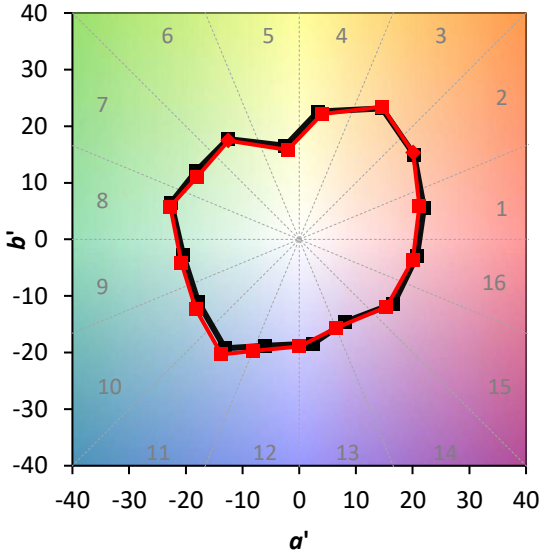

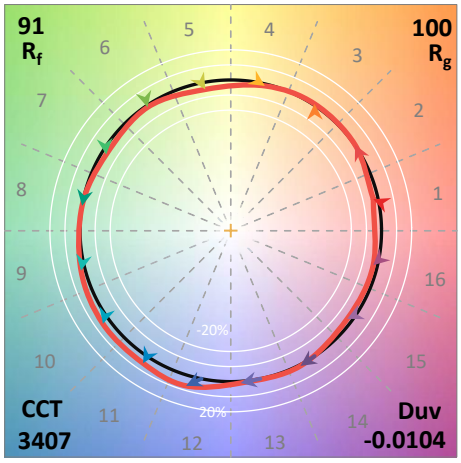

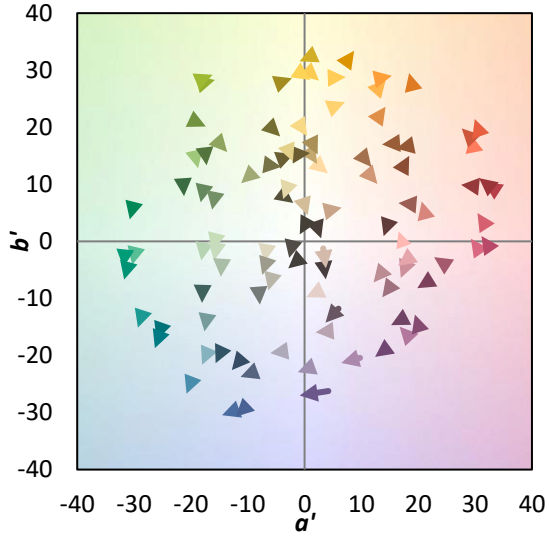


REPORT NUMBER: SP1-2510-581-8-R2

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 86	CES26 = 95	CES51 = 93	CES76 = 90
CES02 = 63	CES27 = 88	CES52 = 97	CES77 = 79
CES03 = 32	CES28 = 96	CES53 = 92	CES78 = 90
CES04 = 70	CES29 = 92	CES54 = 89	CES79 = 82
CES05 = 50	CES30 = 87	CES55 = 87	CES80 = 85
CES06 = 51	CES31 = 92	CES56 = 89	CES81 = 65
CES07 = 43	CES32 = 97	CES57 = 88	CES82 = 94
CES08 = 42	CES33 = 92	CES58 = 88	CES83 = 89
CES09 = 29	CES34 = 95	CES59 = 95	CES84 = 97
CES10 = 76	CES35 = 96	CES60 = 91	CES85 = 78
CES11 = 58	CES36 = 81	CES61 = 92	CES86 = 77
CES12 = 65	CES37 = 97	CES62 = 83	CES87 = 93
CES13 = 44	CES38 = 82	CES63 = 95	CES88 = 93
CES14 = 74	CES39 = 98	CES64 = 91	CES89 = 86
CES15 = 72	CES40 = 96	CES65 = 93	CES90 = 91
CES16 = 48	CES41 = 93	CES66 = 91	CES91 = 76
CES17 = 49	CES42 = 95	CES67 = 91	CES92 = 80
CES18 = 57	CES43 = 93	CES68 = 92	CES93 = 88
CES19 = 71	CES44 = 99	CES69 = 93	CES94 = 79
CES20 = 67	CES45 = 96	CES70 = 92	CES95 = 88
CES21 = 86	CES46 = 96	CES71 = 88	CES96 = 96
CES22 = 78	CES47 = 86	CES72 = 95	CES97 = 94
CES23 = 91	CES48 = 86	CES73 = 90	CES98 = 92
CES24 = 90	CES49 = 97	CES74 = 87	CES99 = 91
CES25 = 71	CES50 = 94	CES75 = 89	

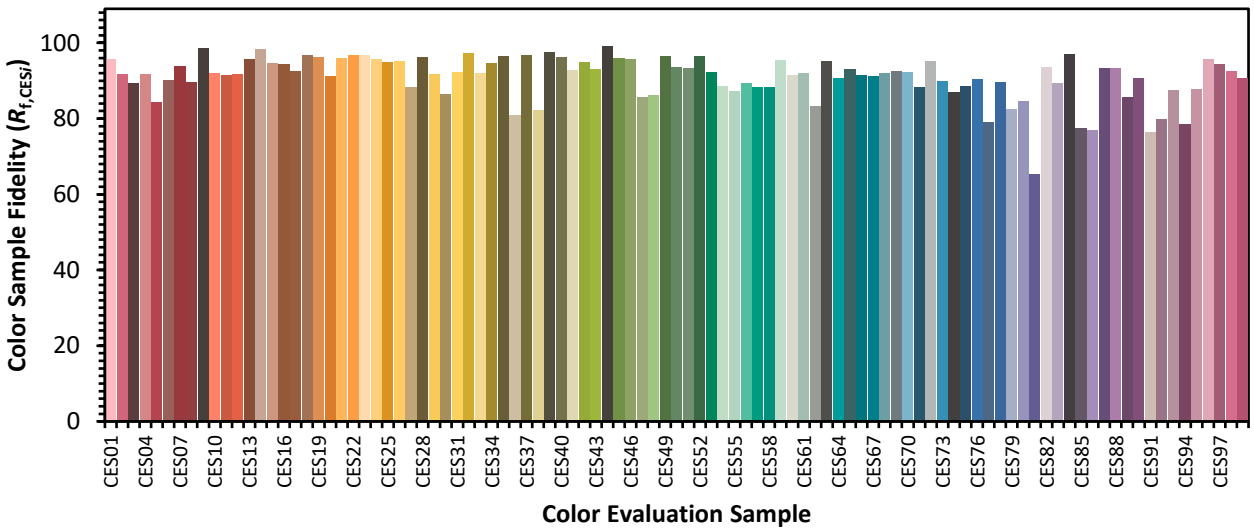



REPORT NUMBER: SP1-2510-581-8-R2

TM-30-18

Color Rendition by Hue-Angle Bin

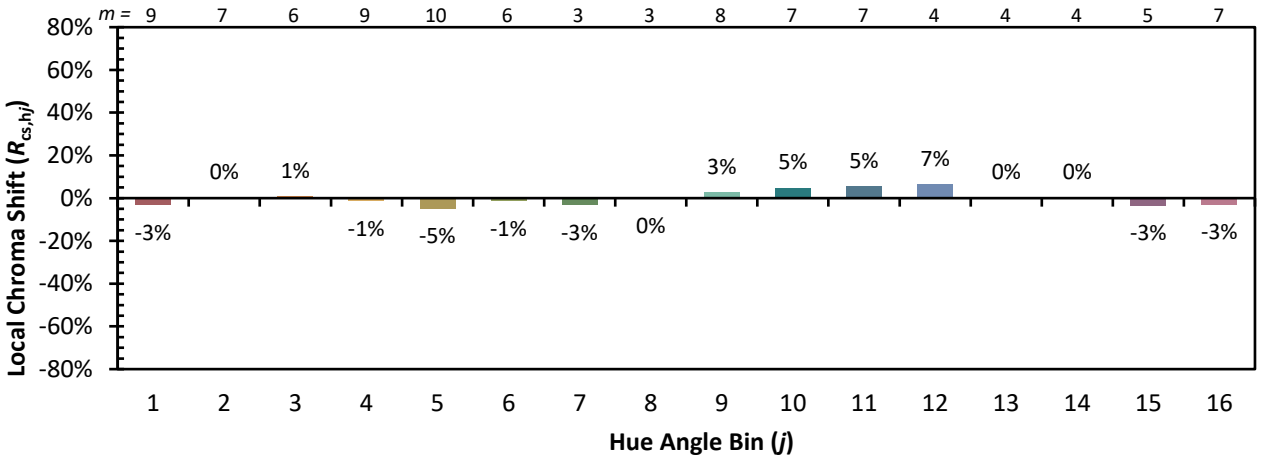

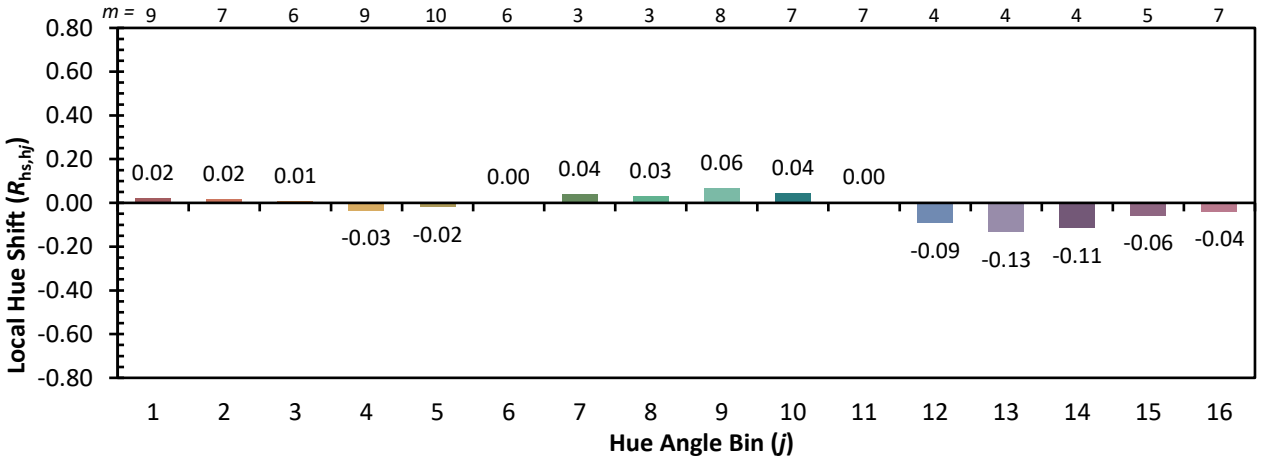


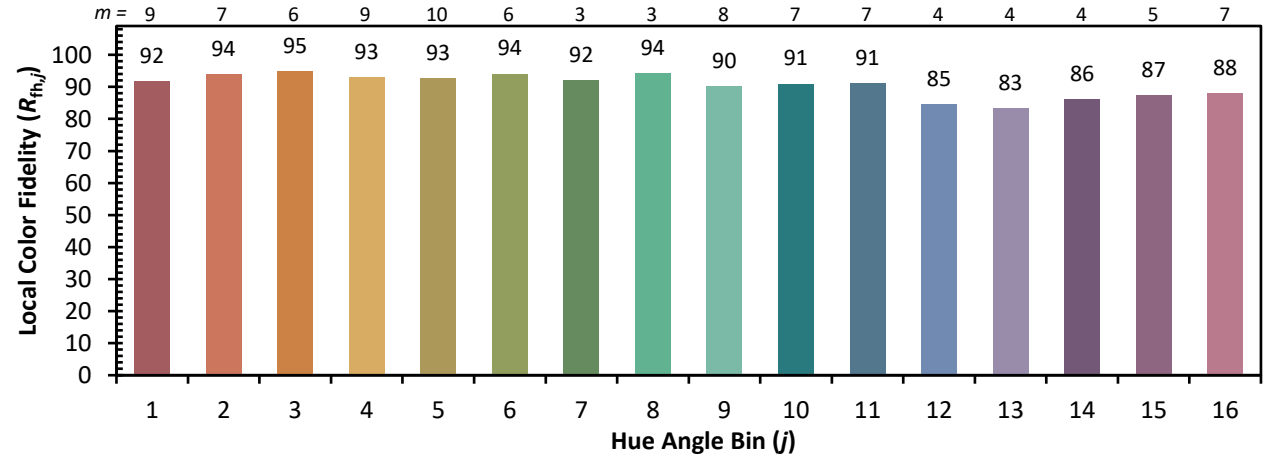


REPORT NUMBER: SP1-2510-581-8-R2

TM-30-18

Measure Comparisons

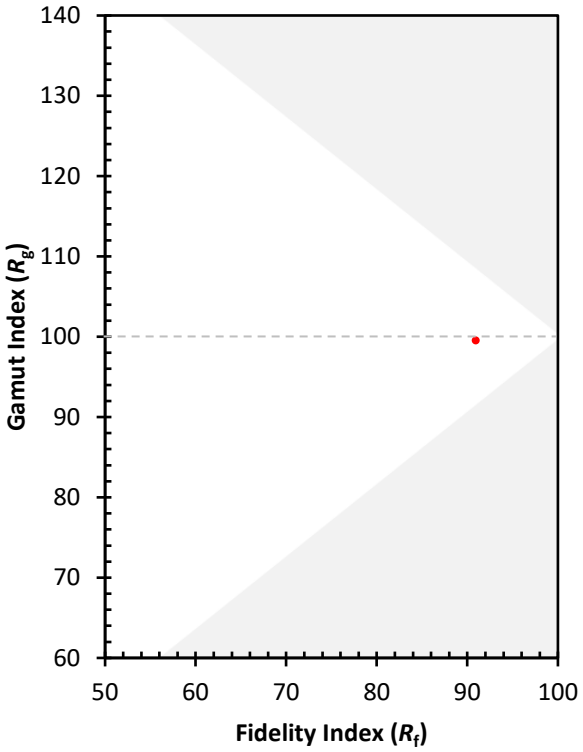

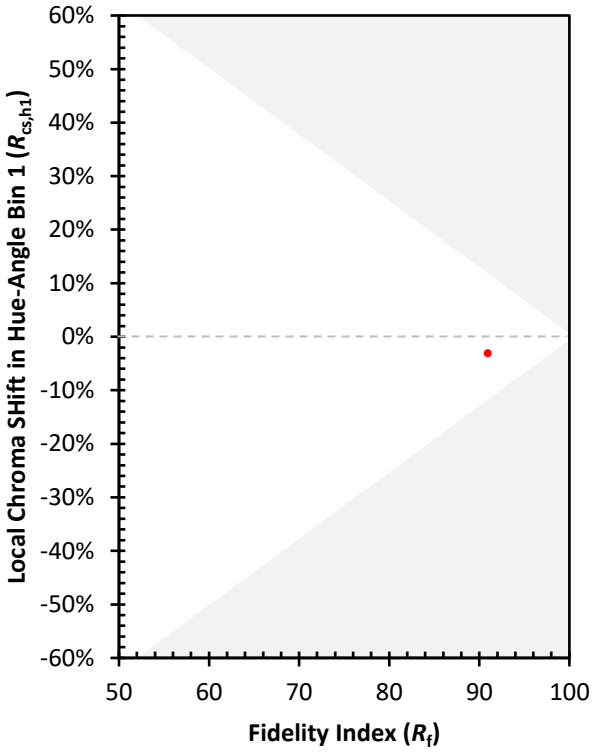

(END OF REPORT)