Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: METALUX

Report Number: P1590754

Luminaire Tested: 22CGTX-50-L92765-W2A-3500K

Issue Date: 9/7/2026

Report Generated By 670265710 / DESKTOP-98SHLC4

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-2019
Report Number:	P1590754
	TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2510-566-1)
Test Lab:	COOPER LIGHTING SOLUTIONS
Issue Date:	9/7/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	METALUX
Catalog Number:	22CGTX-50-L92765-W2A-3500K
Description:	2X2 5000 LUMEN CGTX TROFFER WITH VividTune LEDS AT 3500K CCT WITH FROSTED SMOOTH LENS
Light Source:	3500K CCT, 90 CRI LEDS
Ballast/Driver:	-

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	5544.0 lumens
Efficiency:	N/A
Efficacy:	103.4 lumens/watt
Spacing Criteria (0/90/45):	1.26 / 1.26 / 1.38
Luminous Opening:	Rectangular (W 2' x L: 2' x H: 0')
CIE Type:	Direct
Input Watts (W):	53.6
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	NR
Total Harmonic Distortion (THDi):	NR
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	24 FT




Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590754
CATALOG NUMBER: 22CGTX-50-L92765-W2A-3500K

Luminous Intensity Polar Plot

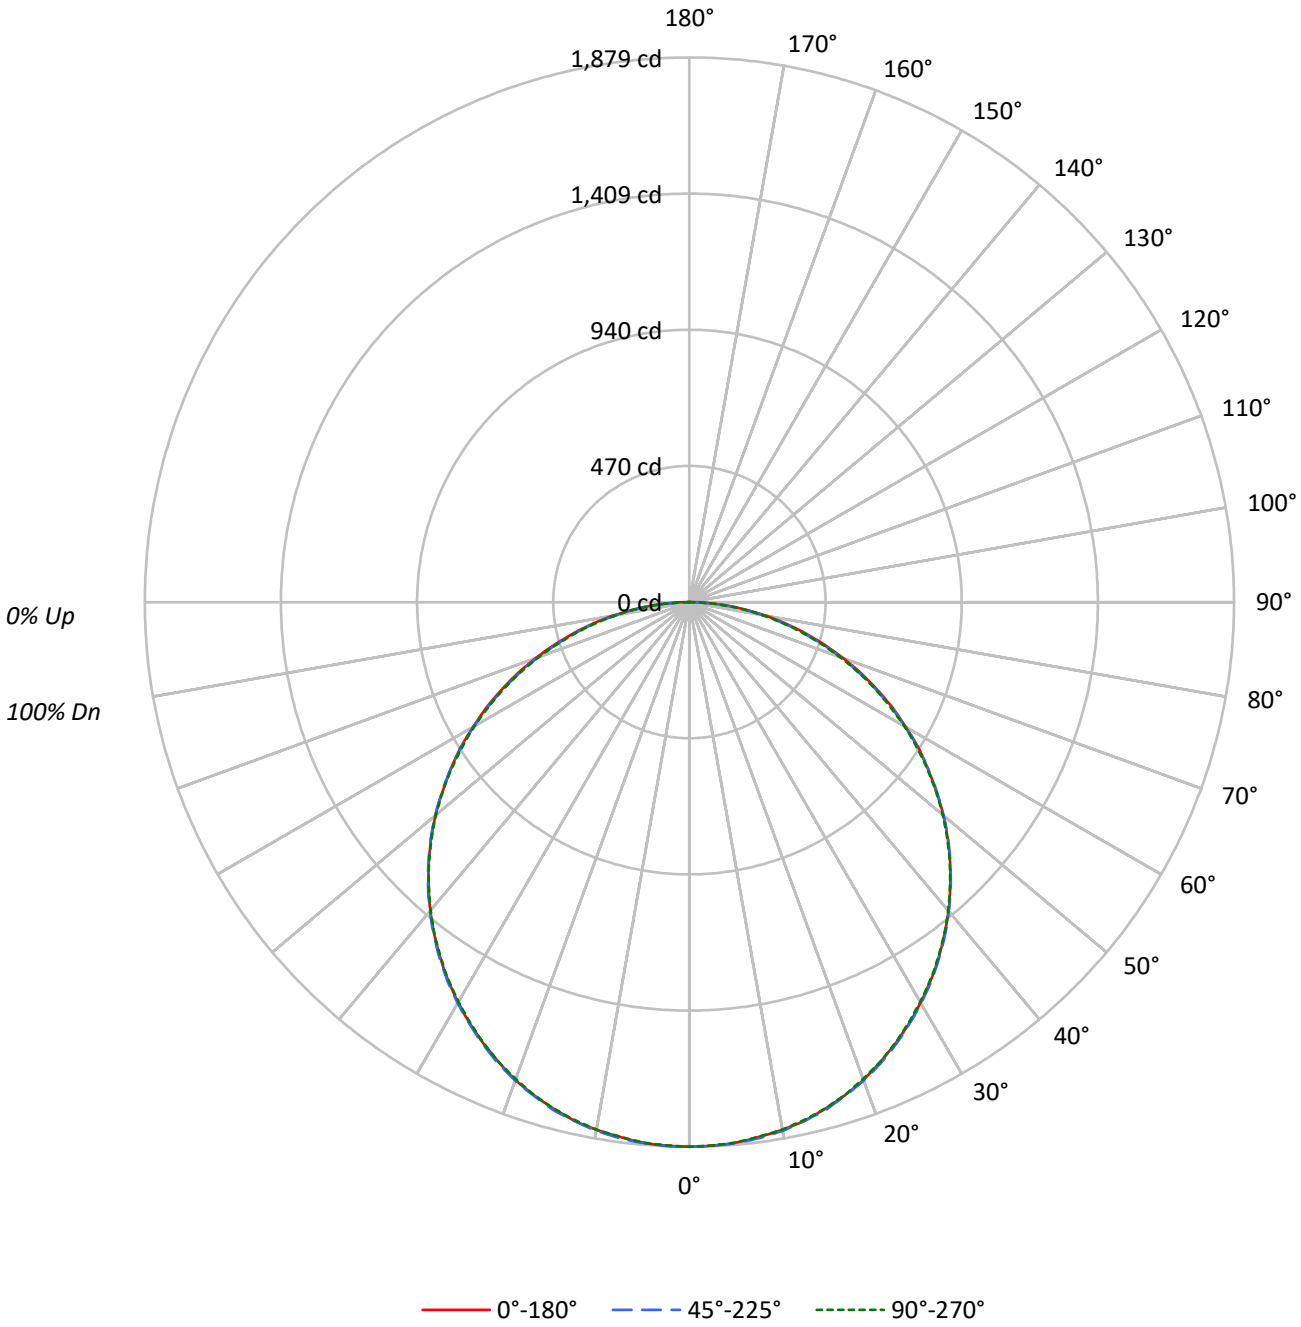

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590754
CATALOG NUMBER: 22CGTX-50-L92765-W2A-3500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20			20			20			20
RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	108	103	99	95	106	101	97	93	97	93	90	93	90	88	89	87	85	83
2	98	90	83	77	96	88	81	76	84	79	74	81	76	72	78	74	71	69
3	89	79	70	64	87	77	69	63	74	67	62	71	65	61	69	64	60	57
4	82	69	60	54	79	68	60	53	66	58	52	63	57	52	61	56	51	49
5	75	62	53	46	73	61	52	46	59	51	45	57	50	45	55	49	44	42
6	69	56	47	40	67	55	46	40	53	45	40	51	44	39	50	44	39	37
7	64	50	42	35	62	50	41	35	48	40	35	47	40	35	45	39	34	32
8	60	46	37	31	58	45	37	31	44	37	31	43	36	31	42	35	31	29
9	56	42	34	28	54	42	34	28	40	33	28	39	33	28	38	32	28	26
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	36	30	25	23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5057	5057	5057
5°	5056	5059	5054
10°	5052	5061	5050
15°	5042	5053	5039
20°	5025	5031	5013
25°	4989	5002	4986
30°	4958	4967	4948
35°	4922	4932	4915
40°	4885	4892	4878
45°	4840	4847	4835
50°	4787	4791	4778
55°	4714	4718	4699
60°	4633	4622	4605
65°	4546	4506	4486
70°	4429	4371	4331
75°	4282	4195	4153
80°	4090	3944	3913
85°	3770	3548	3514

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°
Vertical Angle: 45°
Luminance: 4851 cd/sqm

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590754
CATALOG NUMBER: 22CGTX-50-L92765-W2A-3500K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	178.0	3.2
10°-20°	511.1	9.2
20°-30°	775.2	14.0
30°-40°	938.1	16.9
40°-50°	981.4	17.7
50°-60°	898.2	16.2
60°-70°	701.7	12.7
70°-80°	428.1	7.7
80°-90°	132.1	2.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1464.3	26.4
0°-40°	2402.5	43.3
0°-60°	4282.0	77.2
0°-90°	5544.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5544.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1879	1879	1879	1879	1879	
5°	1872	1872	1873	1873	1871	178
15°	1810	1812	1814	1812	1809	511
25°	1680	1682	1684	1681	1679	775
35°	1498	1500	1501	1497	1496	938
45°	1272	1275	1274	1271	1271	981
55°	1005	1009	1006	1003	1002	899
65°	714	712	708	707	705	707
75°	412	409	404	404	399	435
85°	122	120	115	118	114	136
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590754
CATALOG NUMBER: 22CGTX-50-L92765-W2A-3500K

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1879.1	1879.1	1879.1	*1879.1*	1879.1
2.5°	*1877.0*	*1879.1*	*1878.0*	*1880.1*	*1875.9*
5°	1871.8	1871.8	1872.8	*1872.8*	1870.8
7.5°	1860.4	1862.5	1864.6	*1862.5*	1859.4
10°	1849.0	1850.1	1852.2	*1850.1*	1848.0
12.5°	1833.5	1833.5	1833.5	*1833.5*	1830.4
15°	1809.7	1811.8	1813.9	*1811.8*	1808.7
17.5°	1783.9	1784.9	1785.9	*1784.9*	1782.8
20°	1754.9	1754.9	1757.0	*1753.9*	1750.7
22.5°	1718.7	1720.7	1722.8	*1719.7*	1717.6
25°	1680.4	1682.5	1684.5	*1681.4*	1679.4
27.5°	1640.0	1641.1	1642.1	*1639.0*	1636.9
30°	1595.5	1595.5	1598.6	*1595.5*	1592.4
32.5°	1549.0	1551.0	1552.1	*1547.9*	1546.9
35°	1498.3	1500.3	1501.4	*1497.2*	1496.2
37.5°	1445.5	1448.6	1448.6	*1446.5*	1444.5
40°	1390.7	1393.8	1392.7	*1388.6*	1388.6
42.5°	1331.7	1335.8	1334.8	*1331.7*	1330.7
45°	1271.7	1274.8	1273.7	*1270.6*	1270.6
47.5°	1208.6	1211.7	1210.6	*1206.5*	1206.5
50°	1143.4	1145.4	1144.4	*1141.3*	1141.3
52.5°	1074.0	1078.2	1076.1	*1074.0*	1072.0
55°	1004.7	1008.9	1005.7	*1002.6*	1001.6
57.5°	937.5	935.4	934.4	*931.2*	929.2
60°	860.9	863.0	858.8	*857.8*	855.7
62.5°	790.5	788.5	784.3	*782.2*	780.2
65°	714.0	711.9	707.7	*706.7*	704.6
67.5°	639.5	637.4	632.2	*630.1*	628.1
70°	562.9	560.8	555.6	*553.6*	550.5
72.5°	486.3	485.3	477.0	*477.0*	473.9
75°	411.8	408.7	403.5	*403.5*	399.4
77.5°	336.3	334.2	328.0	*330.1*	323.9
80°	263.9	260.7	254.5	*257.6*	252.5
82.5°	190.4	188.3	183.1	*185.2*	181.1
85°	122.1	120.0	114.9	*118.0*	113.8
87.5°	56.9	54.8	50.7	*54.8*	50.7
90°	0.0	0.0	0.0	*0.0*	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

TEST NUMBER: P1590754
CATALOG NUMBER: 22CGTX-50-L92765-W2A-3500K

CIE UGR TABLE:

Reflectances:											
	Ceiling	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
	Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
	Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	17.58	19.24	17.95	19.56	19.87	17.55	19.21	17.91	19.52	19.84
	3H	19.52	21.03	19.90	21.36	21.72	19.45	20.96	19.83	21.29	21.65
	4H	20.29	21.71	20.69	22.06	22.44	20.20	21.62	20.60	21.97	22.35
	6H	20.90	22.22	21.31	22.59	22.98	20.79	22.11	21.20	22.47	22.86
	8H	21.12	22.38	21.54	22.77	23.16	20.99	22.25	21.41	22.64	23.04
	12H	21.27	22.48	21.70	22.86	23.29	21.13	22.34	21.56	22.72	23.15
4H	2H	18.24	19.67	18.64	20.01	20.39	18.21	19.64	18.61	19.98	20.36
	3H	20.41	21.61	20.82	22.01	22.41	20.35	21.55	20.76	21.95	22.35
	4H	21.32	22.41	21.75	22.82	23.25	21.24	22.33	21.67	22.74	23.18
	6H	22.07	23.02	22.52	23.46	23.92	21.97	22.92	22.42	23.36	23.82
	8H	22.34	23.23	22.80	23.68	24.14	22.23	23.12	22.69	23.56	24.03
	12H	22.55	23.36	23.03	23.83	24.30	22.42	23.23	22.90	23.70	24.17
8H	4H	21.67	22.56	22.13	23.00	23.47	21.60	22.50	22.06	22.94	23.40
	6H	22.56	23.31	23.05	23.79	24.27	22.47	23.22	22.97	23.70	24.18
	8H	22.92	23.59	23.43	24.09	24.58	22.82	23.49	23.33	23.99	24.48
	12H	23.22	23.81	23.72	24.30	24.86	23.10	23.69	23.61	24.18	24.74
12H	4H	21.72	22.52	22.20	23.00	23.46	21.65	22.46	22.13	22.93	23.40
	6H	22.64	23.31	23.14	23.81	24.29	22.55	23.22	23.06	23.73	24.21
	8H	23.06	23.65	23.56	24.14	24.70	22.96	23.55	23.47	24.04	24.60

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2510-566-8-R2

Test Date: 10/14/2025

Luminaire Tested: 22CGTX-50-L92765-W2A-3500K

Data in this report applies to families of products including 22CGTX


Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.05

Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2510-566-8-R2
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	07/28/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	Metalux
Catalog Number:	**22CGTX-50-L92765-W2A-3500K**
Description:	*THIS IS A REVISION OF REPORT SP1-2512-566-8-R2 TO UPDATE THE CATALOG INFORMATION* 2X2 50000 Lumen CGTX TUNABLE WHITE FROM 2700K TO 6500K - 6.5 V

Spectral Parameters

CCT (K):	3550	CRI (Ra):	95.7		
CIE u':	0.2372	R1:	98.8	R9:	76.3
CIE v':	0.5029	R2:	98.1	R10:	94.9
Duv:	-0.0056	R3:	95.8	R11:	94.0
CIE x:	0.3970	R4:	95.8	R12:	83.5
CIE y:	0.3741	R5:	98.9	R13:	98.8
CIE z:	0.2289	R6:	94.8	R14:	96.6
Peak Wavelength (nm):	630	R7:	93.6	R15:	97.6
Dominant Wavelength (nm):	583	R8:	90.3		
Purity:	31.40196				
Rf:	91.7				
Rg:	102.7				

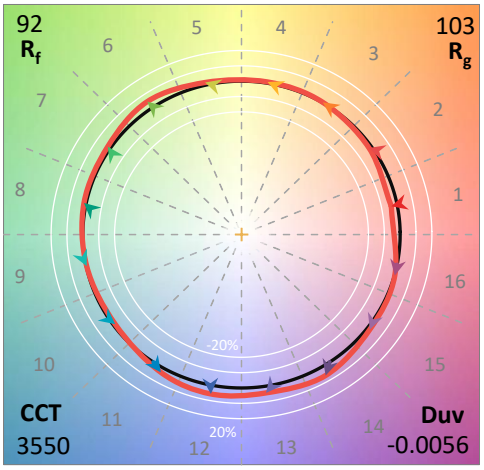

Test Conditions


Stabilization Time:	20M
Operation Time:	1H 20M
Sphere Temperature (°C):	25.0

REPORT NUMBER: SP1-2510-566-8-R2


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2510-566-8-R2

CIE 1931 Chromaticity Diagram

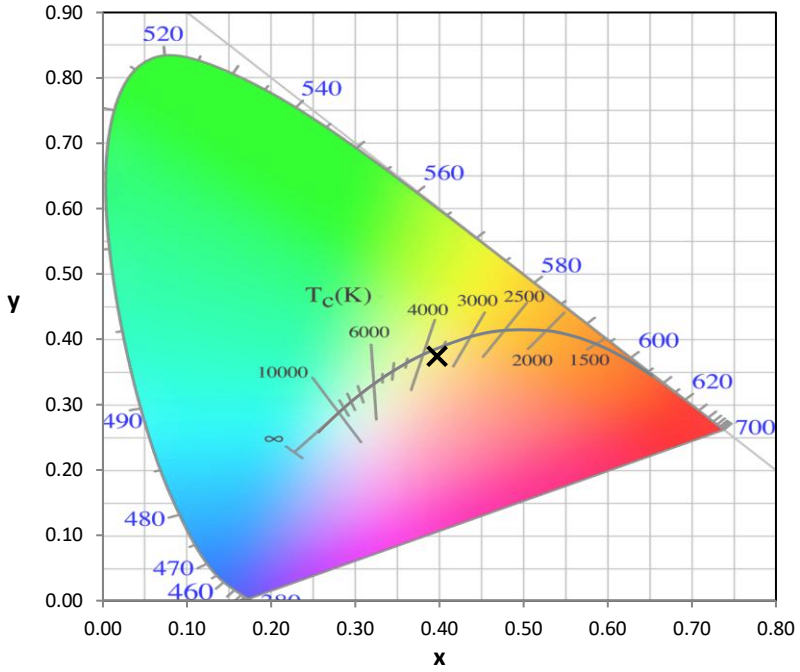

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

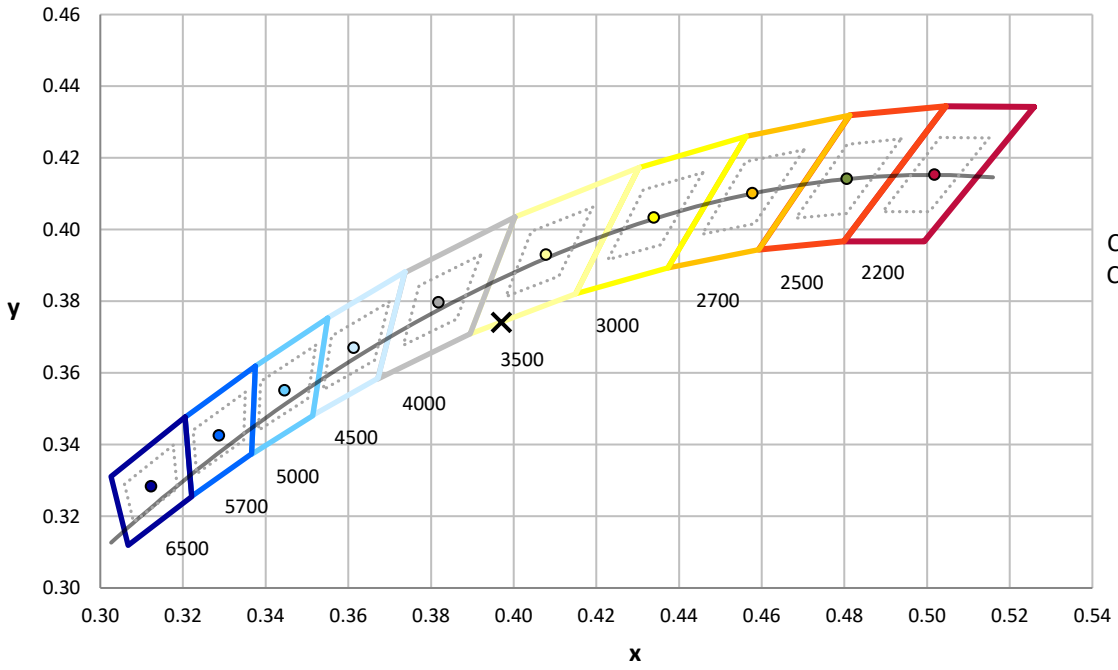


CCT = 3550K
CIE x = 0.3970
CIE y = 0.3741
Duv = -0.0056

Point lies outside the range

REPORT NUMBER: SP1-2510-566-8-R2

Photopic Flux vs. Wavelength

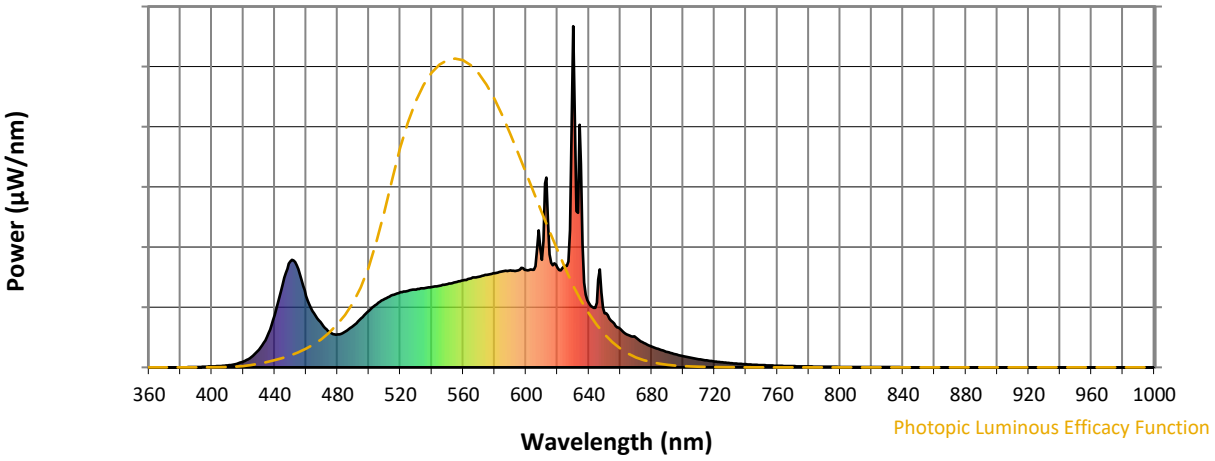


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	122	NR	620	291	NR	750	7	NR	880	0	NR
365	0	NR	495	143	NR	625	297	NR	755	6	NR	885	0	NR
370	0	NR	500	166	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	185	NR	635	596	NR	765	4	NR	895	0	NR
380	0	NR	510	201	NR	640	188	NR	770	3	NR	900	0	NR
385	1	NR	515	212	NR	645	189	NR	775	3	NR	905	0	NR
390	1	NR	520	220	NR	650	159	NR	780	3	NR	910	0	NR
395	2	NR	525	224	NR	655	133	NR	785	2	NR	915	0	NR
400	3	NR	530	228	NR	660	113	NR	790	2	NR	920	0	NR
405	4	NR	535	232	NR	665	95	NR	795	2	NR	925	0	NR
410	6	NR	540	236	NR	670	87	NR	800	1	NR	930	0	NR
415	10	NR	545	239	NR	675	71	NR	805	1	NR	935	0	NR
420	17	NR	550	244	NR	680	61	NR	810	1	NR	940	0	NR
425	30	NR	555	250	NR	685	53	NR	815	1	NR	945	0	NR
430	52	NR	560	255	NR	690	45	NR	820	1	NR	950	0	NR
435	89	NR	565	261	NR	695	39	NR	825	1	NR	955	0	NR
440	153	NR	570	265	NR	700	33	NR	830	1	NR	960	0	NR
445	243	NR	575	271	NR	705	28	NR	835	1	NR	965	0	NR
450	311	NR	580	276	NR	710	24	NR	840	0	NR	970	0	NR
455	288	NR	585	281	NR	715	20	NR	845	0	NR	975	0	NR
460	209	NR	590	285	NR	720	17	NR	850	0	NR	980	0	NR
465	158	NR	595	284	NR	725	15	NR	855	0	NR	985	0	NR
470	127	NR	600	285	NR	730	12	NR	860	0	NR	990	0	NR
475	103	NR	605	286	NR	735	11	NR	865	0	NR	995	0	NR
480	96	NR	610	315	NR	740	9	NR	870	0	NR	1000	0	NR
485	105	NR	615	332	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2510-566-8-R2

Scotopic Flux vs. Wavelength

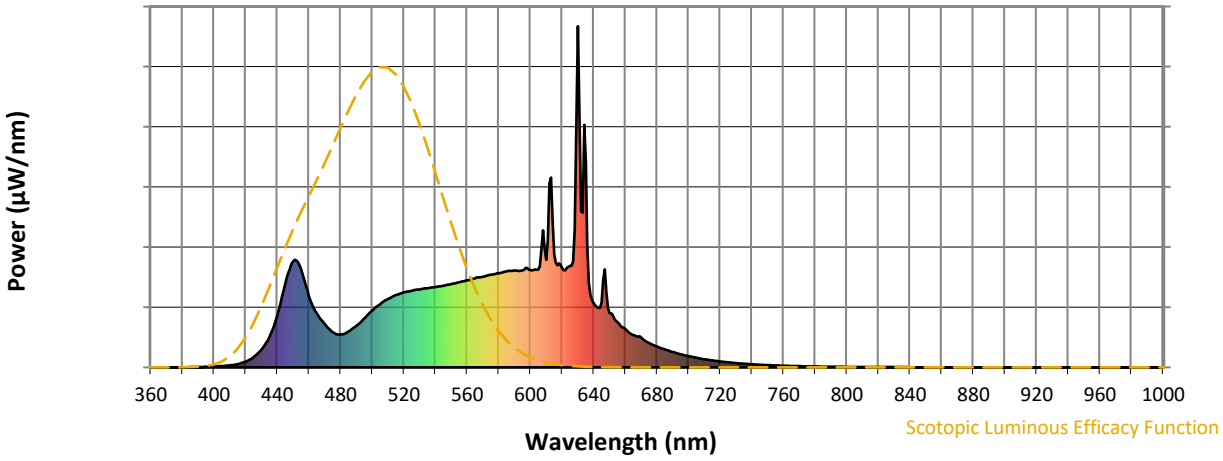


Scotopic Lumens: NR **S/P: 1.67**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	122	NR	620	291	NR	750	7	NR	880	0	NR
365	0	NR	495	143	NR	625	297	NR	755	6	NR	885	0	NR
370	0	NR	500	166	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	185	NR	635	596	NR	765	4	NR	895	0	NR
380	0	NR	510	201	NR	640	188	NR	770	3	NR	900	0	NR
385	1	NR	515	212	NR	645	189	NR	775	3	NR	905	0	NR
390	1	NR	520	220	NR	650	159	NR	780	3	NR	910	0	NR
395	2	NR	525	224	NR	655	133	NR	785	2	NR	915	0	NR
400	3	NR	530	228	NR	660	113	NR	790	2	NR	920	0	NR
405	4	NR	535	232	NR	665	95	NR	795	2	NR	925	0	NR
410	6	NR	540	236	NR	670	87	NR	800	1	NR	930	0	NR
415	10	NR	545	239	NR	675	71	NR	805	1	NR	935	0	NR
420	17	NR	550	244	NR	680	61	NR	810	1	NR	940	0	NR
425	30	NR	555	250	NR	685	53	NR	815	1	NR	945	0	NR
430	52	NR	560	255	NR	690	45	NR	820	1	NR	950	0	NR
435	89	NR	565	261	NR	695	39	NR	825	1	NR	955	0	NR
440	153	NR	570	265	NR	700	33	NR	830	1	NR	960	0	NR
445	243	NR	575	271	NR	705	28	NR	835	1	NR	965	0	NR
450	311	NR	580	276	NR	710	24	NR	840	0	NR	970	0	NR
455	288	NR	585	281	NR	715	20	NR	845	0	NR	975	0	NR
460	209	NR	590	285	NR	720	17	NR	850	0	NR	980	0	NR
465	158	NR	595	284	NR	725	15	NR	855	0	NR	985	0	NR
470	127	NR	600	285	NR	730	12	NR	860	0	NR	990	0	NR
475	103	NR	605	286	NR	735	11	NR	865	0	NR	995	0	NR
480	96	NR	610	315	NR	740	9	NR	870	0	NR	1000	0	NR
485	105	NR	615	332	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2510-566-8-R2

Melanopic Flux vs. Wavelength

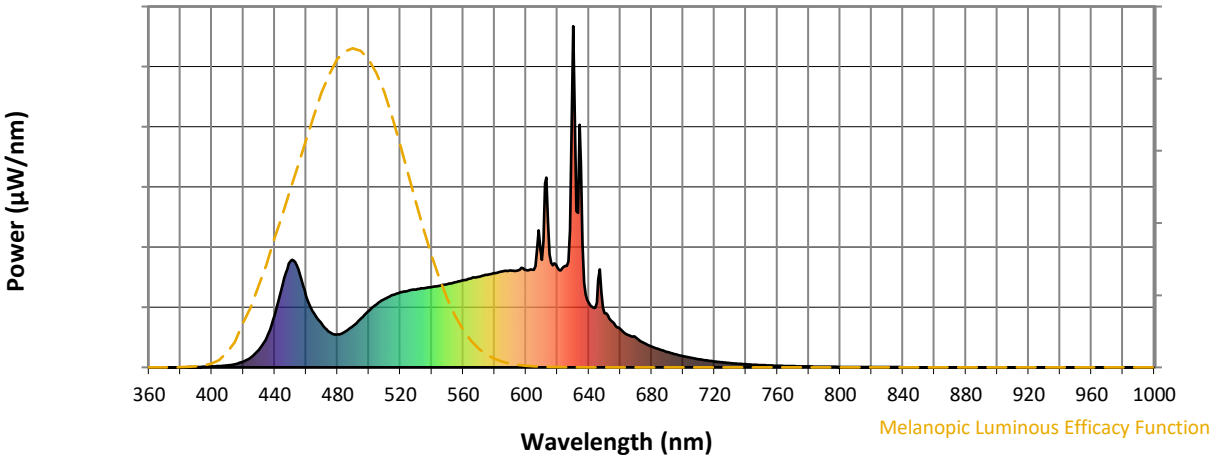

Melanopic Lumens: NR **M/P: 3.45**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	122	NR	620	291	NR	750	7	NR	880	0	NR
365	0	NR	495	143	NR	625	297	NR	755	6	NR	885	0	NR
370	0	NR	500	166	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	185	NR	635	596	NR	765	4	NR	895	0	NR
380	0	NR	510	201	NR	640	188	NR	770	3	NR	900	0	NR
385	1	NR	515	212	NR	645	189	NR	775	3	NR	905	0	NR
390	1	NR	520	220	NR	650	159	NR	780	3	NR	910	0	NR
395	2	NR	525	224	NR	655	133	NR	785	2	NR	915	0	NR
400	3	NR	530	228	NR	660	113	NR	790	2	NR	920	0	NR
405	4	NR	535	232	NR	665	95	NR	795	2	NR	925	0	NR
410	6	NR	540	236	NR	670	87	NR	800	1	NR	930	0	NR
415	10	NR	545	239	NR	675	71	NR	805	1	NR	935	0	NR
420	17	NR	550	244	NR	680	61	NR	810	1	NR	940	0	NR
425	30	NR	555	250	NR	685	53	NR	815	1	NR	945	0	NR
430	52	NR	560	255	NR	690	45	NR	820	1	NR	950	0	NR
435	89	NR	565	261	NR	695	39	NR	825	1	NR	955	0	NR
440	153	NR	570	265	NR	700	33	NR	830	1	NR	960	0	NR
445	243	NR	575	271	NR	705	28	NR	835	1	NR	965	0	NR
450	311	NR	580	276	NR	710	24	NR	840	0	NR	970	0	NR
455	288	NR	585	281	NR	715	20	NR	845	0	NR	975	0	NR
460	209	NR	590	285	NR	720	17	NR	850	0	NR	980	0	NR
465	158	NR	595	284	NR	725	15	NR	855	0	NR	985	0	NR
470	127	NR	600	285	NR	730	12	NR	860	0	NR	990	0	NR
475	103	NR	605	286	NR	735	11	NR	865	0	NR	995	0	NR
480	96	NR	610	315	NR	740	9	NR	870	0	NR	1000	0	NR
485	105	NR	615	332	NR	745	8	NR	875	0	NR			


REPORT NUMBER: SP1-2510-566-8-R2

TM-30-18


Summary


R_f = 91.7
R_g = 102.7
CIE R_a = 95.7
R_9 = 76.3


Spectral Power Distribution Comparison

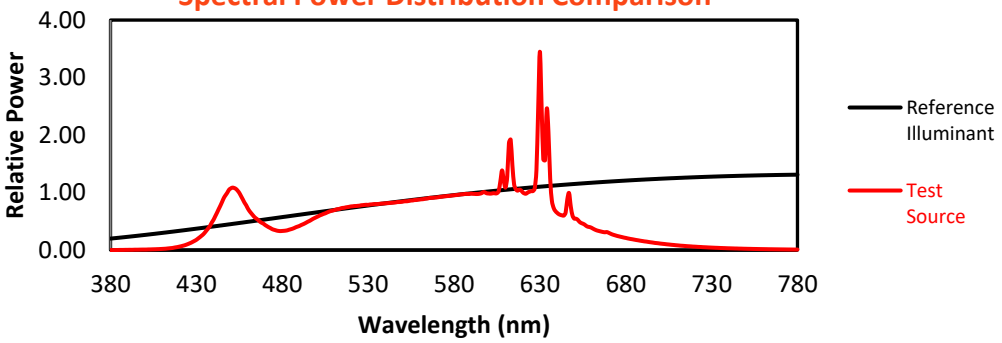


Color Vector Graphics

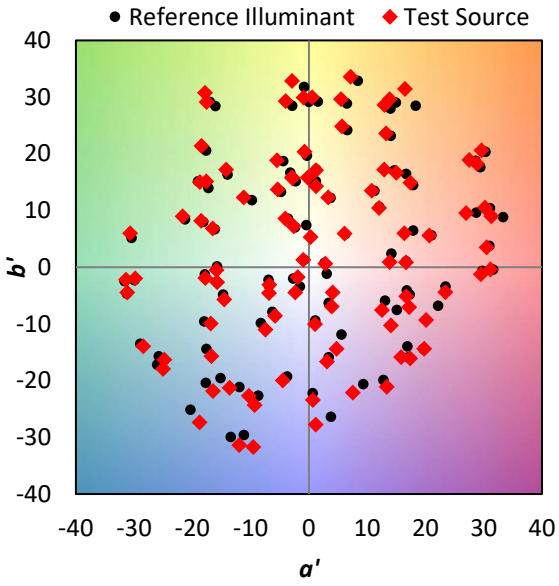

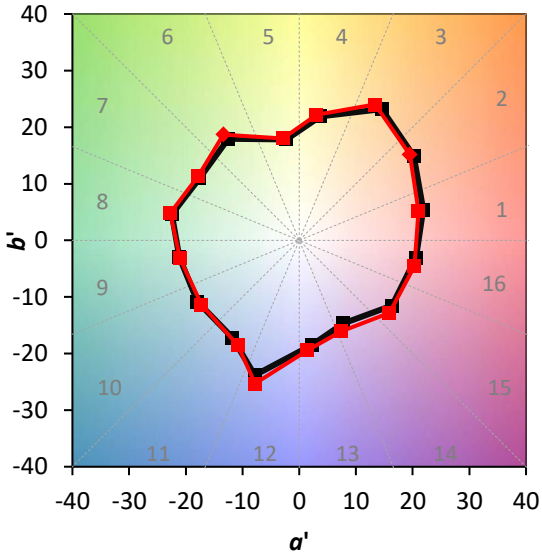

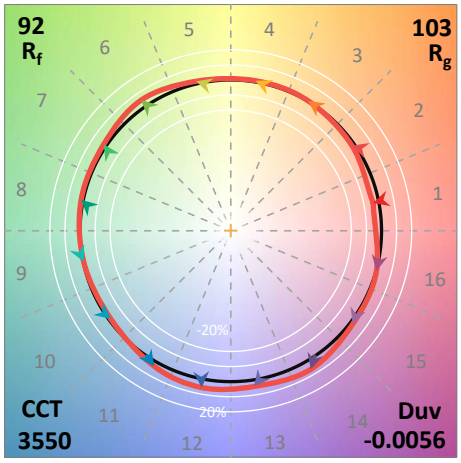

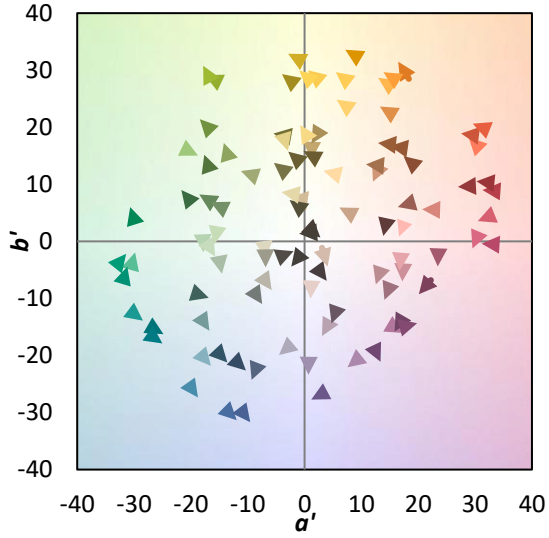


REPORT NUMBER: SP1-2510-566-8-R2

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 86	CES26 = 91	CES51 = 97	CES76 = 86
CES02 = 62	CES27 = 94	CES52 = 95	CES77 = 87
CES03 = 31	CES28 = 95	CES53 = 94	CES78 = 82
CES04 = 70	CES29 = 92	CES54 = 96	CES79 = 92
CES05 = 50	CES30 = 99	CES55 = 95	CES80 = 92
CES06 = 51	CES31 = 92	CES56 = 97	CES81 = 79
CES07 = 43	CES32 = 84	CES57 = 97	CES82 = 96
CES08 = 42	CES33 = 94	CES58 = 97	CES83 = 95
CES09 = 29	CES34 = 90	CES59 = 99	CES84 = 95
CES10 = 75	CES35 = 94	CES60 = 94	CES85 = 82
CES11 = 58	CES36 = 85	CES61 = 94	CES86 = 84
CES12 = 64	CES37 = 92	CES62 = 91	CES87 = 91
CES13 = 44	CES38 = 94	CES63 = 94	CES88 = 98
CES14 = 74	CES39 = 98	CES64 = 95	CES89 = 85
CES15 = 72	CES40 = 95	CES65 = 92	CES90 = 99
CES16 = 48	CES41 = 96	CES66 = 92	CES91 = 77
CES17 = 49	CES42 = 89	CES67 = 91	CES92 = 80
CES18 = 56	CES43 = 87	CES68 = 90	CES93 = 88
CES19 = 71	CES44 = 99	CES69 = 91	CES94 = 78
CES20 = 67	CES45 = 92	CES70 = 87	CES95 = 85
CES21 = 86	CES46 = 94	CES71 = 84	CES96 = 93
CES22 = 78	CES47 = 90	CES72 = 94	CES97 = 93
CES23 = 91	CES48 = 98	CES73 = 82	CES98 = 95
CES24 = 90	CES49 = 91	CES74 = 91	CES99 = 97
CES25 = 71	CES50 = 97	CES75 = 85	

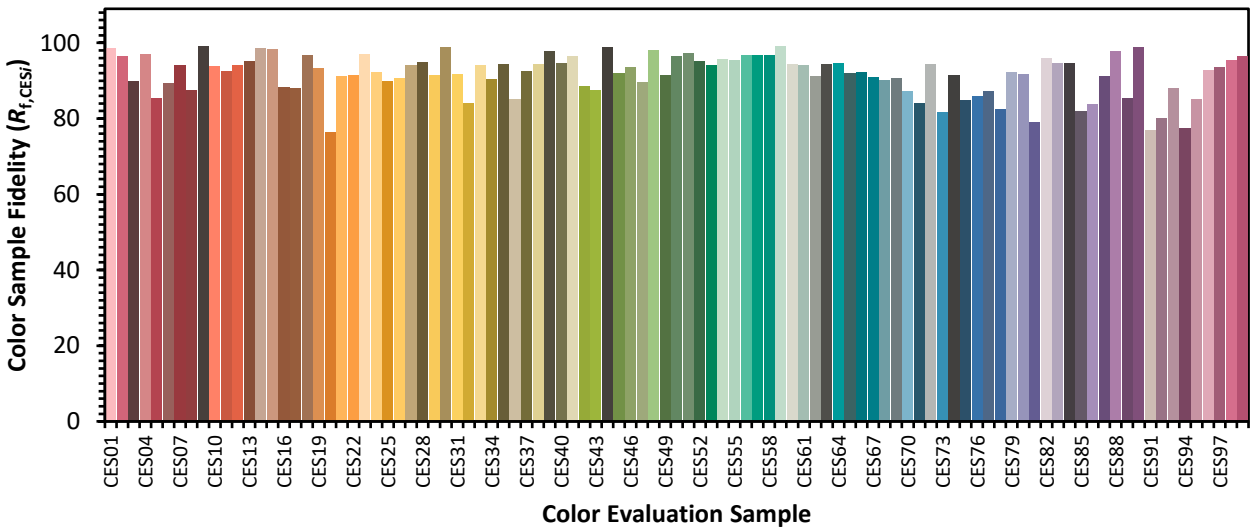



REPORT NUMBER: SP1-2510-566-8-R2

TM-30-18

Color Rendition by Hue-Angle Bin

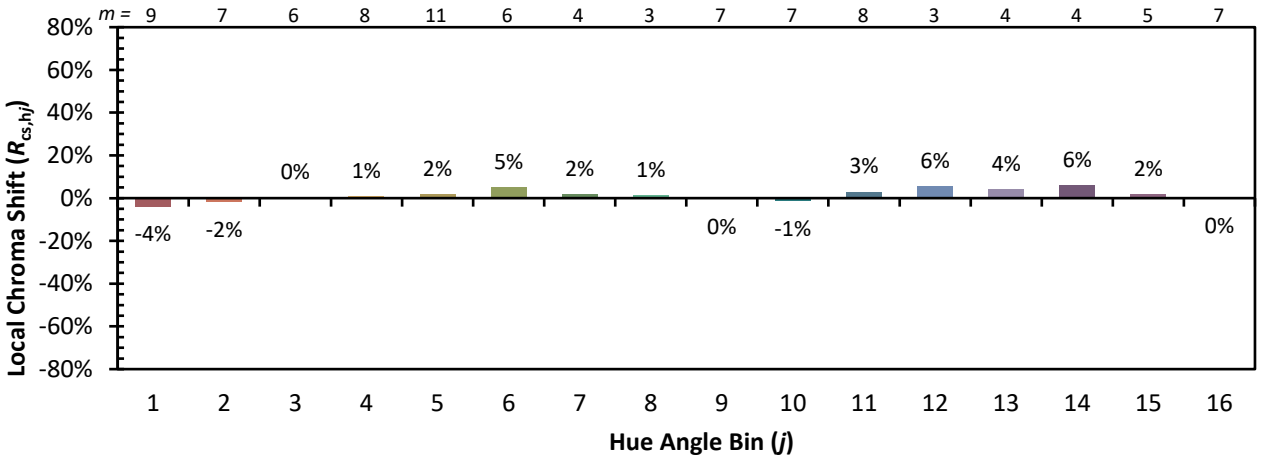

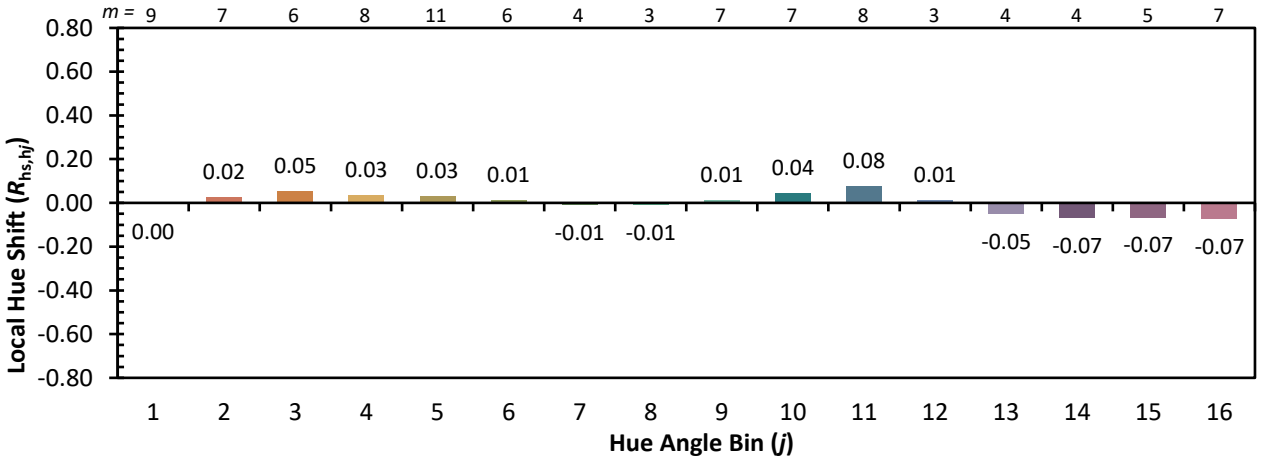


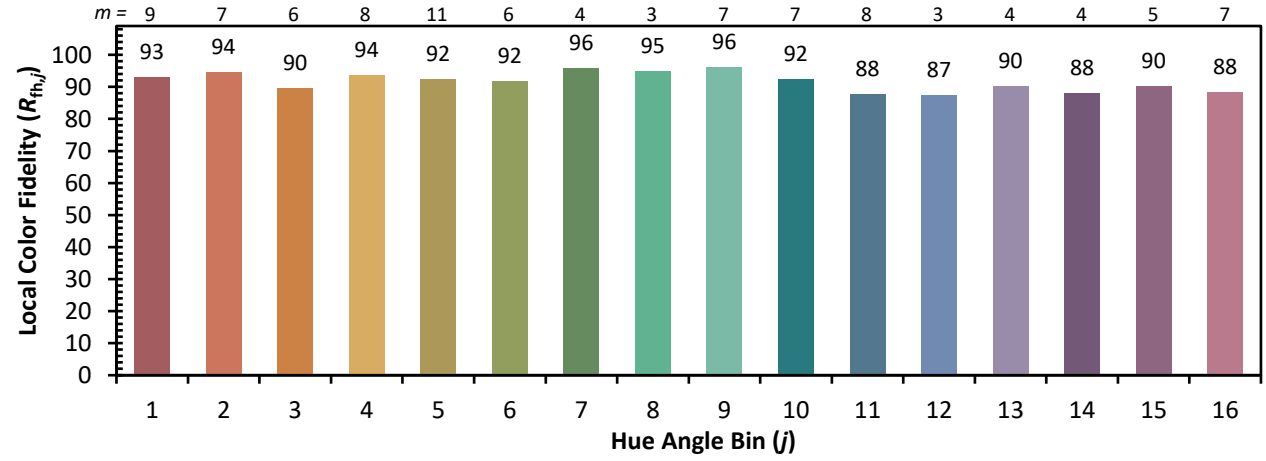


REPORT NUMBER: SP1-2510-566-8-R2

TM-30-18

Measure Comparisons

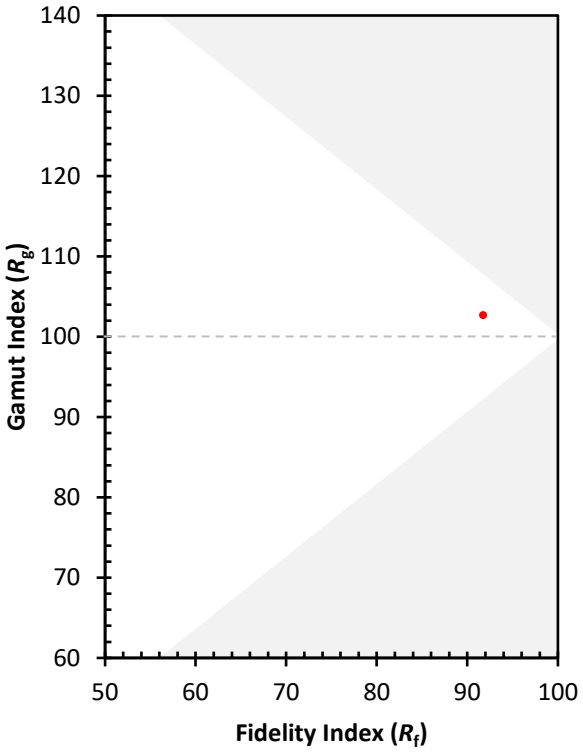

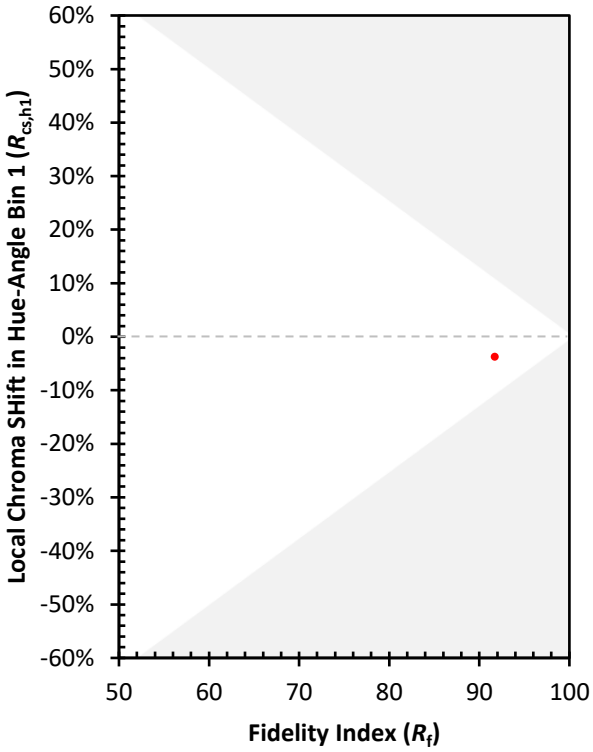

(END OF REPORT)