Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: METALUX

Report Number: P1590757

Luminaire Tested: 22CGTX-50-L92765-W2A-5000K

Issue Date: 9/7/2026

Report Generated By 670265710 / DESKTOP-98SHLC4

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-2019
Report Number:	P1590757
	TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G2-2510-566-1)
Test Lab:	COOPER LIGHTING SOLUTIONS
Issue Date:	9/7/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	METALUX
Catalog Number:	22CGTX-50-L92765-W2A-5000K
Description:	2X2 5000 LUMEN CGTX TROFFER WITH VividTune LEDS AT 5000K CCT WITH FROSTED SMOOTH LENS
Light Source:	5000K CCT, 90 CRI LEDS
Ballast/Driver:	-

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	5632.0 lumens
Efficiency:	N/A
Efficacy:	105.7 lumens/watt
Spacing Criteria (0/90/45):	1.26 / 1.26 / 1.38
Luminous Opening:	Rectangular (W 2' x L: 2' x H: 0')
CIE Type:	Direct
Input Watts (W):	53.3
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	NR
Total Harmonic Distortion (THDi):	NR
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	24 FT




Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590757
CATALOG NUMBER: 22CGTX-50-L92765-W2A-5000K

Luminous Intensity Polar Plot

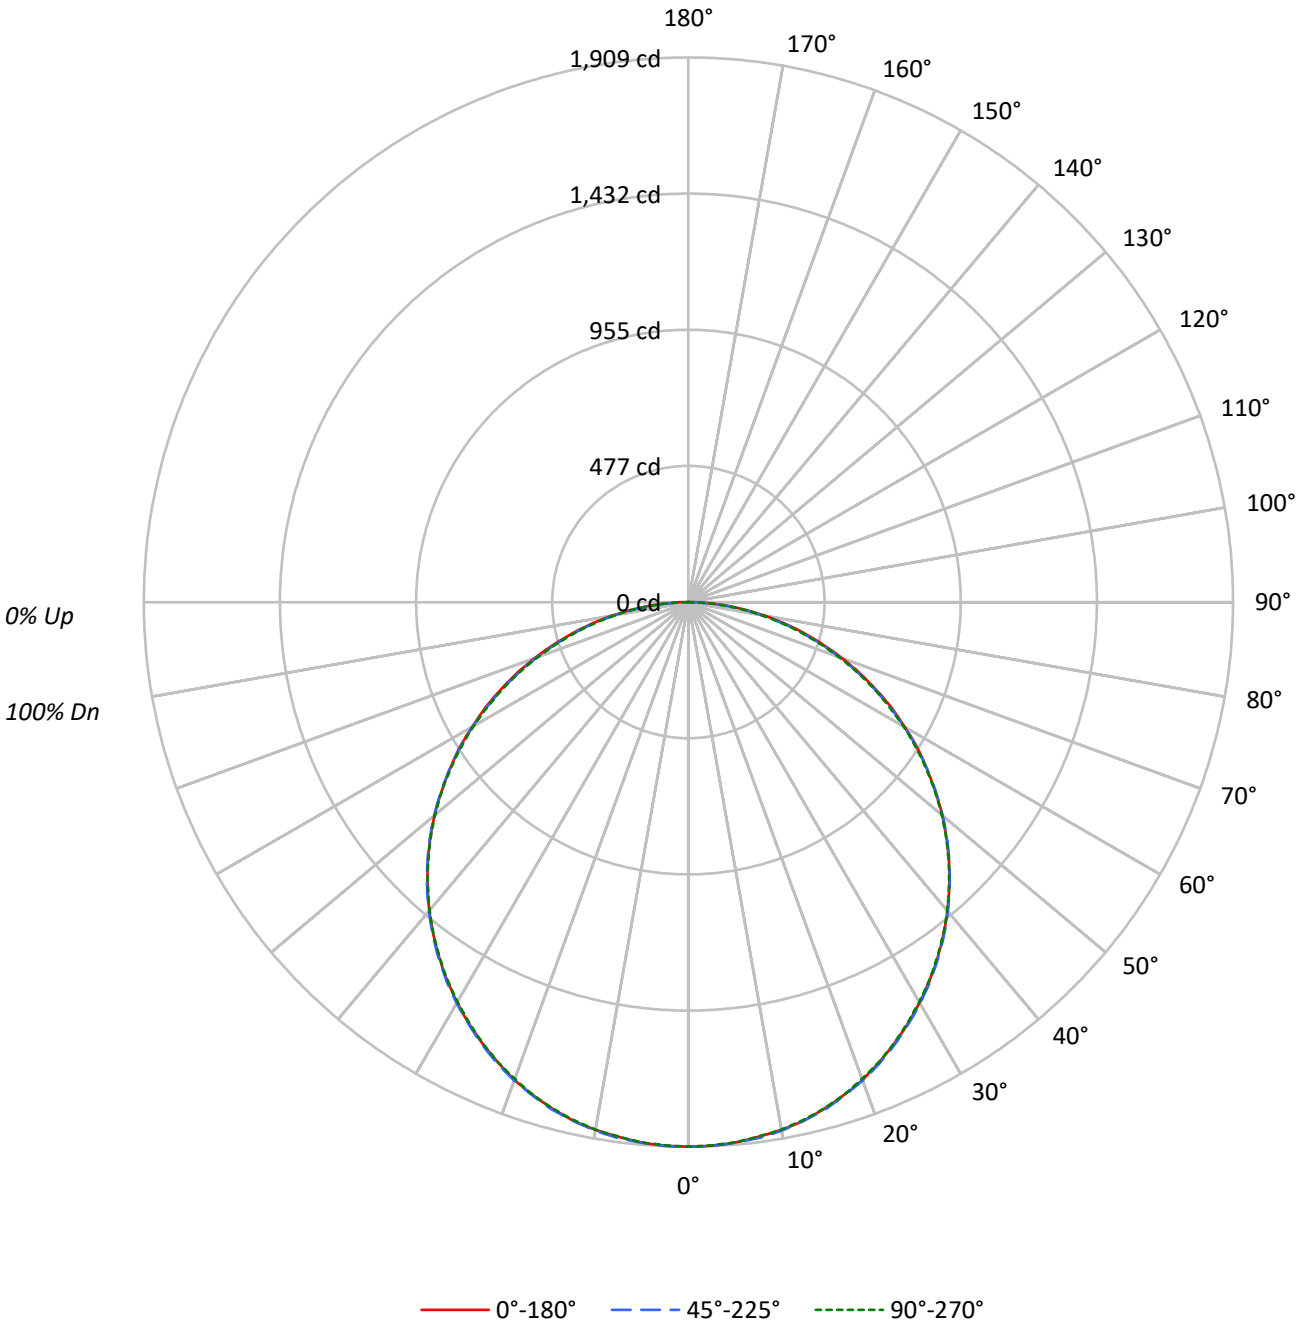

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590757
CATALOG NUMBER: 22CGTX-50-L92765-W2A-5000K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20			20			20			20
RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	108	103	99	95	106	101	97	93	97	93	90	93	90	88	89	87	85	83
2	98	90	83	77	96	88	81	76	84	79	74	81	76	72	78	74	71	69
3	89	79	70	64	87	77	69	63	74	67	62	71	65	61	69	64	60	57
4	82	69	60	54	79	68	60	53	66	58	52	63	57	52	61	56	51	49
5	75	62	53	46	73	61	52	46	59	51	45	57	50	45	55	49	44	42
6	69	56	47	40	67	55	46	40	53	45	40	51	44	39	50	44	39	37
7	64	50	42	35	62	50	41	35	48	40	35	47	40	35	45	39	34	32
8	60	46	37	31	58	45	37	31	44	37	31	43	36	31	42	35	31	29
9	56	42	34	28	54	42	34	28	40	33	28	39	33	28	38	32	28	26
10	52	39	31	26	51	38	31	26	37	30	25	36	30	25	36	30	25	23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5137	5137	5137
5°	5136	5139	5134
10°	5133	5141	5130
15°	5122	5134	5119
20°	5105	5111	5093
25°	5069	5081	5065
30°	5037	5046	5027
35°	5000	5010	4993
40°	4963	4970	4955
45°	4916	4924	4912
50°	4863	4867	4854
55°	4789	4793	4774
60°	4707	4696	4679
65°	4618	4578	4558
70°	4499	4441	4400
75°	4350	4262	4218
80°	4153	4007	3975
85°	3829	3603	3569

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°
Vertical Angle: 45°
Luminance: 4928 cd/sqm

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590757
CATALOG NUMBER: 22CGTX-50-L92765-W2A-5000K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	180.8	3.2
10°-20°	519.2	9.2
20°-30°	787.5	14.0
30°-40°	953.0	16.9
40°-50°	996.9	17.7
50°-60°	912.5	16.2
60°-70°	712.9	12.7
70°-80°	434.9	7.7
80°-90°	134.2	2.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1487.6	26.4
0°-40°	2440.6	43.3
0°-60°	4350.0	77.2
0°-90°	5632.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5632.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1909	1909	1909	1909	1909	
5°	1902	1902	1903	1903	1900	181
15°	1838	1841	1843	1841	1837	519
25°	1707	1709	1711	1708	1706	787
35°	1522	1524	1525	1521	1520	952
45°	1292	1295	1294	1291	1291	996
55°	1021	1025	1022	1019	1018	913
65°	725	723	719	718	716	718
75°	418	415	410	410	406	442
85°	124	122	117	120	116	139
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590757
CATALOG NUMBER: 22CGTX-50-L92765-W2A-5000K

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1908.9	1908.9	1908.9	*1908.9*	1908.9
2.5°	*1906.8*	*1908.9*	*1907.8*	*1909.9*	*1905.7*
5°	1901.5	1901.5	1902.6	*1902.6*	1900.5
7.5°	1890.0	1892.1	1894.2	*1892.1*	1888.9
10°	1878.4	1879.4	1881.5	*1879.4*	1877.3
12.5°	1862.6	1862.6	1862.6	*1862.6*	1859.5
15°	1838.5	1840.6	1842.7	*1840.6*	1837.4
17.5°	1812.2	1813.2	1814.3	*1813.2*	1811.1
20°	1782.7	1782.7	1784.8	*1781.7*	1778.5
22.5°	1746.0	1748.1	1750.2	*1747.0*	1744.9
25°	1707.1	1709.2	1711.3	*1708.1*	1706.0
27.5°	1666.1	1667.1	1668.2	*1665.0*	1662.9
30°	1620.9	1620.9	1624.0	*1620.9*	1617.7
32.5°	1573.6	1575.7	1576.7	*1572.5*	1571.5
35°	1522.1	1524.2	1525.2	*1521.0*	1520.0
37.5°	1468.4	1471.6	1471.6	*1469.5*	1467.4
40°	1412.7	1415.9	1414.8	*1410.6*	1410.6
42.5°	1352.8	1357.0	1356.0	*1352.8*	1351.8
45°	1291.9	1295.0	1294.0	*1290.8*	1290.8
47.5°	1227.7	1230.9	1229.8	*1225.6*	1225.6
50°	1161.5	1163.6	1162.6	*1159.4*	1159.4
52.5°	1091.1	1095.3	1093.2	*1091.1*	1089.0
55°	1020.7	1024.9	1021.7	*1018.6*	1017.5
57.5°	952.3	950.2	949.2	*946.0*	943.9
60°	874.6	876.7	872.5	*871.4*	869.3
62.5°	803.1	801.0	796.8	*794.7*	792.6
65°	725.3	723.2	719.0	*717.9*	715.8
67.5°	649.6	647.5	642.2	*640.1*	638.0
70°	571.8	569.7	564.5	*562.4*	559.2
72.5°	494.0	493.0	484.6	*484.6*	481.4
75°	418.4	415.2	409.9	*409.9*	405.7
77.5°	341.6	339.5	333.2	*335.3*	329.0
80°	268.0	264.9	258.6	*261.7*	256.5
82.5°	193.4	191.3	186.1	*188.2*	184.0
85°	124.0	121.9	116.7	*119.8*	115.6
87.5°	57.8	55.7	51.5	*55.7*	51.5
90°	0.0	0.0	0.0	*0.0*	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

TEST NUMBER: P1590757
CATALOG NUMBER: 22CGTX-50-L92765-W2A-5000K

CIE UGR TABLE:

Reflectances:											
	Ceiling	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
	Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
	Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	17.64	19.30	18.00	19.61	19.93	17.60	19.26	17.97	19.58	19.89
	3H	19.58	21.09	19.95	21.41	21.77	19.51	21.02	19.89	21.34	21.70
	4H	20.35	21.77	20.74	22.12	22.49	20.26	21.68	20.65	22.03	22.40
	6H	20.96	22.28	21.37	22.64	23.03	20.84	22.16	21.25	22.53	22.92
	8H	21.17	22.43	21.59	22.82	23.22	21.04	22.31	21.47	22.70	23.09
	12H	21.32	22.53	21.75	22.92	23.34	21.19	22.40	21.62	22.78	23.21
4H	2H	18.30	19.72	18.70	20.07	20.44	18.27	19.69	18.67	20.04	20.41
	3H	20.47	21.67	20.88	22.06	22.46	20.41	21.60	20.82	22.00	22.40
	4H	21.38	22.46	21.81	22.87	23.31	21.30	22.38	21.73	22.79	23.23
	6H	22.13	23.08	22.58	23.52	23.97	22.03	22.98	22.48	23.42	23.87
	8H	22.40	23.29	22.86	23.73	24.19	22.28	23.18	22.74	23.62	24.08
	12H	22.61	23.41	23.09	23.88	24.35	22.48	23.28	22.96	23.76	24.22
8H	4H	21.73	22.62	22.19	23.06	23.52	21.66	22.55	22.12	22.99	23.46
	6H	22.62	23.36	23.11	23.85	24.32	22.53	23.27	23.02	23.76	24.23
	8H	22.97	23.64	23.48	24.15	24.63	22.87	23.54	23.38	24.05	24.53
	12H	23.27	23.86	23.78	24.35	24.91	23.16	23.75	23.66	24.24	24.80
12H	4H	21.77	22.58	22.25	23.05	23.52	21.71	22.51	22.19	22.99	23.45
	6H	22.69	23.36	23.20	23.86	24.35	22.61	23.28	23.11	23.78	24.26
	8H	23.11	23.70	23.62	24.19	24.75	23.02	23.61	23.52	24.10	24.66

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2510-566-13-R2

Test Date: 10/14/2025

Luminaire Tested: 22CGTX-50-L92765-W2A-5000K

Data in this report applies to families of products including 22CGTX


Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.05

Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2510-566-13-R2
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	07/28/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	Metalux
Catalog Number:	**22CGTX-50-L92765-W2A-5000K**
Description:	*THIS IS A REVISION OF REPORT SP1-2512-566-13-R2 TO UPDATE THE CATALOG INFORMATION*2X2 50000 Lumen CGTX TUNABLE WHITE FROM 2700K TO 6500K - 4 V

Spectral Parameters

CCT (K):	4816	CRI (Ra):	95.9		
CIE u':	0.2166	R1:	97.7	R9:	83.7
CIE v':	0.4824	R2:	98.1	R10:	93.6
Duv:	-0.0047	R3:	94.7	R11:	96.0
CIE x:	0.3493	R4:	97.7	R12:	71.1
CIE y:	0.3457	R5:	96.5	R13:	99.1
CIE z:	0.3051	R6:	93.1	R14:	96.3
Peak Wavelength (nm):	630	R7:	95.9	R15:	97.4
Dominant Wavelength (nm):	581	R8:	93.8		
Purity:	8.50802				
Rf:	90.9				
Rg:	101.8				

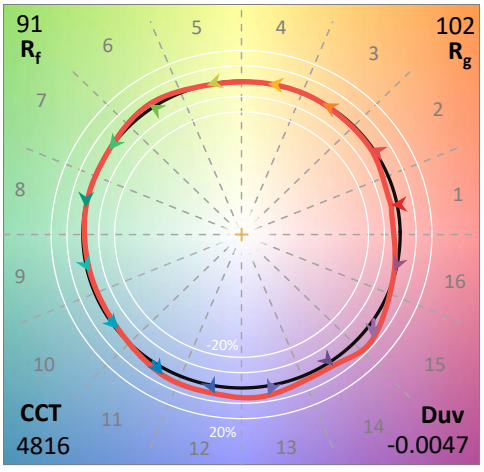

Test Conditions


Stabilization Time:	20M
Operation Time:	1H 20M
Sphere Temperature (°C):	25.0

REPORT NUMBER: SP1-2510-566-13-R2


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2510-566-13-R2

CIE 1931 Chromaticity Diagram

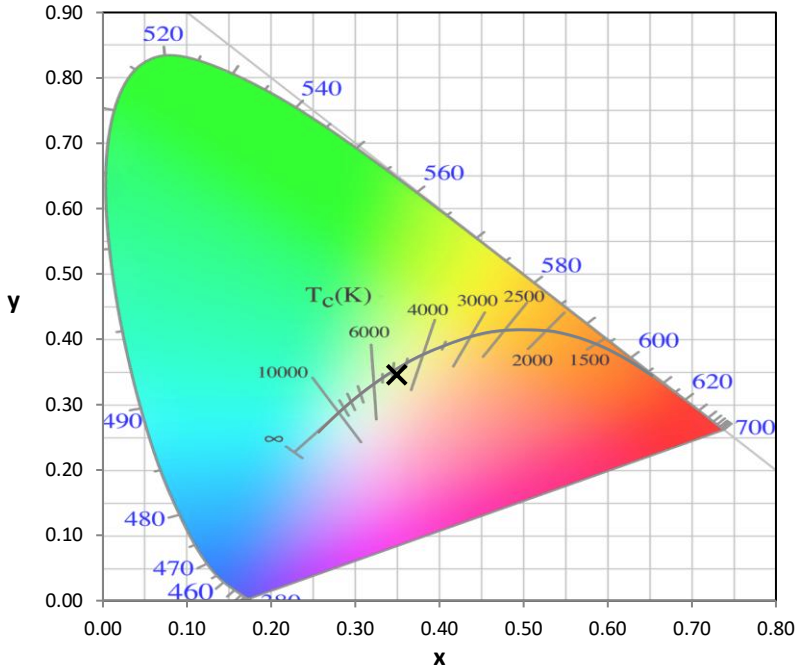

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

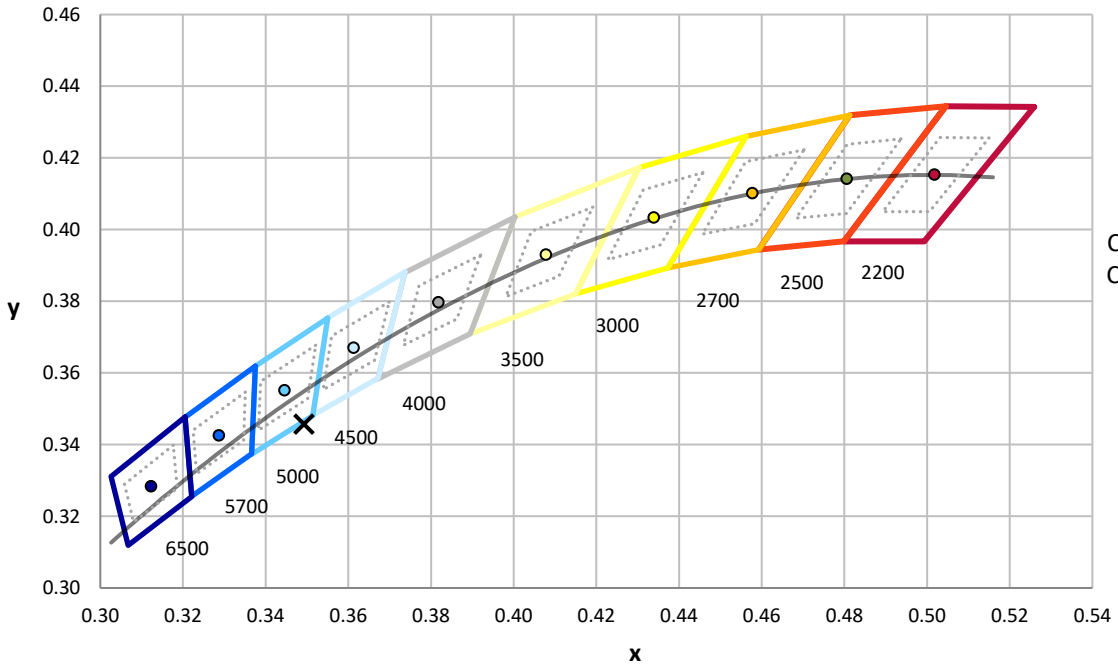


CCT = 4816K
CIE x = 0.3493
CIE y = 0.3457
Duv = -0.0047

Point lies outside the range

REPORT NUMBER: SP1-2510-566-13-R2

Photopic Flux vs. Wavelength

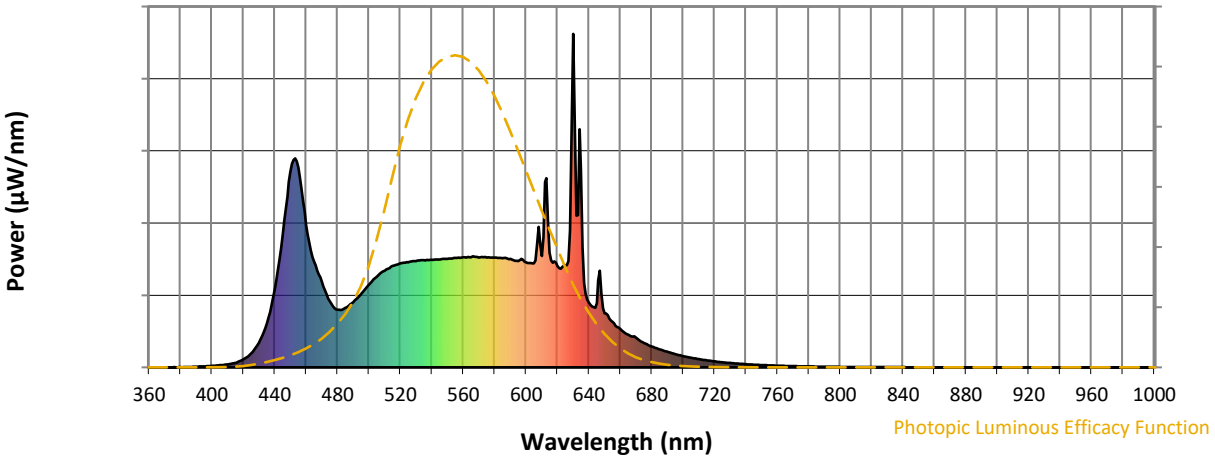


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	196	NR	620	303	NR	750	7	NR	880	0	NR
365	0	NR	495	220	NR	625	307	NR	755	6	NR	885	0	NR
370	0	NR	500	248	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	272	NR	635	591	NR	765	4	NR	895	0	NR
380	1	NR	510	290	NR	640	194	NR	770	4	NR	900	0	NR
385	1	NR	515	305	NR	645	193	NR	775	3	NR	905	0	NR
390	2	NR	520	312	NR	650	162	NR	780	3	NR	910	0	NR
395	3	NR	525	315	NR	655	136	NR	785	2	NR	915	0	NR
400	4	NR	530	318	NR	660	115	NR	790	2	NR	920	0	NR
405	6	NR	535	321	NR	665	98	NR	795	2	NR	925	0	NR
410	8	NR	540	323	NR	670	90	NR	800	1	NR	930	0	NR
415	14	NR	545	324	NR	675	73	NR	805	1	NR	935	0	NR
420	24	NR	550	326	NR	680	63	NR	810	1	NR	940	0	NR
425	42	NR	555	329	NR	685	54	NR	815	1	NR	945	0	NR
430	74	NR	560	330	NR	690	47	NR	820	1	NR	950	0	NR
435	133	NR	565	330	NR	695	40	NR	825	1	NR	955	0	NR
440	232	NR	570	330	NR	700	34	NR	830	1	NR	960	0	NR
445	395	NR	575	330	NR	705	29	NR	835	1	NR	965	0	NR
450	587	NR	580	330	NR	710	25	NR	840	1	NR	970	0	NR
455	600	NR	585	328	NR	715	21	NR	845	0	NR	975	0	NR
460	428	NR	590	325	NR	720	18	NR	850	0	NR	980	0	NR
465	318	NR	595	319	NR	725	15	NR	855	0	NR	985	0	NR
470	255	NR	600	315	NR	730	13	NR	860	0	NR	990	0	NR
475	199	NR	605	312	NR	735	11	NR	865	0	NR	995	0	NR
480	173	NR	610	334	NR	740	9	NR	870	0	NR	1000	0	NR
485	178	NR	615	344	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2510-566-13-R2

Scotopic Flux vs. Wavelength

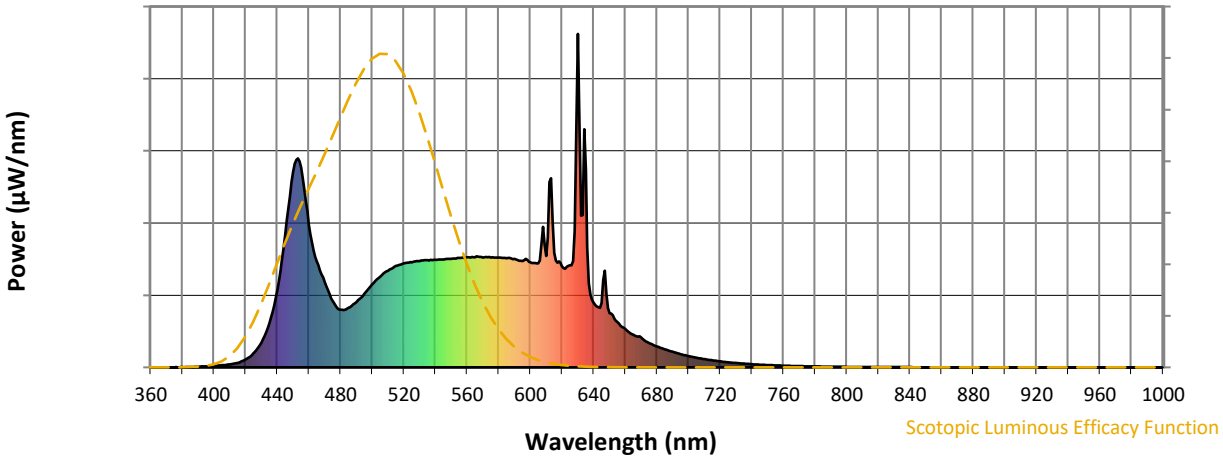


Scotopic Lumens: NR **S/P: 2.04**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	196	NR	620	303	NR	750	7	NR	880	0	NR
365	0	NR	495	220	NR	625	307	NR	755	6	NR	885	0	NR
370	0	NR	500	248	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	272	NR	635	591	NR	765	4	NR	895	0	NR
380	1	NR	510	290	NR	640	194	NR	770	4	NR	900	0	NR
385	1	NR	515	305	NR	645	193	NR	775	3	NR	905	0	NR
390	2	NR	520	312	NR	650	162	NR	780	3	NR	910	0	NR
395	3	NR	525	315	NR	655	136	NR	785	2	NR	915	0	NR
400	4	NR	530	318	NR	660	115	NR	790	2	NR	920	0	NR
405	6	NR	535	321	NR	665	98	NR	795	2	NR	925	0	NR
410	8	NR	540	323	NR	670	90	NR	800	1	NR	930	0	NR
415	14	NR	545	324	NR	675	73	NR	805	1	NR	935	0	NR
420	24	NR	550	326	NR	680	63	NR	810	1	NR	940	0	NR
425	42	NR	555	329	NR	685	54	NR	815	1	NR	945	0	NR
430	74	NR	560	330	NR	690	47	NR	820	1	NR	950	0	NR
435	133	NR	565	330	NR	695	40	NR	825	1	NR	955	0	NR
440	232	NR	570	330	NR	700	34	NR	830	1	NR	960	0	NR
445	395	NR	575	330	NR	705	29	NR	835	1	NR	965	0	NR
450	587	NR	580	330	NR	710	25	NR	840	1	NR	970	0	NR
455	600	NR	585	328	NR	715	21	NR	845	0	NR	975	0	NR
460	428	NR	590	325	NR	720	18	NR	850	0	NR	980	0	NR
465	318	NR	595	319	NR	725	15	NR	855	0	NR	985	0	NR
470	255	NR	600	315	NR	730	13	NR	860	0	NR	990	0	NR
475	199	NR	605	312	NR	735	11	NR	865	0	NR	995	0	NR
480	173	NR	610	334	NR	740	9	NR	870	0	NR	1000	0	NR
485	178	NR	615	344	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2510-566-13-R2

Melanopic Flux vs. Wavelength

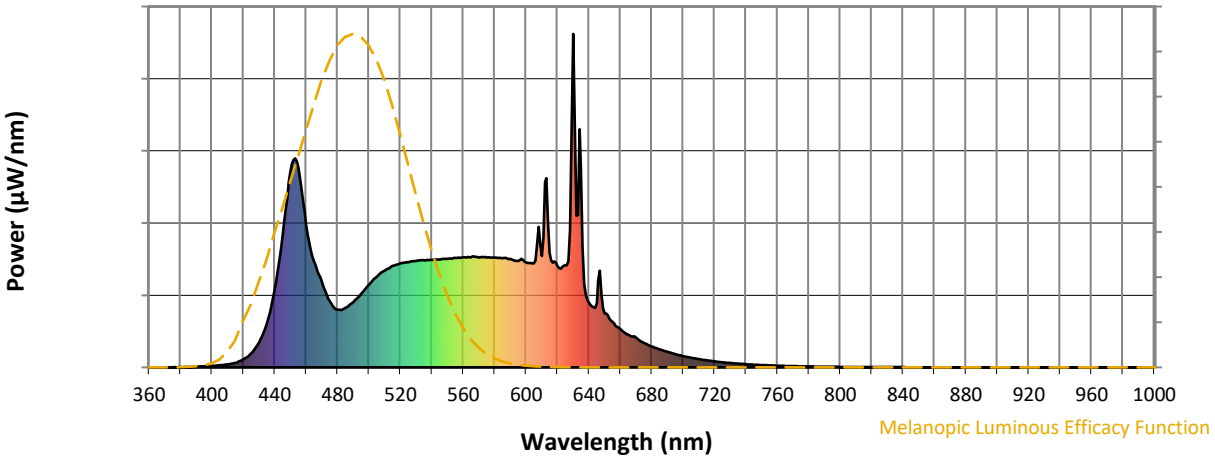

Melanopic Lumens: NR **M/P: 4.45**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	196	NR	620	303	NR	750	7	NR	880	0	NR
365	0	NR	495	220	NR	625	307	NR	755	6	NR	885	0	NR
370	0	NR	500	248	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	272	NR	635	591	NR	765	4	NR	895	0	NR
380	1	NR	510	290	NR	640	194	NR	770	4	NR	900	0	NR
385	1	NR	515	305	NR	645	193	NR	775	3	NR	905	0	NR
390	2	NR	520	312	NR	650	162	NR	780	3	NR	910	0	NR
395	3	NR	525	315	NR	655	136	NR	785	2	NR	915	0	NR
400	4	NR	530	318	NR	660	115	NR	790	2	NR	920	0	NR
405	6	NR	535	321	NR	665	98	NR	795	2	NR	925	0	NR
410	8	NR	540	323	NR	670	90	NR	800	1	NR	930	0	NR
415	14	NR	545	324	NR	675	73	NR	805	1	NR	935	0	NR
420	24	NR	550	326	NR	680	63	NR	810	1	NR	940	0	NR
425	42	NR	555	329	NR	685	54	NR	815	1	NR	945	0	NR
430	74	NR	560	330	NR	690	47	NR	820	1	NR	950	0	NR
435	133	NR	565	330	NR	695	40	NR	825	1	NR	955	0	NR
440	232	NR	570	330	NR	700	34	NR	830	1	NR	960	0	NR
445	395	NR	575	330	NR	705	29	NR	835	1	NR	965	0	NR
450	587	NR	580	330	NR	710	25	NR	840	1	NR	970	0	NR
455	600	NR	585	328	NR	715	21	NR	845	0	NR	975	0	NR
460	428	NR	590	325	NR	720	18	NR	850	0	NR	980	0	NR
465	318	NR	595	319	NR	725	15	NR	855	0	NR	985	0	NR
470	255	NR	600	315	NR	730	13	NR	860	0	NR	990	0	NR
475	199	NR	605	312	NR	735	11	NR	865	0	NR	995	0	NR
480	173	NR	610	334	NR	740	9	NR	870	0	NR	1000	0	NR
485	178	NR	615	344	NR	745	8	NR	875	0	NR			


REPORT NUMBER: SP1-2510-566-13-R2

TM-30-18


Summary


R_f = 90.9
R_g = 101.8
CIE R_a = 95.9
R_9 = 83.7


Spectral Power Distribution Comparison

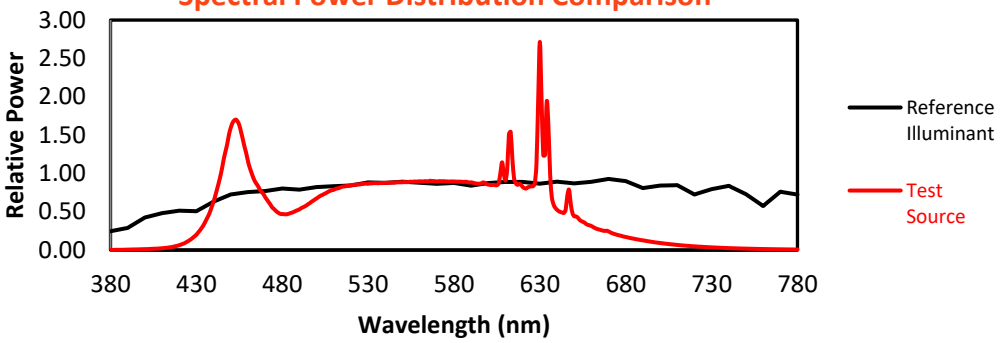


Color Vector Graphics

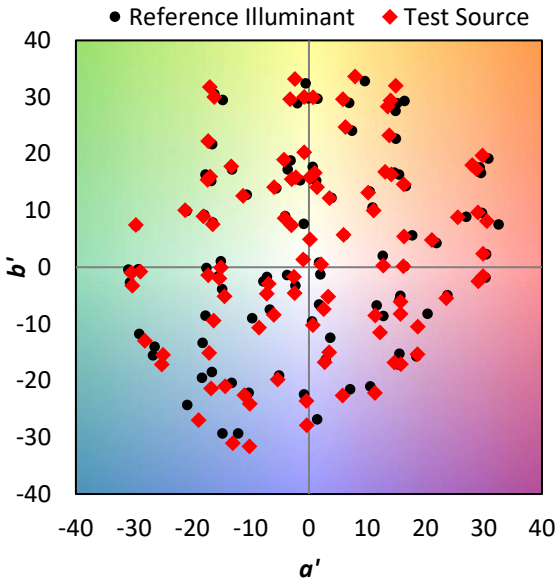

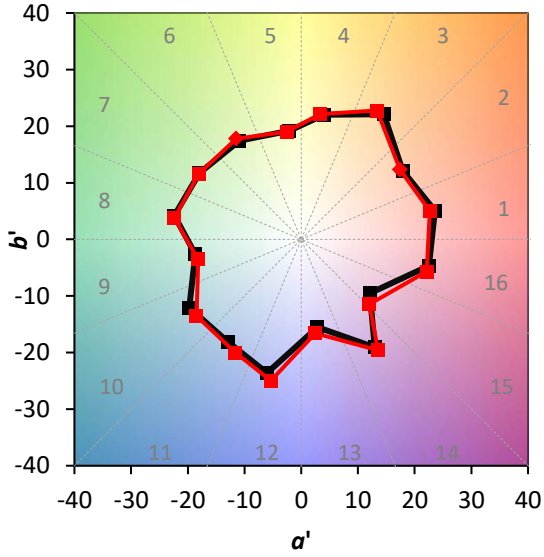

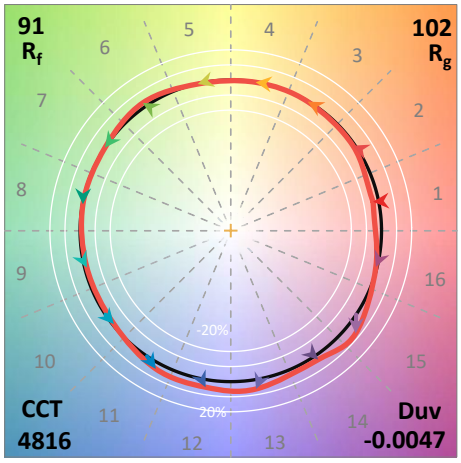

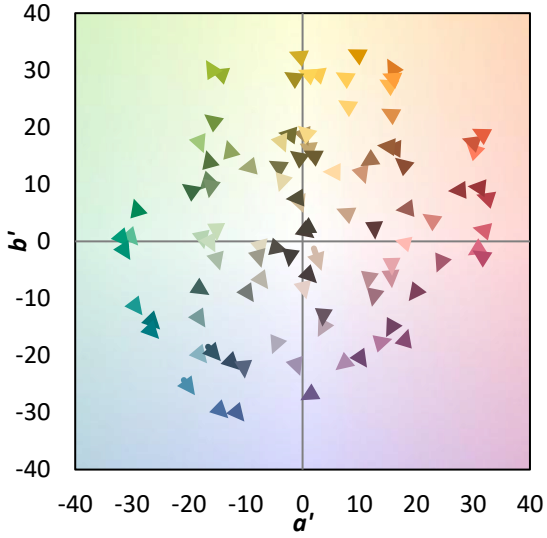


REPORT NUMBER: SP1-2510-566-13-R2

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 91	CES51 = 97	CES76 = 83
CES02 = 61	CES27 = 92	CES52 = 97	CES77 = 86
CES03 = 31	CES28 = 94	CES53 = 97	CES78 = 80
CES04 = 69	CES29 = 95	CES54 = 93	CES79 = 94
CES05 = 48	CES30 = 93	CES55 = 91	CES80 = 91
CES06 = 50	CES31 = 95	CES56 = 95	CES81 = 84
CES07 = 41	CES32 = 86	CES57 = 94	CES82 = 96
CES08 = 40	CES33 = 99	CES58 = 94	CES83 = 96
CES09 = 29	CES34 = 90	CES59 = 97	CES84 = 92
CES10 = 74	CES35 = 94	CES60 = 92	CES85 = 83
CES11 = 56	CES36 = 81	CES61 = 91	CES86 = 88
CES12 = 62	CES37 = 92	CES62 = 85	CES87 = 91
CES13 = 43	CES38 = 88	CES63 = 92	CES88 = 97
CES14 = 74	CES39 = 99	CES64 = 89	CES89 = 88
CES15 = 71	CES40 = 97	CES65 = 89	CES90 = 97
CES16 = 47	CES41 = 97	CES66 = 86	CES91 = 72
CES17 = 49	CES42 = 89	CES67 = 85	CES92 = 80
CES18 = 56	CES43 = 90	CES68 = 86	CES93 = 88
CES19 = 70	CES44 = 99	CES69 = 86	CES94 = 80
CES20 = 65	CES45 = 94	CES70 = 83	CES95 = 84
CES21 = 85	CES46 = 96	CES71 = 77	CES96 = 93
CES22 = 77	CES47 = 95	CES72 = 92	CES97 = 96
CES23 = 91	CES48 = 94	CES73 = 78	CES98 = 97
CES24 = 90	CES49 = 95	CES74 = 91	CES99 = 96
CES25 = 70	CES50 = 98	CES75 = 79	

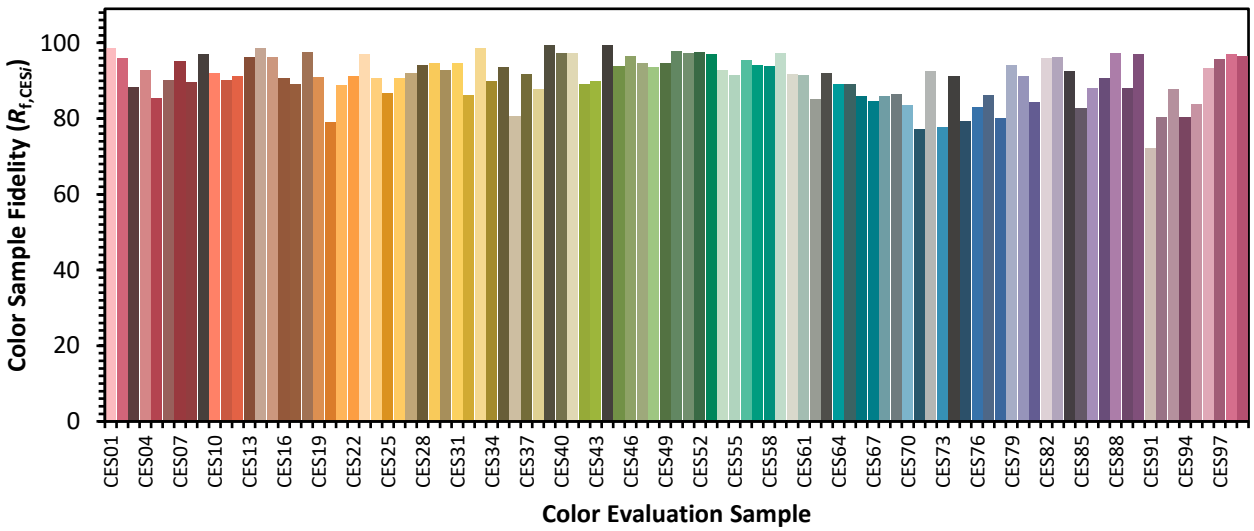



REPORT NUMBER: SP1-2510-566-13-R2

TM-30-18

Color Rendition by Hue-Angle Bin

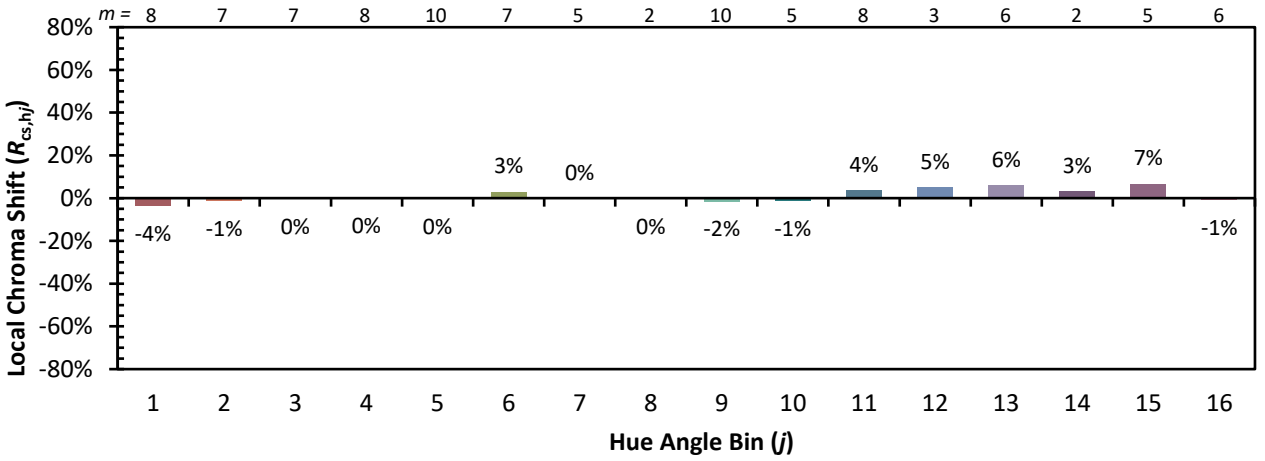

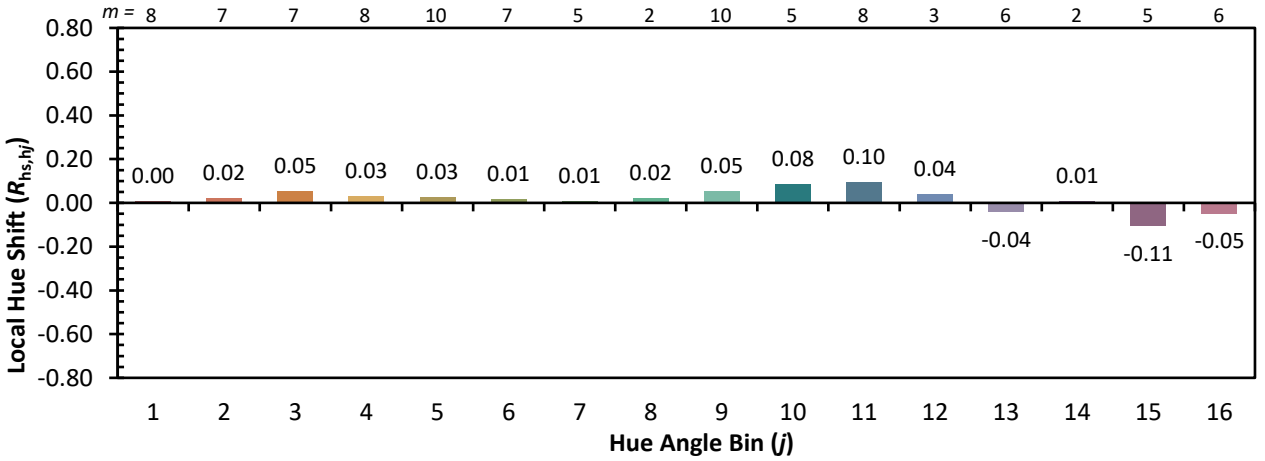


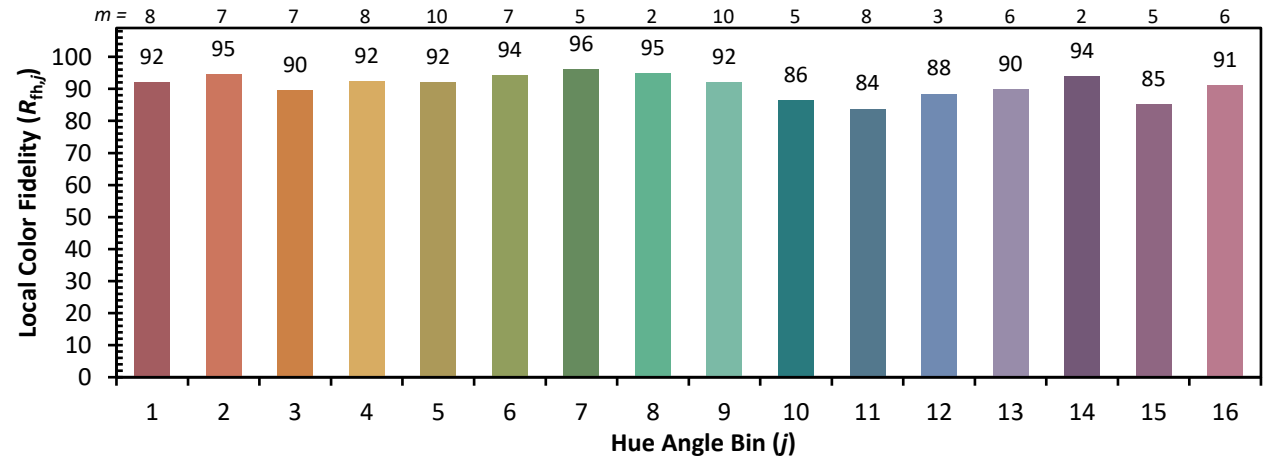


REPORT NUMBER: SP1-2510-566-13-R2

TM-30-18

Measure Comparisons

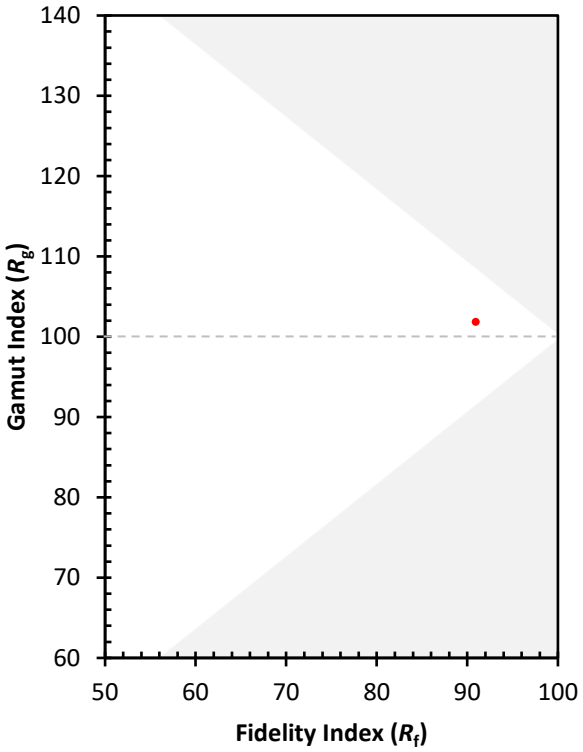

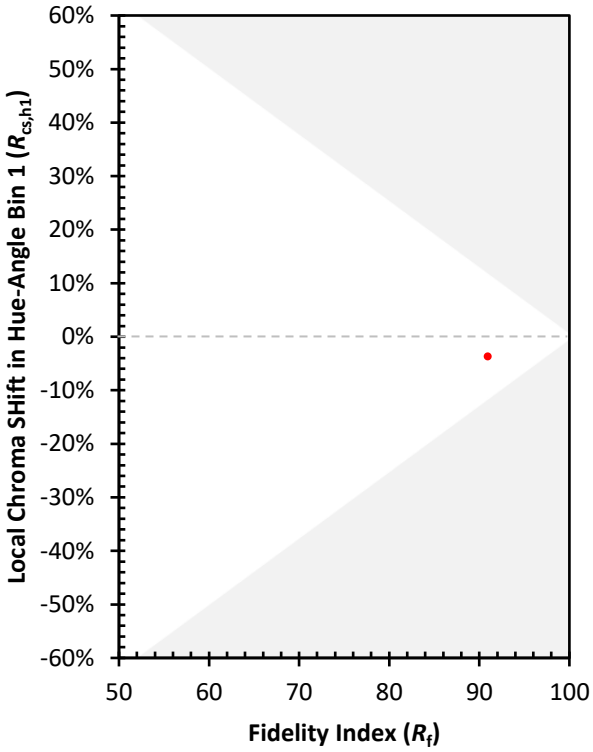

(END OF REPORT)