Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: METALUX

Report Number: P1590798

Luminaire Tested: 24CGTX-45-L92765-W2A-5700K

Issue Date: 9/7/2026

Report Generated By 670265710 / DESKTOP-98SHLC4

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269


Scaled Data Report

Test Information

Test Method:	LM-79-2019
Report Number:	P1590798
	TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G3-2510-586-8)
Test Lab:	COOPER LIGHTING SOLUTIONS
Issue Date:	9/7/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	METALUX
Catalog Number:	24CGTX-45-L92765-W2A-5700K
Description:	2X4 4500 LUMEN CGTX TROFFER WITH VividTune LEDS AT 5700K CCT WITH FROSTED SMOOTH LENS
Light Source:	5700K CCT, 90 CRI LEDS
Ballast/Driver:	-

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	5134.2 lumens
Efficiency:	N/A
Efficacy:	115.6 lumens/watt
Spacing Criteria (0/90/45):	1.27 / 1.27 / 1.39
Luminous Opening:	Rectangular (W 2' x L: 4' x H: 0')
CIE Type:	Direct
Input Watts (W):	44.4
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	NR
Total Harmonic Distortion (THDi):	NR
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	24 FT

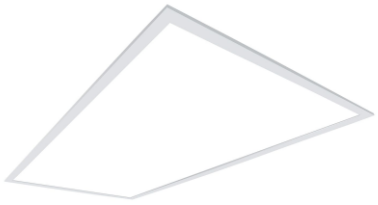


Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590798
CATALOG NUMBER: 24CGTX-45-L92765-W2A-5700K

Luminous Intensity Polar Plot

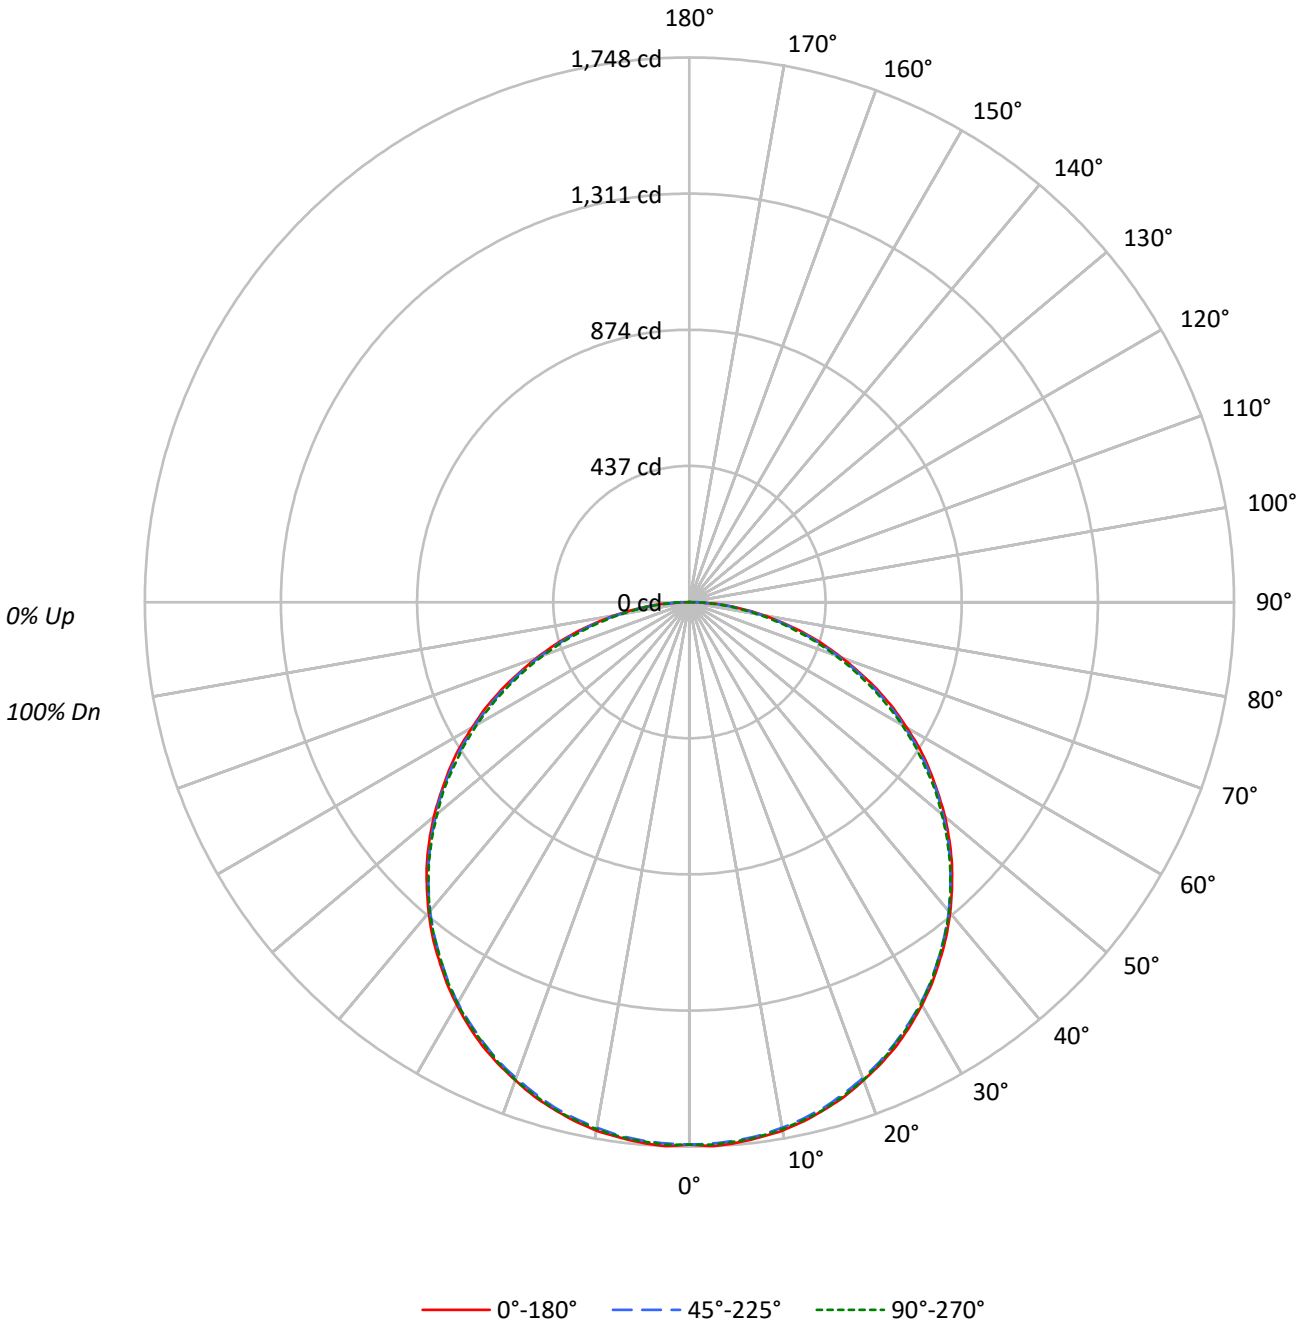

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590798
CATALOG NUMBER: 24CGTX-45-L92765-W2A-5700K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20			20			20			20
RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	108	103	99	95	106	101	97	93	97	94	91	93	90	88	89	87	85	83
2	98	90	83	77	96	88	82	76	84	79	74	81	77	73	78	74	71	69
3	90	79	70	64	87	77	69	63	74	67	62	71	66	61	69	64	60	58
4	82	70	61	54	80	68	60	53	66	58	53	63	57	52	61	56	51	49
5	75	62	53	46	73	61	52	46	59	51	45	57	50	45	55	49	44	42
6	69	56	47	40	67	55	46	40	53	45	40	51	45	39	50	44	39	37
7	64	51	42	35	63	50	41	35	48	41	35	47	40	35	45	39	35	33
8	60	46	38	32	58	45	37	31	44	37	31	43	36	31	42	35	31	29
9	56	42	34	28	54	42	34	28	41	33	28	39	33	28	38	32	28	26
10	52	39	31	26	51	38	31	26	37	30	26	37	30	25	36	30	25	24

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2343	2343	2343
5°	2353	2343	2346
10°	2353	2341	2346
15°	2347	2337	2344
20°	2339	2328	2337
25°	2334	2318	2323
30°	2320	2308	2312
35°	2302	2290	2290
40°	2287	2274	2278
45°	2268	2252	2250
50°	2241	2223	2210
55°	2209	2190	2168
60°	2165	2143	2121
65°	2119	2079	2046
70°	2038	2002	1952
75°	1970	1905	1830
80°	1858	1786	1705
85°	1731	1619	1539

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2268 cd/sqm

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590798
CATALOG NUMBER: 24CGTX-45-L92765-W2A-5700K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	165.1	3.2
10°-20°	474.1	9.2
20°-30°	721.3	14.0
30°-40°	874.1	17.0
40°-50°	913.6	17.8
50°-60°	833.9	16.2
60°-70°	646.3	12.6
70°-80°	387.7	7.6
80°-90°	118.0	2.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1360.5	26.5
0°-40°	2234.6	43.5
0°-60°	3982.2	77.6
0°-90°	5134.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5134.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1741	1741	1741	1741	1741	
5°	1742	1737	1735	1733	1737	166
15°	1685	1681	1678	1677	1683	476
25°	1572	1566	1562	1565	1565	724
35°	1402	1401	1394	1393	1394	878
45°	1192	1188	1184	1181	1183	919
55°	942	939	933	928	924	841
65°	666	661	653	645	643	657
75°	379	374	366	359	352	399
85°	112	109	105	101	100	124
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590798
CATALOG NUMBER: 24CGTX-45-L92765-W2A-5700K

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	*1741.2*	1741.2	1741.2	1741.2	1741.2
2.5°	*1747.5*	*1741.2*	*1739.2*	*1737.1*	*1743.3*
5°	*1742.3*	1737.1	1735.0	1732.9	1737.1
7.5°	*1732.9*	1728.8	1726.7	1724.6	1729.8
10°	*1722.5*	1717.4	1713.2	1712.2	1717.4
12.5°	*1705.9*	1699.7	1697.6	1697.6	1701.8
15°	*1685.2*	1681.0	1677.9	1676.9	1683.1
17.5°	*1662.3*	1657.1	1653.0	1654.0	1658.2
20°	*1633.3*	1630.1	1626.0	1628.1	1632.2
22.5°	*1604.2*	1601.1	1596.9	1596.9	1600.0
25°	*1572.0*	1565.8	1561.6	1564.7	1564.7
27.5°	*1533.6*	1528.4	1524.2	1525.3	1528.4
30°	*1493.1*	1490.0	1485.8	1484.8	1487.9
32.5°	*1449.5*	1445.3	1442.2	1441.2	1444.3
35°	*1401.7*	1400.7	1394.4	1393.4	1394.4
37.5°	*1354.0*	1350.8	1345.6	1345.6	1347.7
40°	*1302.0*	1297.9	1294.8	1291.7	1296.8
42.5°	*1247.0*	1244.9	1239.7	1238.7	1239.7
45°	*1192.0*	1187.8	1183.7	1180.6	1182.6
47.5°	*1131.8*	1130.7	1124.5	1121.4	1120.3
50°	*1070.5*	1068.4	1062.2	1058.0	1056.0
52.5°	*1005.1*	1004.0	1000.9	994.7	994.7
55°	*941.7*	938.6	933.4	928.2	924.1
57.5°	*877.4*	871.1	865.9	858.7	857.6
60°	*804.7*	801.6	796.4	789.1	788.1
62.5°	*738.2*	732.0	725.8	718.5	715.4
65°	*665.6*	661.4	653.1	644.8	642.7
67.5°	*590.8*	588.7	582.5	571.1	570.0
70°	*518.1*	515.0	508.8	500.5	496.3
72.5°	*449.6*	445.4	436.1	430.9	426.7
75°	*379.0*	373.8	366.5	359.3	352.0
77.5°	*306.3*	305.3	299.0	289.7	285.5
80°	*239.8*	235.7	230.5	222.2	220.1
82.5°	*174.4*	172.4	168.2	159.9	158.9
85°	*112.1*	109.0	104.9	100.7	99.7
87.5°	*47.8*	47.8	47.8	45.7	45.7
90°	*0.0*	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

TEST NUMBER: P1590798
CATALOG NUMBER: 24CGTX-45-L92765-W2A-5700K

CIE UGR TABLE:

Reflectances:											
	Ceiling	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
	Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
	Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.96	16.61	15.32	16.93	17.24	14.84	16.50	15.21	16.82	17.13
	3H	16.86	18.37	17.24	18.69	19.05	16.70	18.20	17.07	18.53	18.89
	4H	17.62	19.04	18.02	19.39	19.76	17.41	18.83	17.81	19.17	19.55
	6H	18.21	19.52	18.62	19.89	20.28	17.95	19.27	18.36	19.63	20.02
	8H	18.42	19.68	18.84	20.06	20.46	18.14	19.40	18.56	19.78	20.18
	12H	18.57	19.78	19.00	20.16	20.59	18.27	19.48	18.70	19.86	20.29
4H	2H	15.60	17.02	16.00	17.37	17.74	15.52	16.93	15.91	17.28	17.66
	3H	17.74	18.93	18.15	19.33	19.73	17.60	18.79	18.00	19.19	19.59
	4H	18.63	19.71	19.06	20.13	20.56	18.44	19.52	18.87	19.94	20.37
	6H	19.36	20.31	19.81	20.75	21.20	19.12	20.07	19.57	20.51	20.96
	8H	19.63	20.51	20.09	20.96	21.42	19.36	20.24	19.82	20.69	21.15
	12H	19.83	20.63	20.31	21.11	21.58	19.54	20.34	20.02	20.81	21.28
8H	4H	18.97	19.86	19.43	20.30	20.76	18.80	19.69	19.26	20.13	20.60
	6H	19.84	20.58	20.33	21.06	21.54	19.61	20.35	20.10	20.84	21.31
	8H	20.19	20.85	20.70	21.36	21.84	19.93	20.60	20.44	21.10	21.59
	12H	20.48	21.07	20.99	21.56	22.12	20.20	20.79	20.70	21.27	21.83
12H	4H	19.01	19.81	19.49	20.28	20.75	18.85	19.65	19.33	20.12	20.59
	6H	19.90	20.57	20.41	21.08	21.56	19.69	20.36	20.20	20.86	21.35
	8H	20.32	20.91	20.83	21.40	21.96	20.08	20.67	20.58	21.15	21.71

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2510-566-15-R2

Test Date: 10/15/2025

Luminaire Tested: 22CGTX-50-L92765-W2A-5700K

Data in this report applies to families of products including 22CGTX

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.05


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2510-566-15-R2
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	07/28/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	Metalux
Catalog Number:	**22CGTX-50-L92765-W2A-5700K**
Description:	*THIS IS A REVISION OF REPORT SP1-2512-566-15-R2 TO UPDATE THE CATALOG INFORMATION* 2X2 50000 Lumen CGTX TUNABLE WHITE FROM 2700K TO 6500K - 3 V

Spectral Parameters

CCT (K):	5464
CIE u':	0.2093
CIE v':	0.4752
Duv:	-0.0028
CIE x:	0.3332
CIE y:	0.3363
CIE z:	0.3306
Peak Wavelength (nm):	630
Dominant Wavelength (nm):	552
Purity:	0.8453147
Rf:	90.5
Rg:	100.7

CRI (Ra):	95.3				
R1:	97.1	R9:	81.4
R2:	97.2	R10:	91.8
R3:	93.9	R11:	95.7
R4:	97.1	R12:	72.4
R5:	96.2	R13:	98.1
R6:	92.3	R14:	96.0
R7:	95.5	R15:	97.9
R8:	93.3		

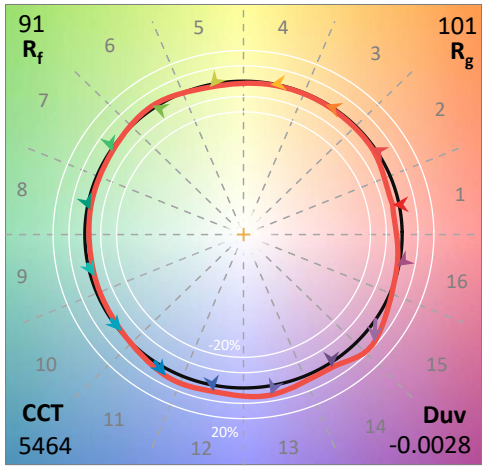

Test Conditions


Stabilization Time:	33M
Operation Time:	1H 33M
Sphere Temperature (°C):	25.0

REPORT NUMBER: SP1-2510-566-15-R2


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	6/16/2025	12/16/2025
Power Meter	XITRON INXT2011004	1/21/2025	1/21/2026
AC Power Source	CHROMA 61603 IN0063	10/22/2024	10/22/2025
DC Power Source	AGILENT E3634A IN0208	10/22/2024	10/22/2025
Sphere Thermometer	ONSET IN0085	10/22/2024	10/22/2025
Room Thermometer	ONSET IN0046	10/22/2024	10/22/2025

REPORT NUMBER: SP1-2510-566-15-R2

CIE 1931 Chromaticity Diagram

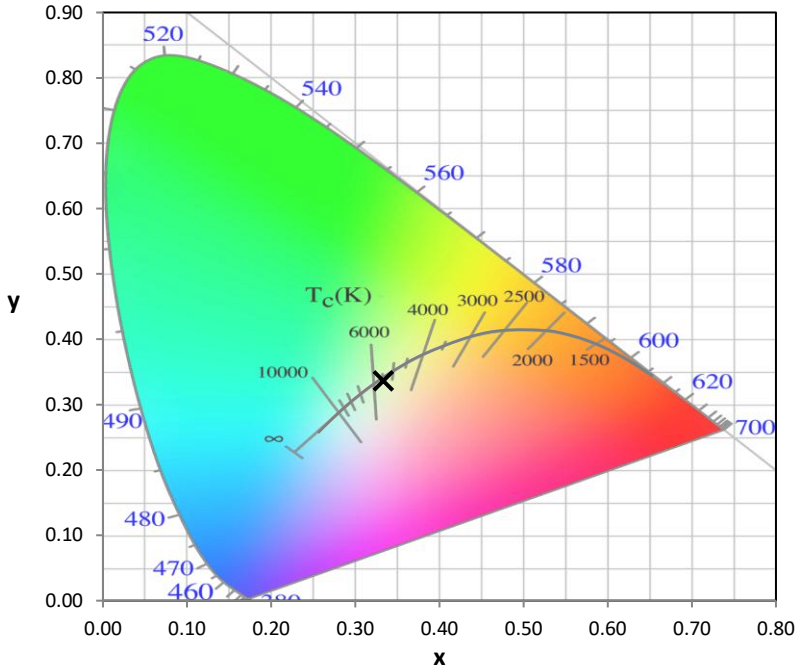

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

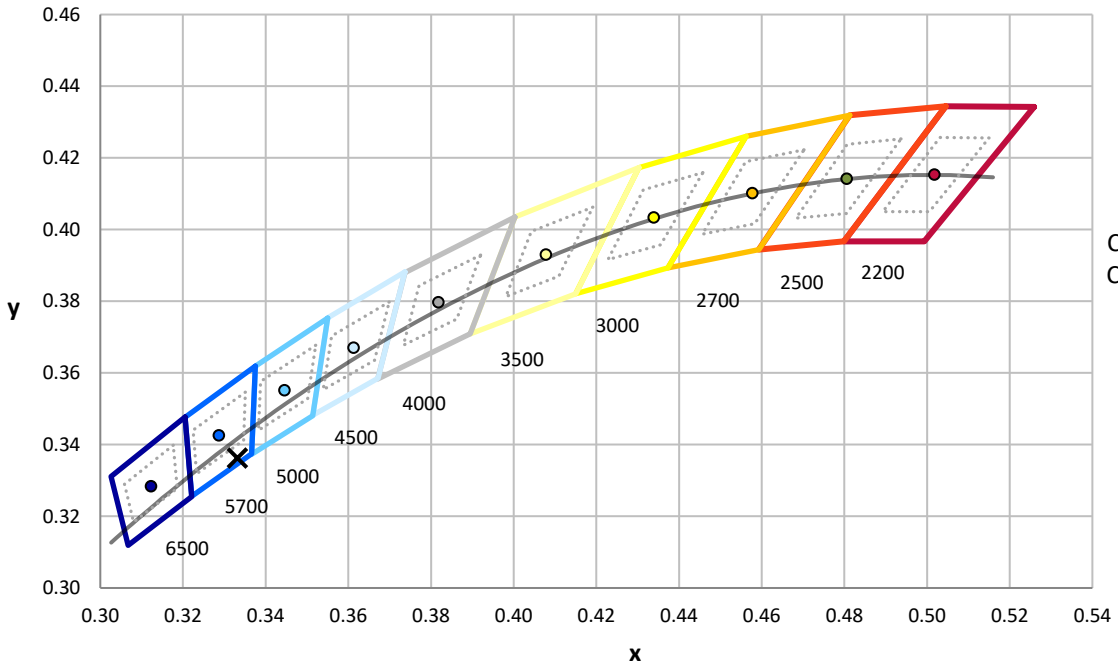


CCT = 5464K
CIE x = 0.3332
CIE y = 0.3363
Duv = -0.0028

Point lies inside the ANSI 5700K 7-step quadrangle

REPORT NUMBER: SP1-2510-566-15-R2

Photopic Flux vs. Wavelength

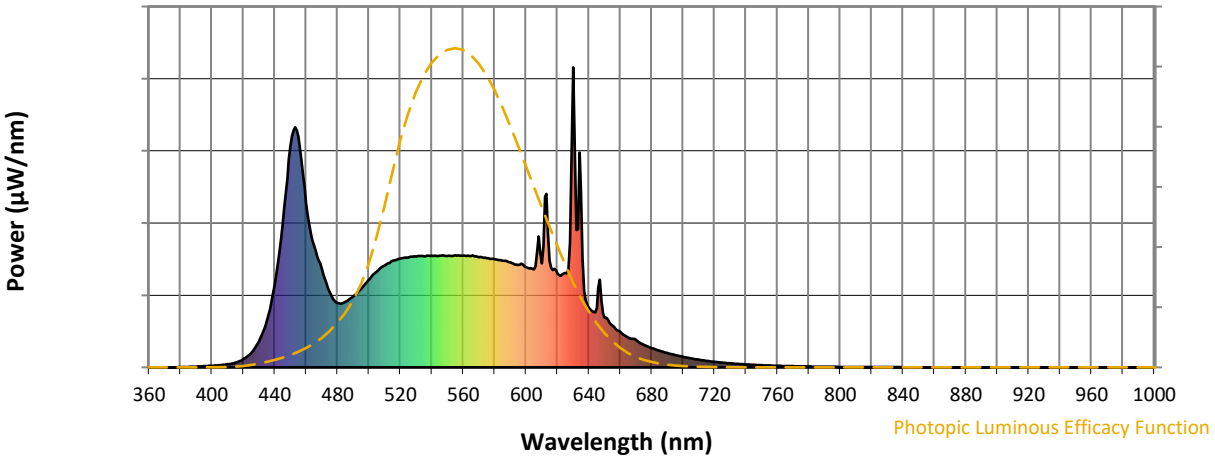


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	237	NR	620	313	NR	750	7	NR	880	0	NR
365	0	NR	495	262	NR	625	315	NR	755	6	NR	885	0	NR
370	0	NR	500	293	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	319	NR	635	592	NR	765	4	NR	895	0	NR
380	1	NR	510	339	NR	640	199	NR	770	4	NR	900	0	NR
385	2	NR	515	355	NR	645	198	NR	775	3	NR	905	0	NR
390	2	NR	520	363	NR	650	166	NR	780	3	NR	910	0	NR
395	4	NR	525	366	NR	655	139	NR	785	2	NR	915	0	NR
400	5	NR	530	369	NR	660	118	NR	790	2	NR	920	0	NR
405	7	NR	535	371	NR	665	100	NR	795	2	NR	925	0	NR
410	10	NR	540	373	NR	670	92	NR	800	2	NR	930	0	NR
415	16	NR	545	372	NR	675	75	NR	805	1	NR	935	0	NR
420	28	NR	550	372	NR	680	64	NR	810	1	NR	940	0	NR
425	48	NR	555	374	NR	685	55	NR	815	1	NR	945	0	NR
430	86	NR	560	372	NR	690	48	NR	820	1	NR	950	0	NR
435	157	NR	565	371	NR	695	41	NR	825	1	NR	955	0	NR
440	274	NR	570	368	NR	700	35	NR	830	1	NR	960	0	NR
445	477	NR	575	364	NR	705	30	NR	835	1	NR	965	0	NR
450	736	NR	580	361	NR	710	25	NR	840	1	NR	970	0	NR
455	770	NR	585	356	NR	715	22	NR	845	0	NR	975	0	NR
460	547	NR	590	351	NR	720	19	NR	850	0	NR	980	0	NR
465	406	NR	595	341	NR	725	16	NR	855	0	NR	985	0	NR
470	327	NR	600	334	NR	730	14	NR	860	0	NR	990	0	NR
475	251	NR	605	327	NR	735	12	NR	865	0	NR	995	0	NR
480	215	NR	610	347	NR	740	10	NR	870	0	NR	1000	0	NR
485	218	NR	615	355	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2510-566-15-R2

Scotopic Flux vs. Wavelength

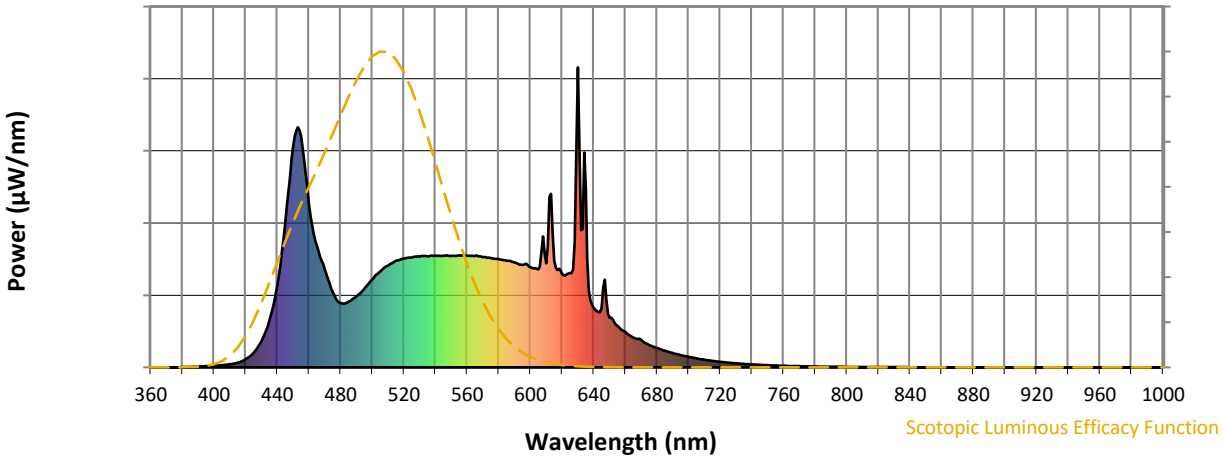


Scotopic Lumens: NR **S/P: 2.18**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	237	NR	620	313	NR	750	7	NR	880	0	NR
365	0	NR	495	262	NR	625	315	NR	755	6	NR	885	0	NR
370	0	NR	500	293	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	319	NR	635	592	NR	765	4	NR	895	0	NR
380	1	NR	510	339	NR	640	199	NR	770	4	NR	900	0	NR
385	2	NR	515	355	NR	645	198	NR	775	3	NR	905	0	NR
390	2	NR	520	363	NR	650	166	NR	780	3	NR	910	0	NR
395	4	NR	525	366	NR	655	139	NR	785	2	NR	915	0	NR
400	5	NR	530	369	NR	660	118	NR	790	2	NR	920	0	NR
405	7	NR	535	371	NR	665	100	NR	795	2	NR	925	0	NR
410	10	NR	540	373	NR	670	92	NR	800	2	NR	930	0	NR
415	16	NR	545	372	NR	675	75	NR	805	1	NR	935	0	NR
420	28	NR	550	372	NR	680	64	NR	810	1	NR	940	0	NR
425	48	NR	555	374	NR	685	55	NR	815	1	NR	945	0	NR
430	86	NR	560	372	NR	690	48	NR	820	1	NR	950	0	NR
435	157	NR	565	371	NR	695	41	NR	825	1	NR	955	0	NR
440	274	NR	570	368	NR	700	35	NR	830	1	NR	960	0	NR
445	477	NR	575	364	NR	705	30	NR	835	1	NR	965	0	NR
450	736	NR	580	361	NR	710	25	NR	840	1	NR	970	0	NR
455	770	NR	585	356	NR	715	22	NR	845	0	NR	975	0	NR
460	547	NR	590	351	NR	720	19	NR	850	0	NR	980	0	NR
465	406	NR	595	341	NR	725	16	NR	855	0	NR	985	0	NR
470	327	NR	600	334	NR	730	14	NR	860	0	NR	990	0	NR
475	251	NR	605	327	NR	735	12	NR	865	0	NR	995	0	NR
480	215	NR	610	347	NR	740	10	NR	870	0	NR	1000	0	NR
485	218	NR	615	355	NR	745	8	NR	875	0	NR			

REPORT NUMBER: SP1-2510-566-15-R2

Melanopic Flux vs. Wavelength

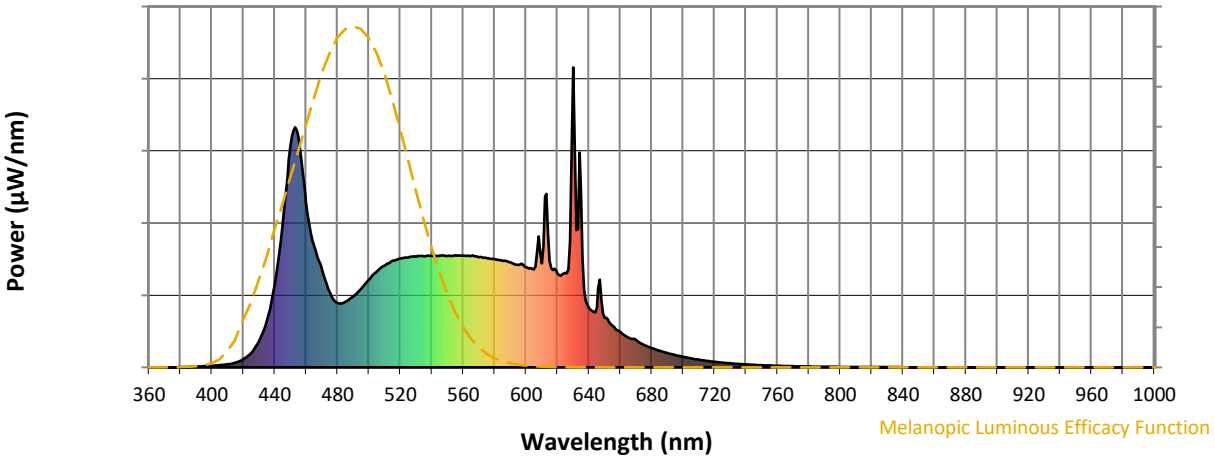

Melanopic Lumens: NR **M/P: 4.82**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	237	NR	620	313	NR	750	7	NR	880	0	NR
365	0	NR	495	262	NR	625	315	NR	755	6	NR	885	0	NR
370	0	NR	500	293	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	319	NR	635	592	NR	765	4	NR	895	0	NR
380	1	NR	510	339	NR	640	199	NR	770	4	NR	900	0	NR
385	2	NR	515	355	NR	645	198	NR	775	3	NR	905	0	NR
390	2	NR	520	363	NR	650	166	NR	780	3	NR	910	0	NR
395	4	NR	525	366	NR	655	139	NR	785	2	NR	915	0	NR
400	5	NR	530	369	NR	660	118	NR	790	2	NR	920	0	NR
405	7	NR	535	371	NR	665	100	NR	795	2	NR	925	0	NR
410	10	NR	540	373	NR	670	92	NR	800	2	NR	930	0	NR
415	16	NR	545	372	NR	675	75	NR	805	1	NR	935	0	NR
420	28	NR	550	372	NR	680	64	NR	810	1	NR	940	0	NR
425	48	NR	555	374	NR	685	55	NR	815	1	NR	945	0	NR
430	86	NR	560	372	NR	690	48	NR	820	1	NR	950	0	NR
435	157	NR	565	371	NR	695	41	NR	825	1	NR	955	0	NR
440	274	NR	570	368	NR	700	35	NR	830	1	NR	960	0	NR
445	477	NR	575	364	NR	705	30	NR	835	1	NR	965	0	NR
450	736	NR	580	361	NR	710	25	NR	840	1	NR	970	0	NR
455	770	NR	585	356	NR	715	22	NR	845	0	NR	975	0	NR
460	547	NR	590	351	NR	720	19	NR	850	0	NR	980	0	NR
465	406	NR	595	341	NR	725	16	NR	855	0	NR	985	0	NR
470	327	NR	600	334	NR	730	14	NR	860	0	NR	990	0	NR
475	251	NR	605	327	NR	735	12	NR	865	0	NR	995	0	NR
480	215	NR	610	347	NR	740	10	NR	870	0	NR	1000	0	NR
485	218	NR	615	355	NR	745	8	NR	875	0	NR			


REPORT NUMBER: SP1-2510-566-15-R2

TM-30-18


Summary


R_f = 90.5
R_g = 100.7
CIE R_a = 95.3
R_9 = 81.4


Spectral Power Distribution Comparison

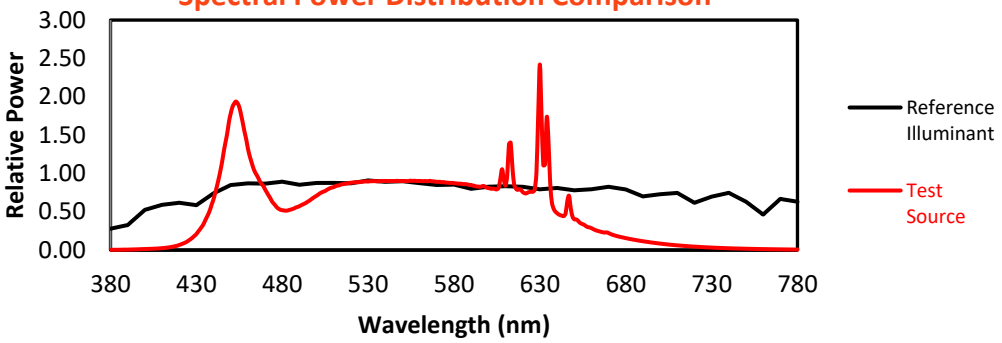


Color Vector Graphics

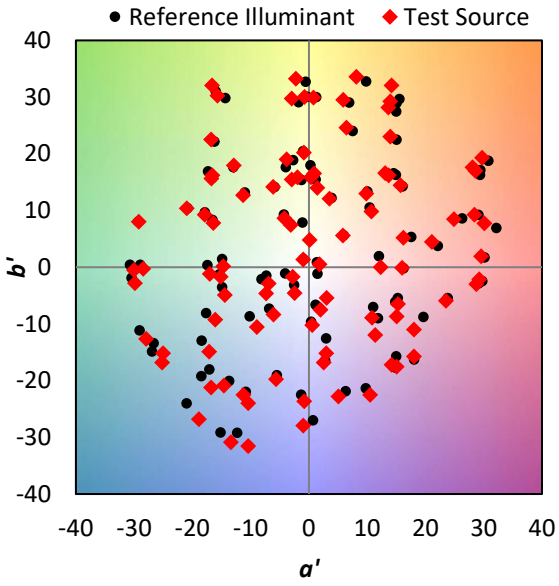

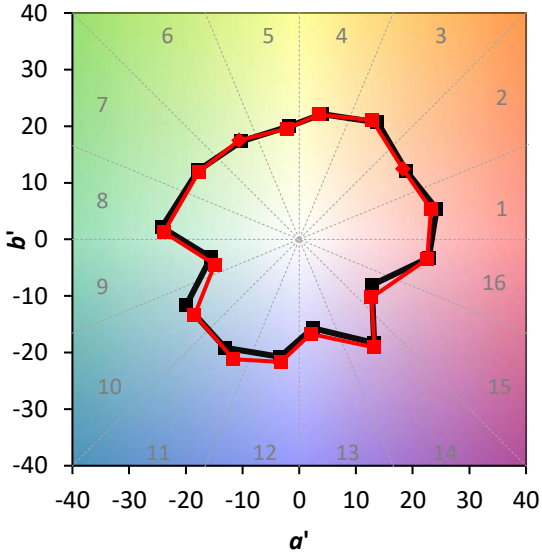

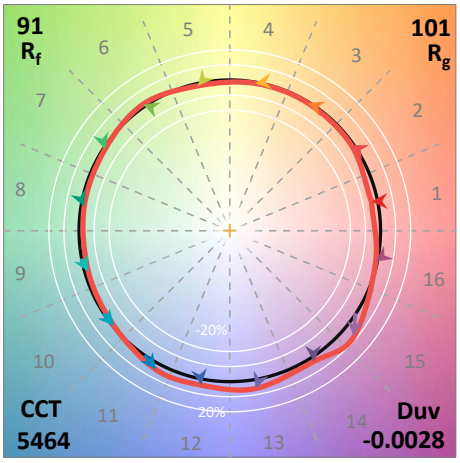

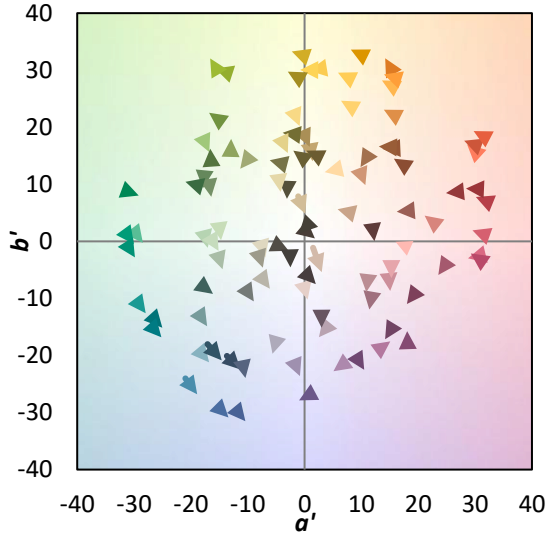


REPORT NUMBER: SP1-2510-566-15-R2

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 85	CES26 = 92	CES51 = 96	CES76 = 83
CES02 = 61	CES27 = 90	CES52 = 98	CES77 = 86
CES03 = 31	CES28 = 94	CES53 = 97	CES78 = 80
CES04 = 68	CES29 = 96	CES54 = 92	CES79 = 94
CES05 = 48	CES30 = 90	CES55 = 90	CES80 = 91
CES06 = 50	CES31 = 96	CES56 = 94	CES81 = 86
CES07 = 41	CES32 = 88	CES57 = 92	CES82 = 96
CES08 = 40	CES33 = 98	CES58 = 92	CES83 = 97
CES09 = 29	CES34 = 90	CES59 = 97	CES84 = 92
CES10 = 73	CES35 = 94	CES60 = 91	CES85 = 83
CES11 = 56	CES36 = 78	CES61 = 90	CES86 = 89
CES12 = 62	CES37 = 92	CES62 = 82	CES87 = 91
CES13 = 42	CES38 = 84	CES63 = 91	CES88 = 98
CES14 = 74	CES39 = 99	CES64 = 87	CES89 = 89
CES15 = 71	CES40 = 98	CES65 = 87	CES90 = 96
CES16 = 46	CES41 = 96	CES66 = 83	CES91 = 70
CES17 = 48	CES42 = 90	CES67 = 82	CES92 = 80
CES18 = 56	CES43 = 92	CES68 = 85	CES93 = 87
CES19 = 70	CES44 = 99	CES69 = 85	CES94 = 81
CES20 = 65	CES45 = 95	CES70 = 82	CES95 = 83
CES21 = 84	CES46 = 98	CES71 = 74	CES96 = 93
CES22 = 77	CES47 = 95	CES72 = 92	CES97 = 96
CES23 = 91	CES48 = 91	CES73 = 76	CES98 = 97
CES24 = 90	CES49 = 96	CES74 = 90	CES99 = 96
CES25 = 70	CES50 = 97	CES75 = 77	

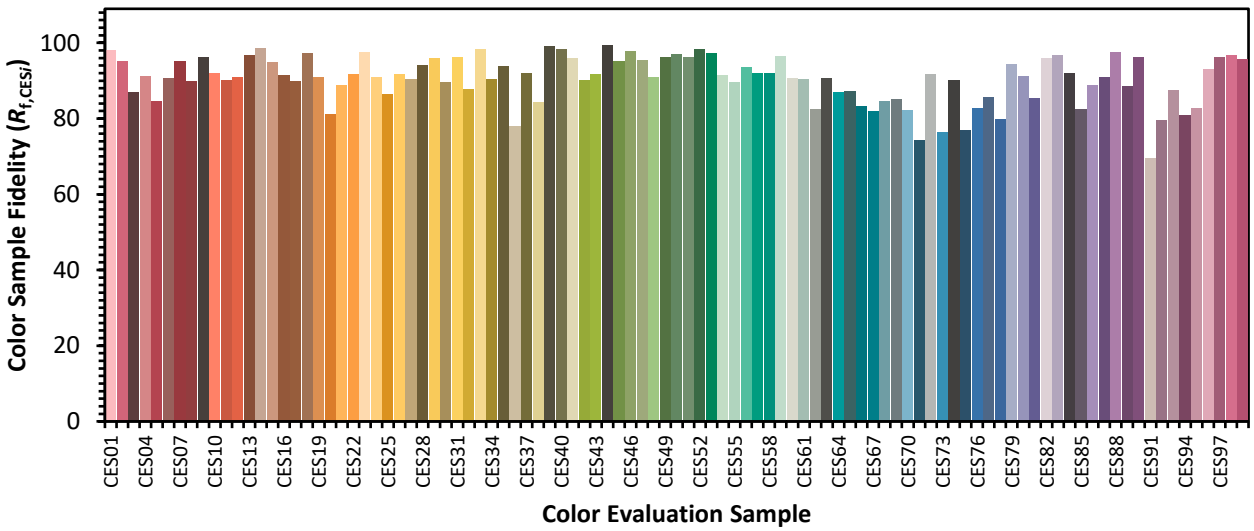



REPORT NUMBER: SP1-2510-566-15-R2

TM-30-18

Color Rendition by Hue-Angle Bin

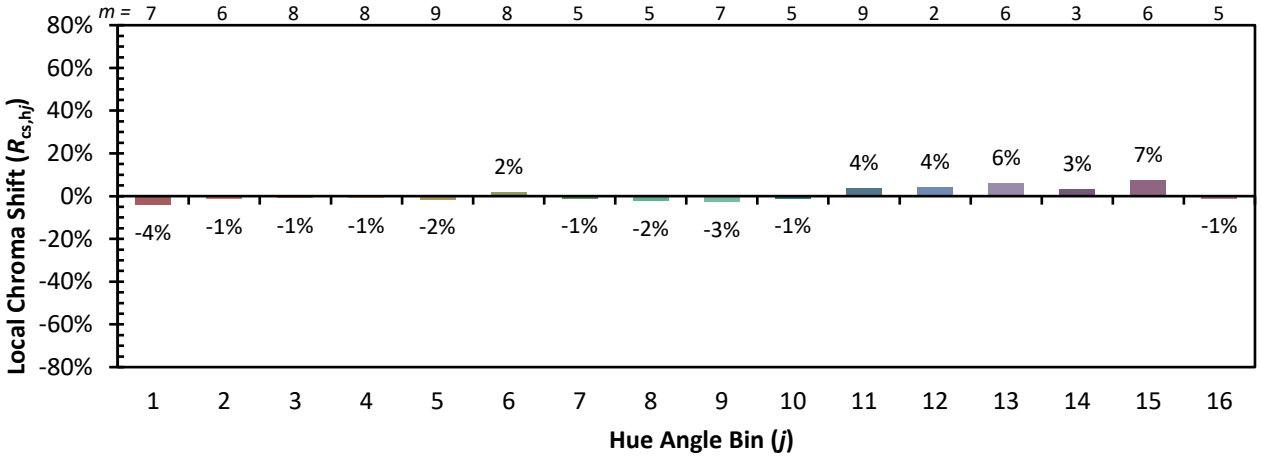

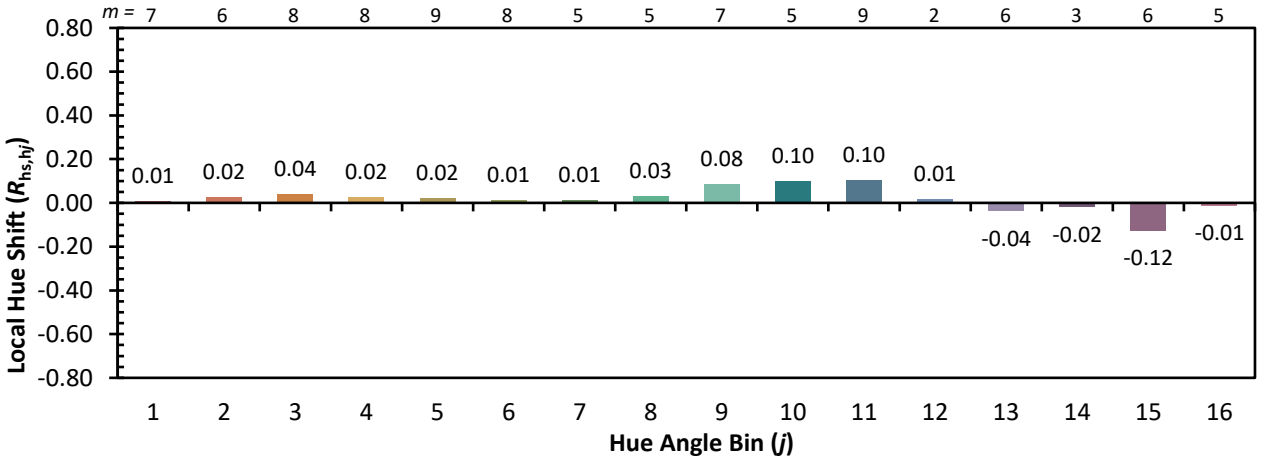


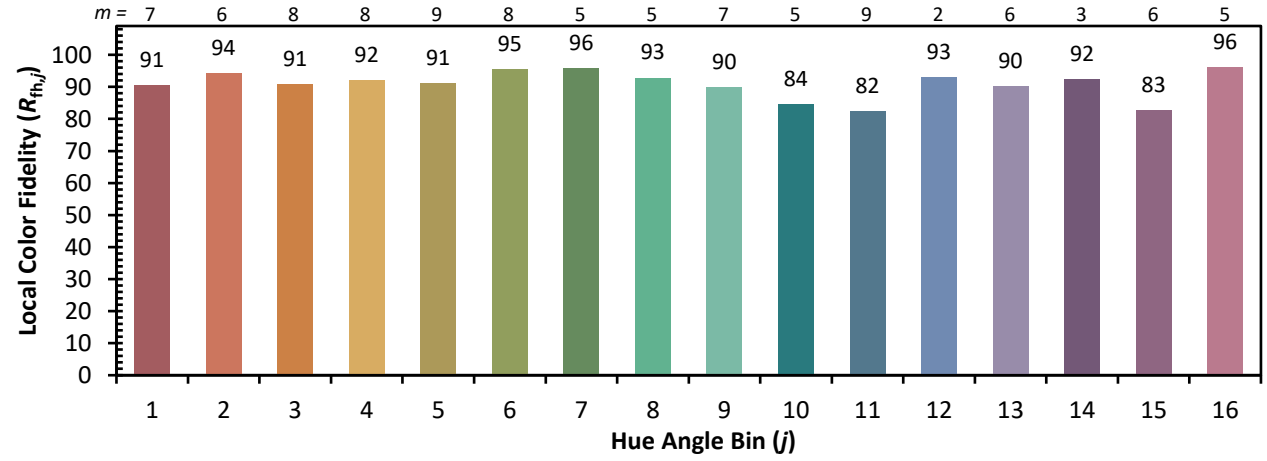


REPORT NUMBER: SP1-2510-566-15-R2

TM-30-18

Measure Comparisons

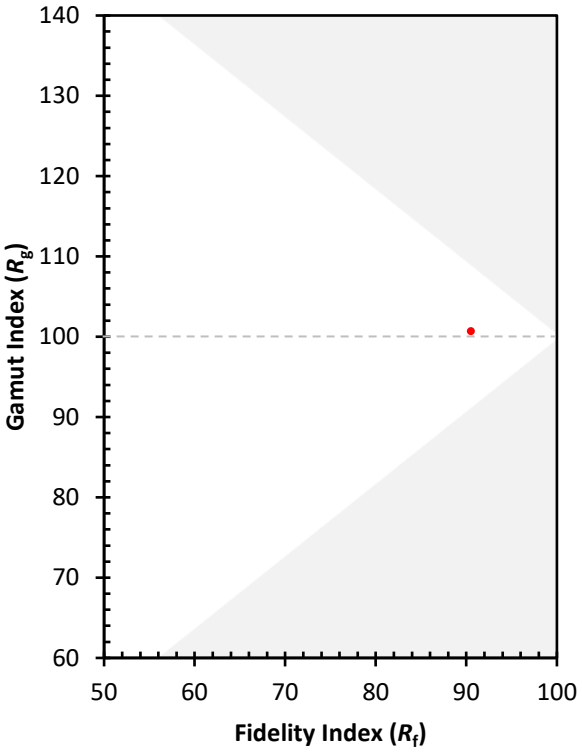

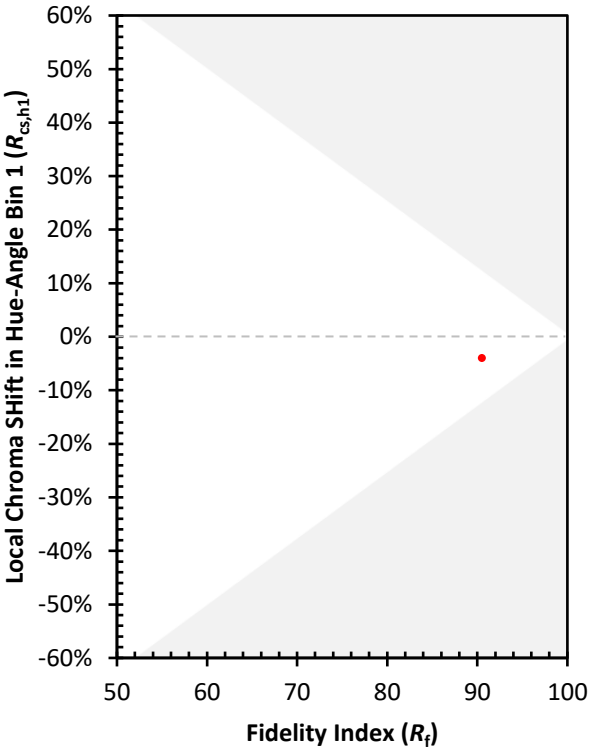

(END OF REPORT)