Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled data based on original data using

LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: METALUX

Report Number: P1590927

Luminaire Tested: 22CGTX-50-L93050-W2A-3500K

Issue Date: 9/7/2026

Report Generated By 670265710 / DESKTOP-98SHLC4

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

Test Information

Test Method:	LM-79-2019
Report Number:	P1590927
	TEST IS SCALED FROM IESNA LM-79-24 TEST DATA (G3-2512-631-5)
Test Lab:	COOPER LIGHTING SOLUTIONS
Issue Date:	9/7/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	METALUX
Catalog Number:	22CGTX-50-L93050-W2A-3500K
Description:	2X2 5000 LUMEN CGTX TROFFER WITH VividTune LEDS AT 3500K CCT
Light Source:	3500K CCT, 90 CRI LEDS
Ballast/Driver:	-

Summary

Lumens per Lamp:	N/A
Luminaire Lumens:	5538.0 lumens
Efficiency:	N/A
Efficacy:	104.1 lumens/watt
Spacing Criteria (0/90/45):	1.27 / 1.27 / 1.39
Luminous Opening:	Rectangular (W 2' x L: 2' x H: 0')
CIE Type:	Direct
Input Watts (W):	53.2
Input Voltage (V):	120
Input Current (Ain):	NR
Voltage Rise (V):	NR
Power Factor:	NR
Total Harmonic Distortion (THDi):	NR
Frequency (hertz):	60
Stabilization Time:	NR
Operation Time:	NR
Ambient Temperature (°C):	NR
Test Distance:	24 FT




Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590927
CATALOG NUMBER: 22CGTX-50-L93050-W2A-3500K

Luminous Intensity Polar Plot

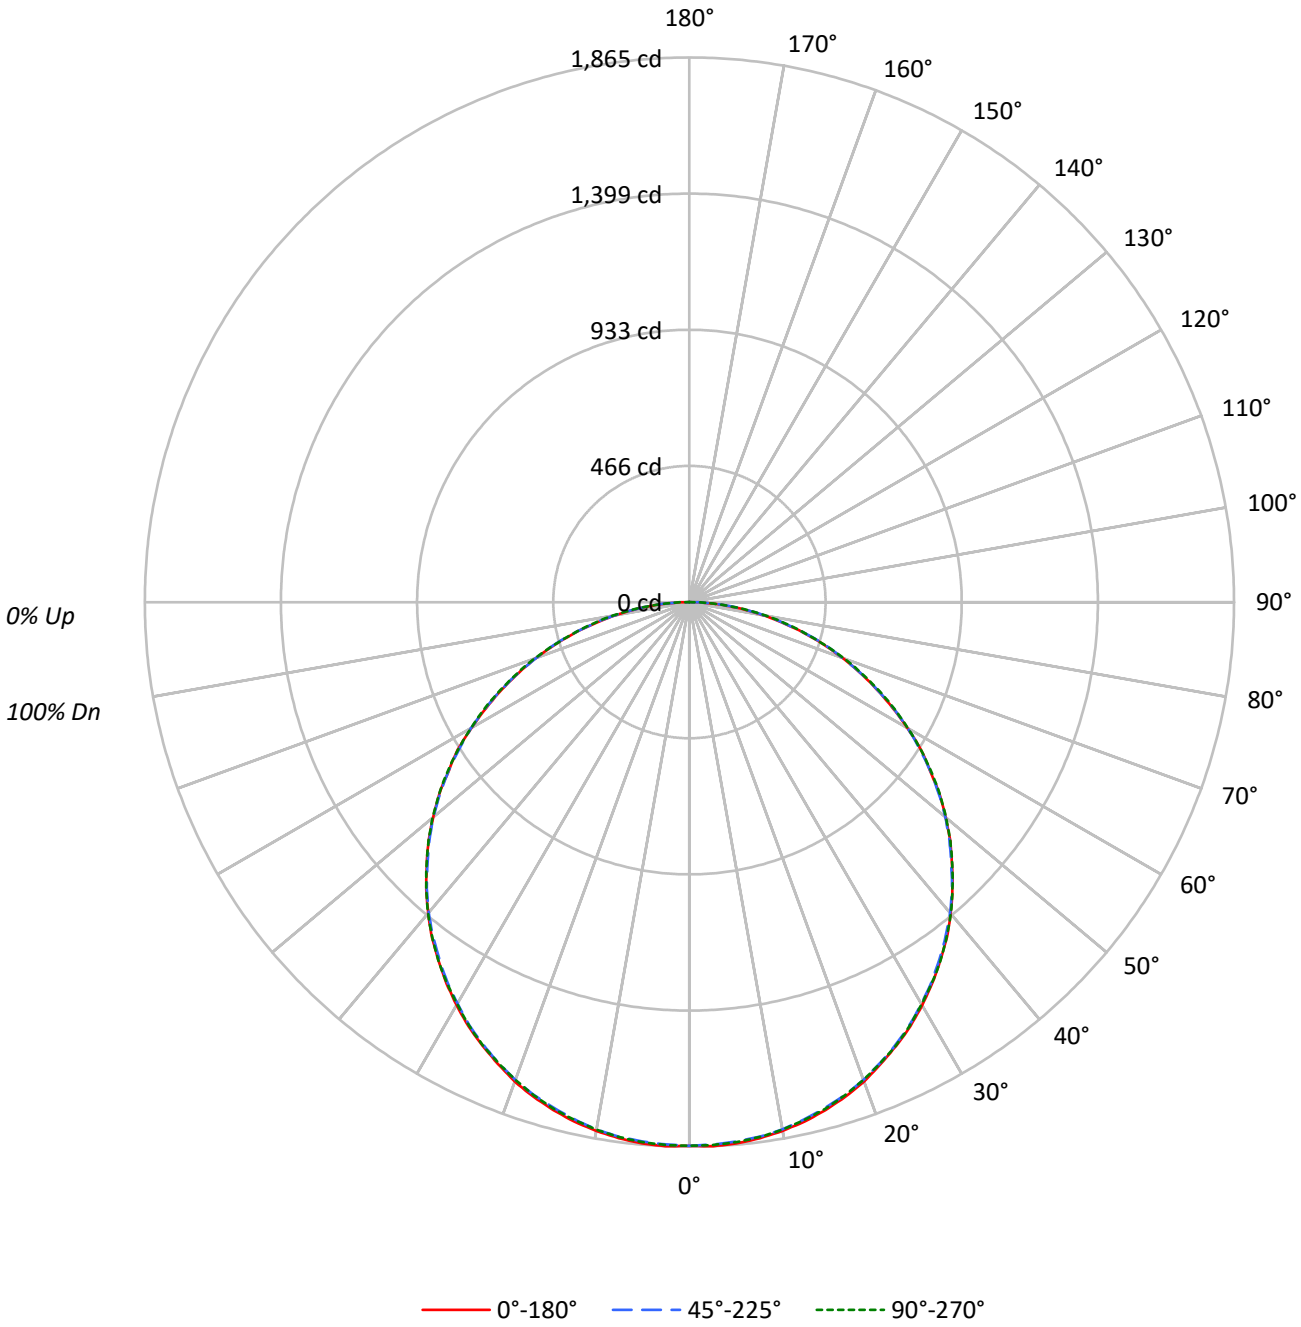

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590927
CATALOG NUMBER: 22CGTX-50-L93050-W2A-3500K

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20			20			20			20
RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	108	103	99	95	106	101	97	93	97	93	90	93	90	88	89	87	85	83
2	98	90	83	77	96	88	81	76	84	79	74	81	76	72	78	74	71	68
3	89	79	70	63	87	77	69	63	74	67	62	71	65	61	69	64	60	57
4	82	69	60	54	79	68	60	53	66	58	52	63	57	52	61	55	51	49
5	75	62	53	46	73	61	52	46	59	51	45	57	50	45	55	49	44	42
6	69	56	47	40	67	55	46	40	53	45	39	51	44	39	50	43	39	37
7	64	50	41	35	62	50	41	35	48	40	35	47	40	35	45	39	34	32
8	60	46	37	31	58	45	37	31	44	36	31	43	36	31	41	35	31	29
9	56	42	34	28	54	42	34	28	40	33	28	39	33	28	38	32	28	26
10	52	39	31	26	51	38	31	25	37	30	25	36	30	25	35	29	25	23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5010	5010	5010
5°	5027	5007	5013
10°	5023	5009	5012
15°	5016	4996	5005
20°	5004	4986	4986
25°	4976	4964	4973
30°	4953	4934	4940
35°	4921	4904	4924
40°	4888	4878	4892
45°	4840	4825	4845
50°	4794	4785	4803
55°	4716	4720	4744
60°	4633	4645	4650
65°	4512	4525	4551
70°	4384	4376	4441
75°	4199	4242	4242
80°	3945	4009	4088
85°	3473	3693	3662

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 67.5°
Vertical Angle: 45°
Luminance: 4845 cd/sqm

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590927
CATALOG NUMBER: 22CGTX-50-L93050-W2A-3500K

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	176.5	3.2
10°-20°	507.0	9.2
20°-30°	771.2	13.9
30°-40°	935.8	16.9
40°-50°	980.7	17.7
50°-60°	900.4	16.3
60°-70°	703.9	12.7
70°-80°	430.0	7.8
80°-90°	132.5	2.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1454.7	26.3
0°-40°	2390.5	43.2
0°-60°	4271.6	77.1
0°-90°	5538.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5538.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1862	1862	1862	1862	1862	
5°	1861	1859	1854	1854	1856	177
15°	1800	1798	1793	1793	1796	508
25°	1676	1674	1672	1671	1675	773
35°	1498	1496	1493	1496	1499	938
45°	1272	1270	1268	1273	1273	982
55°	1005	1008	1006	1007	1011	901
65°	709	710	711	715	715	701
75°	404	405	408	410	408	426
85°	112	116	120	119	119	129
90°	0	0	0	0	0	

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report

TEST NUMBER: P1590927
CATALOG NUMBER: 22CGTX-50-L93050-W2A-3500K

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	*1861.9*	1861.9	1861.9	1861.9	1861.9
2.5°	*1865.0*	*1861.9*	*1858.8*	*1857.8*	*1860.9*
5°	*1860.9*	1858.8	1853.7	1853.7	1855.8
7.5°	*1851.7*	1848.6	1846.6	1844.5	1847.6
10°	*1838.4*	1835.3	1833.3	1832.2	1834.3
12.5°	*1822.0*	1818.9	1814.9	1814.9	1816.9
15°	*1800.5*	1797.5	1793.4	1793.4	1796.5
17.5°	*1776.0*	1772.9	1769.9	1769.9	1770.9
20°	*1747.4*	1743.3	1741.2	1741.2	1741.2
22.5°	*1712.6*	1709.5	1707.5	1707.5	1708.5
25°	*1675.8*	1673.8	1671.7	1670.7	1674.8
27.5°	*1638.0*	1634.9	1632.9	1633.9	1634.9
30°	*1594.0*	1590.9	1587.9	1589.9	1589.9
32.5°	*1548.0*	1544.9	1542.9	1542.9	1546.0
35°	*1497.9*	1495.9	1492.8	1495.9	1498.9
37.5°	*1447.8*	1444.7	1441.7	1442.7	1446.8
40°	*1391.6*	1388.5	1388.5	1388.5	1392.6
42.5°	*1333.3*	1331.2	1331.2	1331.2	1333.3
45°	*1271.9*	1269.9	1267.8	1273.0	1273.0
47.5°	*1211.6*	1207.5	1207.5	1209.6	1211.6
50°	*1145.1*	1146.2	1143.1	1144.1	1147.2
52.5°	*1079.7*	1076.6	1075.6	1076.6	1080.7
55°	*1005.1*	1008.1	1006.1	1007.1	1011.2
57.5°	*940.7*	934.5	933.5	939.6	938.6
60°	*860.9*	860.9	863.0	866.0	864.0
62.5°	*784.2*	785.2	787.3	790.4	791.4
65°	*708.6*	709.6	710.6	714.7	714.7
67.5°	*631.9*	632.9	633.9	633.9	639.0
70°	*557.2*	556.2	556.2	562.3	564.4
72.5°	*479.5*	480.6	485.7	485.7	483.6
75°	*403.9*	404.9	408.0	410.0	408.0
77.5°	*326.2*	329.2	330.3	334.3	335.4
80°	*254.6*	255.6	258.7	259.7	263.8
82.5°	*183.0*	184.0	186.1	189.2	191.2
85°	*112.5*	115.5	119.6	118.6	118.6
87.5°	*52.1*	52.1	54.2	54.2	57.3
90°	*0.0*	0.0	0.0	0.0	0.0

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

TEST NUMBER: P1590927
CATALOG NUMBER: 22CGTX-50-L93050-W2A-3500K

CIE UGR TABLE:

Reflectances:											
	Ceiling	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
	Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
	Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	17.58	19.25	17.95	19.56	19.87	17.61	19.27	17.98	19.59	19.90
	3H	19.49	21.00	19.87	21.33	21.69	19.54	21.05	19.91	21.37	21.73
	4H	20.25	21.67	20.65	22.02	22.39	20.30	21.72	20.69	22.07	22.44
	6H	20.83	22.15	21.24	22.52	22.91	20.90	22.23	21.31	22.59	22.98
	8H	21.03	22.30	21.46	22.69	23.08	21.12	22.38	21.54	22.77	23.17
	12H	21.17	22.39	21.60	22.77	23.20	21.27	22.48	21.70	22.86	23.29
4H	2H	18.25	19.67	18.65	20.02	20.40	18.27	19.70	18.67	20.04	20.42
	3H	20.39	21.59	20.80	21.99	22.39	20.43	21.63	20.84	22.03	22.43
	4H	21.28	22.37	21.72	22.78	23.22	21.33	22.42	21.76	22.83	23.27
	6H	22.01	22.96	22.46	23.40	23.85	22.08	23.03	22.53	23.47	23.93
	8H	22.27	23.16	22.72	23.60	24.06	22.35	23.24	22.81	23.69	24.15
	12H	22.46	23.26	22.94	23.74	24.20	22.56	23.36	23.03	23.83	24.30
8H	4H	21.65	22.54	22.11	22.98	23.45	21.69	22.58	22.15	23.02	23.49
	6H	22.51	23.26	23.00	23.74	24.22	22.58	23.32	23.07	23.81	24.28
	8H	22.85	23.52	23.36	24.03	24.51	22.93	23.60	23.44	24.11	24.59
	12H	23.13	23.72	23.63	24.21	24.77	23.23	23.82	23.73	24.31	24.87
12H	4H	21.70	22.50	22.18	22.98	23.44	21.74	22.54	22.22	23.02	23.48
	6H	22.59	23.26	23.10	23.76	24.25	22.65	23.32	23.16	23.83	24.31
	8H	23.00	23.59	23.50	24.08	24.64	23.07	23.67	23.58	24.16	24.72

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

LM-79-2019: Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Report Prepared for

Cooper Lighting Solutions

Metalux

Report Number: SP1-2512-631-36-R2

Test Date: 02/05/2026

Luminaire Tested: 22CGTX-50-L93050-W2A-3500K

Data in this report applies to families of products including 22CGTX

Report Generated By FNC07603 / LDUCLS01DT446
Version: v7.05


Test Information

Test Method:	LM-79-2019
Report Number:	SP1-2512-631-36-R2
Test Lab:	COOPER LIGHTING SOLUTIONS
Photometer:	SP1 - 76IN SPHERE
Measurement Geometry:	4π
Issue Date:	07/28/2026
Manufacturer:	COOPER LIGHTING SOLUTIONS
Product Line:	Metalux
Catalog Number:	**22CGTX-50-L93050-W2A-3500K**
Description:	*THIS IS A REVISION OF REPORT SP1-2512-631-36-R2 TO UPDATE THE CATALOG INFORMATION* 2X2 5000 LUMEN HE CGTX TUNABLE WHITE FROM 3000K TO 5000K - 7 Volt

Spectral Parameters

CCT (K):	3452
CIE u':	0.2375
CIE v':	0.5107
Duv:	-0.0011
CIE x:	0.4068
CIE y:	0.3888
CIE z:	0.2044
Peak Wavelength (nm):	630
Dominant Wavelength (nm):	581
Purity:	38.79211
Rf:	91.1
Rg:	101.1

CRI (Ra):	93.4
R1:	95.1
R2:	95.5
R3:	94.7
R4:	94.6
R5:	94.4
R6:	94.6
R7:	93.0
R8:	84.9
R9:	61.5
R10:	88.0
R11:	95.0
R12:	80.7
R13:	95.0
R14:	96.1
R15:	91.3

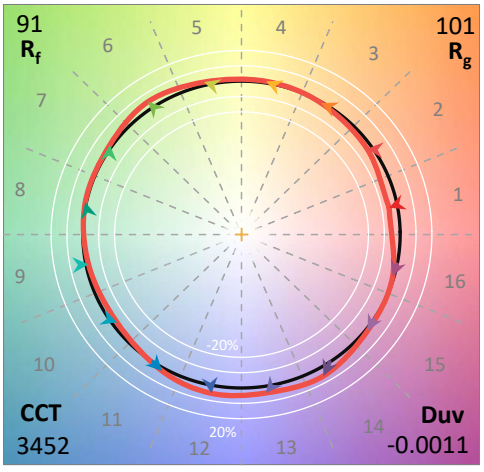


Test Conditions

Stabilization Time:	20M
Operation Time:	1H 20M
Sphere Temperature (°C):	25.1


Measurement and Test Equipment			
Instrument	Identification Number	Calibration Date	Calibration Due Date
Photometer	76INCH SPHERE IN0058	12/16/2025	6/16/2026
Power Meter	XITRON INXT2011004	10/21/2025	10/21/2026
AC Power Source	CHROMA 61603 IN0063	10/21/2025	10/21/2026
DC Power Source	AGILENT E3634A IN0208	10/21/2025	10/21/2026
Sphere Thermometer	ONSET IN0085	10/21/2025	10/21/2026
Room Thermometer	ONSET IN0046	10/21/2025	10/21/2026

REPORT NUMBER: SP1-2512-631-36-R2

CIE 1931 Chromaticity Diagram

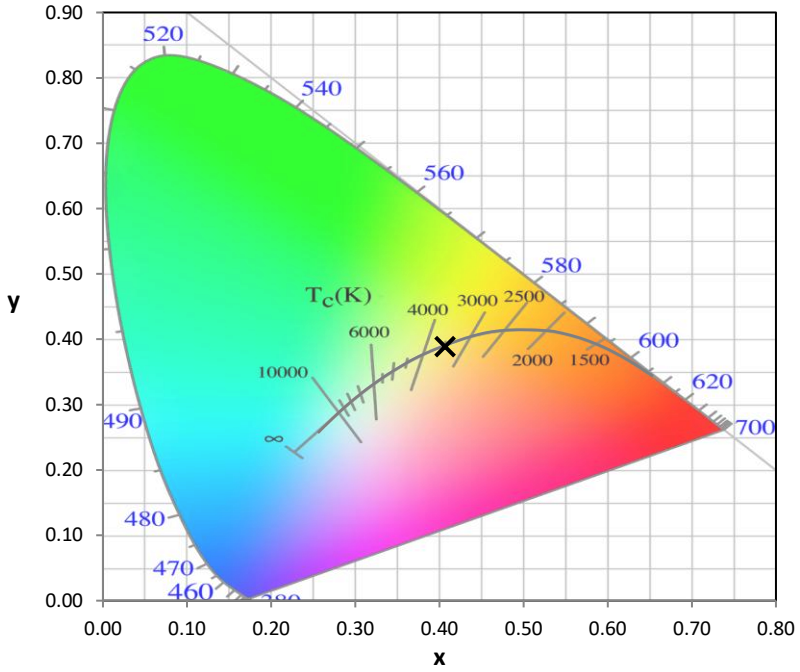

CIE 1931 Chromaticity Diagram with 2017 ANSI 7-Step and 4-Step Quadrangles

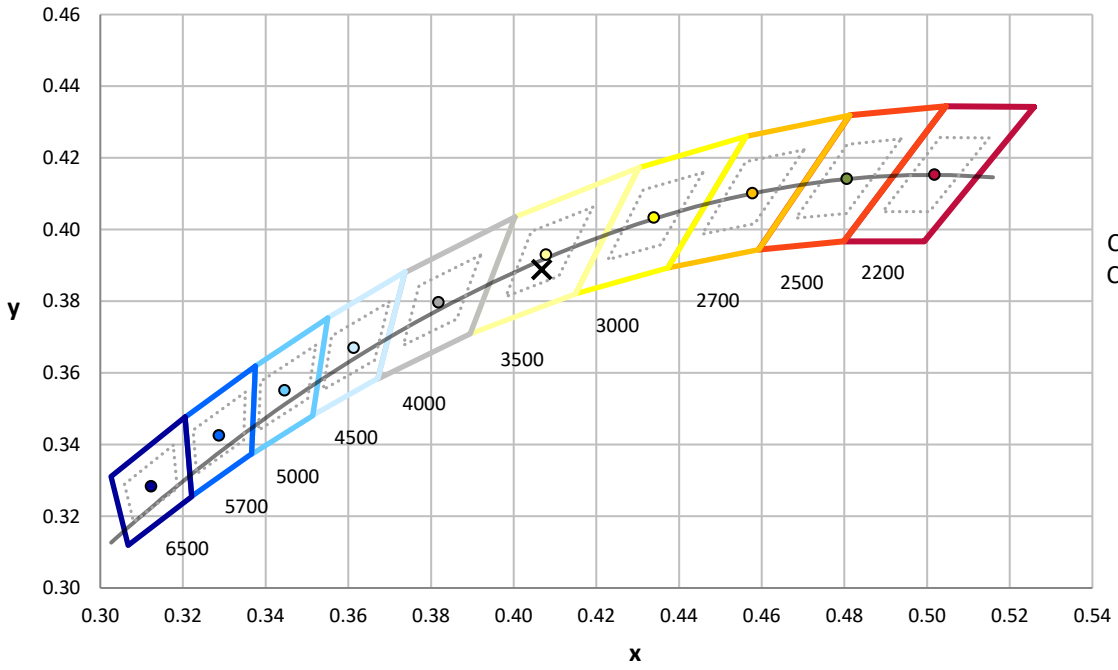


CCT = 3452K
CIE x = 0.4068
CIE y = 0.3888
Duv = -0.0011

Point lies inside the ANSI 3500K 4-step quadrangle

REPORT NUMBER: SP1-2512-631-36-R2

Photopic Flux vs. Wavelength

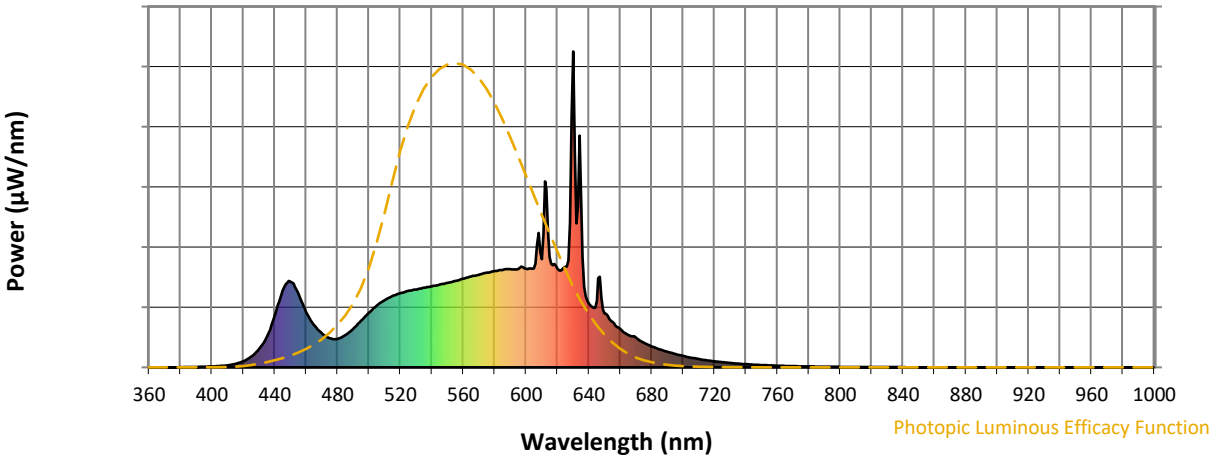


Photopic Lumens: NR

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	122	NR	620	312	NR	750	7	NR	880	0	NR
365	0	NR	495	147	NR	625	319	NR	755	6	NR	885	0	NR
370	0	NR	500	173	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	196	NR	635	559	NR	765	5	NR	895	0	NR
380	1	NR	510	213	NR	640	202	NR	770	4	NR	900	0	NR
385	1	NR	515	226	NR	645	211	NR	775	3	NR	905	0	NR
390	2	NR	520	235	NR	650	171	NR	780	3	NR	910	0	NR
395	2	NR	525	242	NR	655	144	NR	785	2	NR	915	0	NR
400	3	NR	530	246	NR	660	122	NR	790	2	NR	920	0	NR
405	4	NR	535	252	NR	665	103	NR	795	2	NR	925	0	NR
410	7	NR	540	257	NR	670	94	NR	800	2	NR	930	0	NR
415	11	NR	545	263	NR	675	78	NR	805	1	NR	935	0	NR
420	19	NR	550	268	NR	680	66	NR	810	1	NR	940	0	NR
425	34	NR	555	273	NR	685	57	NR	815	1	NR	945	0	NR
430	58	NR	560	281	NR	690	49	NR	820	1	NR	950	0	NR
435	97	NR	565	288	NR	695	42	NR	825	1	NR	955	0	NR
440	163	NR	570	293	NR	700	36	NR	830	1	NR	960	0	NR
445	243	NR	575	300	NR	705	31	NR	835	1	NR	965	0	NR
450	272	NR	580	305	NR	710	26	NR	840	1	NR	970	0	NR
455	234	NR	585	308	NR	715	22	NR	845	0	NR	975	0	NR
460	175	NR	590	311	NR	720	19	NR	850	0	NR	980	0	NR
465	134	NR	595	311	NR	725	16	NR	855	0	NR	985	0	NR
470	107	NR	600	312	NR	730	14	NR	860	0	NR	990	0	NR
475	92	NR	605	313	NR	735	12	NR	865	0	NR	995	0	NR
480	91	NR	610	343	NR	740	10	NR	870	0	NR	1000	0	NR
485	103	NR	615	349	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2512-631-36-R2

Scotopic Flux vs. Wavelength

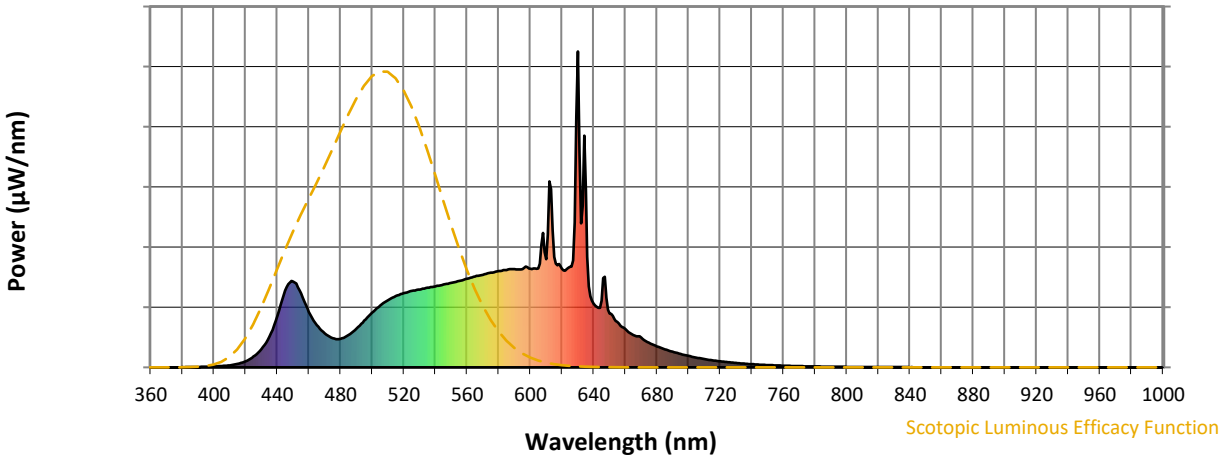


Scotopic Lumens: NR **S/P: 1.59**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	122	NR	620	312	NR	750	7	NR	880	0	NR
365	0	NR	495	147	NR	625	319	NR	755	6	NR	885	0	NR
370	0	NR	500	173	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	196	NR	635	559	NR	765	5	NR	895	0	NR
380	1	NR	510	213	NR	640	202	NR	770	4	NR	900	0	NR
385	1	NR	515	226	NR	645	211	NR	775	3	NR	905	0	NR
390	2	NR	520	235	NR	650	171	NR	780	3	NR	910	0	NR
395	2	NR	525	242	NR	655	144	NR	785	2	NR	915	0	NR
400	3	NR	530	246	NR	660	122	NR	790	2	NR	920	0	NR
405	4	NR	535	252	NR	665	103	NR	795	2	NR	925	0	NR
410	7	NR	540	257	NR	670	94	NR	800	2	NR	930	0	NR
415	11	NR	545	263	NR	675	78	NR	805	1	NR	935	0	NR
420	19	NR	550	268	NR	680	66	NR	810	1	NR	940	0	NR
425	34	NR	555	273	NR	685	57	NR	815	1	NR	945	0	NR
430	58	NR	560	281	NR	690	49	NR	820	1	NR	950	0	NR
435	97	NR	565	288	NR	695	42	NR	825	1	NR	955	0	NR
440	163	NR	570	293	NR	700	36	NR	830	1	NR	960	0	NR
445	243	NR	575	300	NR	705	31	NR	835	1	NR	965	0	NR
450	272	NR	580	305	NR	710	26	NR	840	1	NR	970	0	NR
455	234	NR	585	308	NR	715	22	NR	845	0	NR	975	0	NR
460	175	NR	590	311	NR	720	19	NR	850	0	NR	980	0	NR
465	134	NR	595	311	NR	725	16	NR	855	0	NR	985	0	NR
470	107	NR	600	312	NR	730	14	NR	860	0	NR	990	0	NR
475	92	NR	605	313	NR	735	12	NR	865	0	NR	995	0	NR
480	91	NR	610	343	NR	740	10	NR	870	0	NR	1000	0	NR
485	103	NR	615	349	NR	745	9	NR	875	0	NR			

REPORT NUMBER: SP1-2512-631-36-R2

Melanopic Flux vs. Wavelength

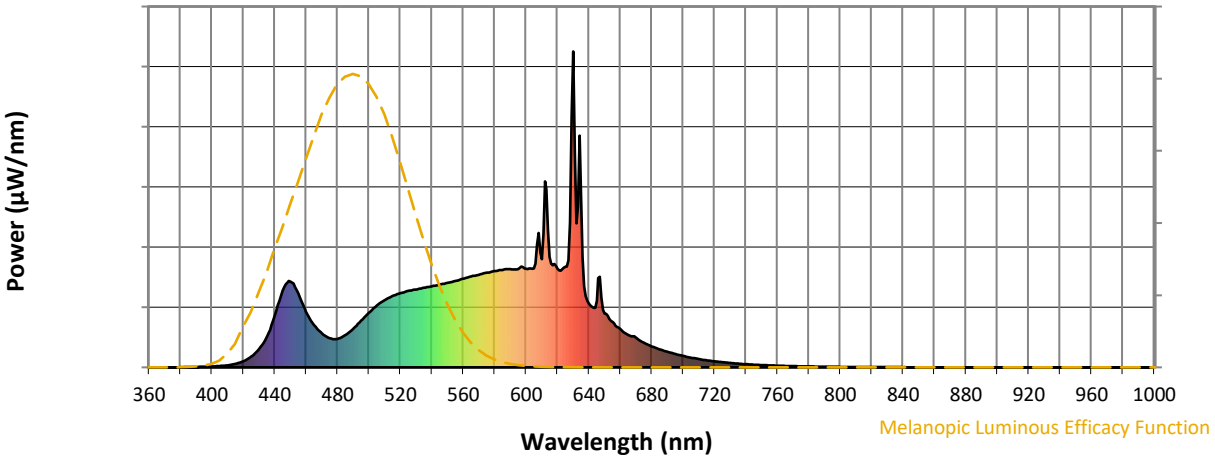

Melanopic Lumens: NR **M/P: 3.18**

λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)	λ (nm)	Power W^/nm	Lumens (ϕ/nm)
360	0	NR	490	122	NR	620	312	NR	750	7	NR	880	0	NR
365	0	NR	495	147	NR	625	319	NR	755	6	NR	885	0	NR
370	0	NR	500	173	NR	630	1000	NR	760	5	NR	890	0	NR
375	0	NR	505	196	NR	635	559	NR	765	5	NR	895	0	NR
380	1	NR	510	213	NR	640	202	NR	770	4	NR	900	0	NR
385	1	NR	515	226	NR	645	211	NR	775	3	NR	905	0	NR
390	2	NR	520	235	NR	650	171	NR	780	3	NR	910	0	NR
395	2	NR	525	242	NR	655	144	NR	785	2	NR	915	0	NR
400	3	NR	530	246	NR	660	122	NR	790	2	NR	920	0	NR
405	4	NR	535	252	NR	665	103	NR	795	2	NR	925	0	NR
410	7	NR	540	257	NR	670	94	NR	800	2	NR	930	0	NR
415	11	NR	545	263	NR	675	78	NR	805	1	NR	935	0	NR
420	19	NR	550	268	NR	680	66	NR	810	1	NR	940	0	NR
425	34	NR	555	273	NR	685	57	NR	815	1	NR	945	0	NR
430	58	NR	560	281	NR	690	49	NR	820	1	NR	950	0	NR
435	97	NR	565	288	NR	695	42	NR	825	1	NR	955	0	NR
440	163	NR	570	293	NR	700	36	NR	830	1	NR	960	0	NR
445	243	NR	575	300	NR	705	31	NR	835	1	NR	965	0	NR
450	272	NR	580	305	NR	710	26	NR	840	1	NR	970	0	NR
455	234	NR	585	308	NR	715	22	NR	845	0	NR	975	0	NR
460	175	NR	590	311	NR	720	19	NR	850	0	NR	980	0	NR
465	134	NR	595	311	NR	725	16	NR	855	0	NR	985	0	NR
470	107	NR	600	312	NR	730	14	NR	860	0	NR	990	0	NR
475	92	NR	605	313	NR	735	12	NR	865	0	NR	995	0	NR
480	91	NR	610	343	NR	740	10	NR	870	0	NR	1000	0	NR
485	103	NR	615	349	NR	745	9	NR	875	0	NR			


REPORT NUMBER: SP1-2512-631-36-R2

TM-30-18


Summary


R_f = 91.1
R_g = 101.1
CIE R_a = 93.4
R_9 = 61.5


Spectral Power Distribution Comparison

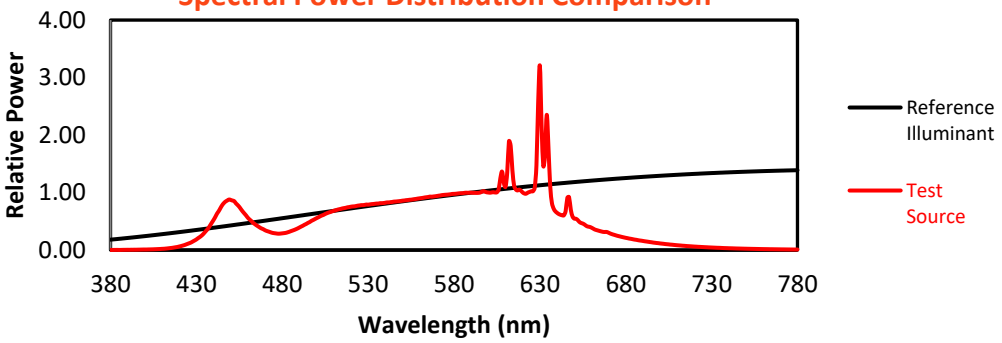


Color Vector Graphics

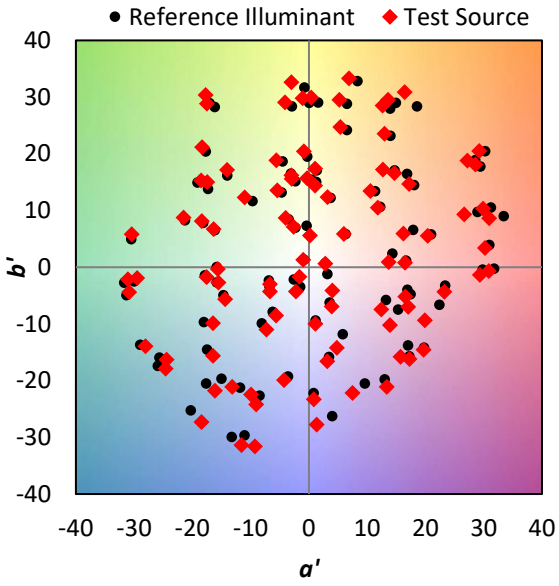

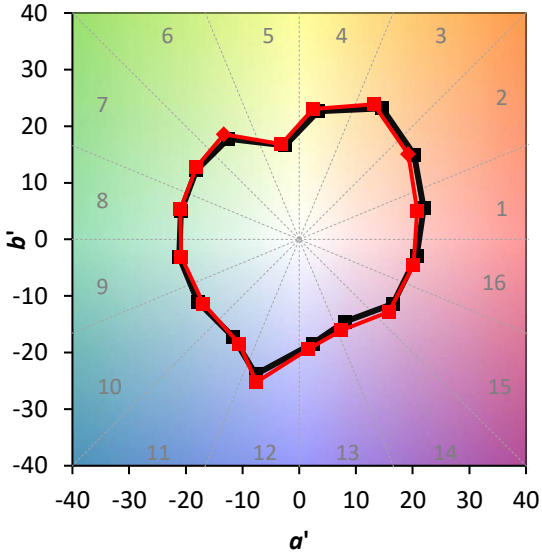

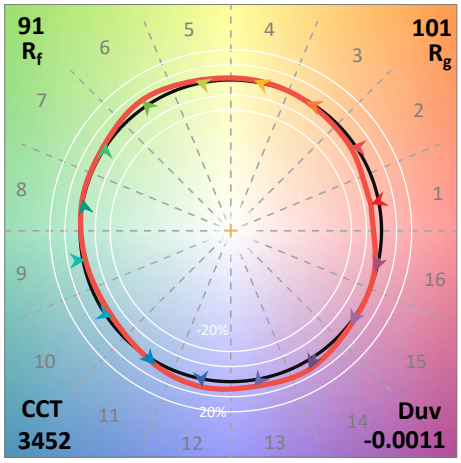

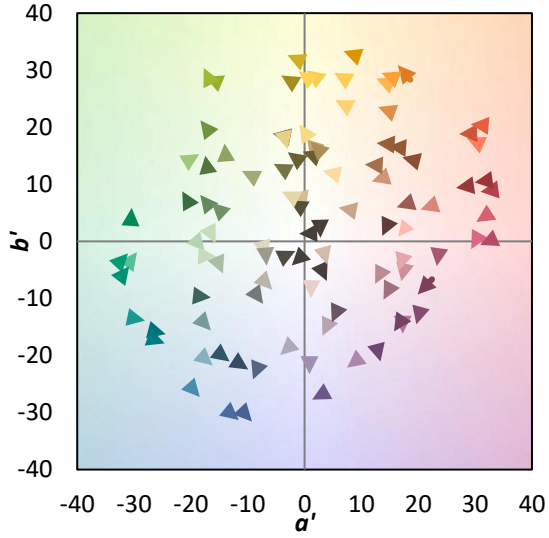


REPORT NUMBER: SP1-2512-631-36-R2

TM-30-18

Individual Sample Fidelity Index ($R_{f,i}$)


CES01 = 86	CES26 = 90	CES51 = 98	CES76 = 85
CES02 = 62	CES27 = 95	CES52 = 96	CES77 = 88
CES03 = 31	CES28 = 94	CES53 = 94	CES78 = 82
CES04 = 70	CES29 = 90	CES54 = 98	CES79 = 93
CES05 = 50	CES30 = 97	CES55 = 97	CES80 = 92
CES06 = 51	CES31 = 90	CES56 = 95	CES81 = 78
CES07 = 43	CES32 = 84	CES57 = 94	CES82 = 96
CES08 = 41	CES33 = 92	CES58 = 95	CES83 = 94
CES09 = 29	CES34 = 91	CES59 = 98	CES84 = 95
CES10 = 75	CES35 = 95	CES60 = 96	CES85 = 82
CES11 = 58	CES36 = 88	CES61 = 95	CES86 = 81
CES12 = 64	CES37 = 92	CES62 = 94	CES87 = 91
CES13 = 43	CES38 = 98	CES63 = 93	CES88 = 97
CES14 = 74	CES39 = 97	CES64 = 94	CES89 = 84
CES15 = 71	CES40 = 94	CES65 = 90	CES90 = 97
CES16 = 47	CES41 = 96	CES66 = 91	CES91 = 80
CES17 = 49	CES42 = 90	CES67 = 90	CES92 = 79
CES18 = 56	CES43 = 89	CES68 = 90	CES93 = 87
CES19 = 71	CES44 = 99	CES69 = 91	CES94 = 74
CES20 = 67	CES45 = 93	CES70 = 87	CES95 = 84
CES21 = 86	CES46 = 93	CES71 = 84	CES96 = 92
CES22 = 78	CES47 = 89	CES72 = 95	CES97 = 93
CES23 = 91	CES48 = 95	CES73 = 81	CES98 = 93
CES24 = 90	CES49 = 92	CES74 = 92	CES99 = 93
CES25 = 71	CES50 = 97	CES75 = 85	

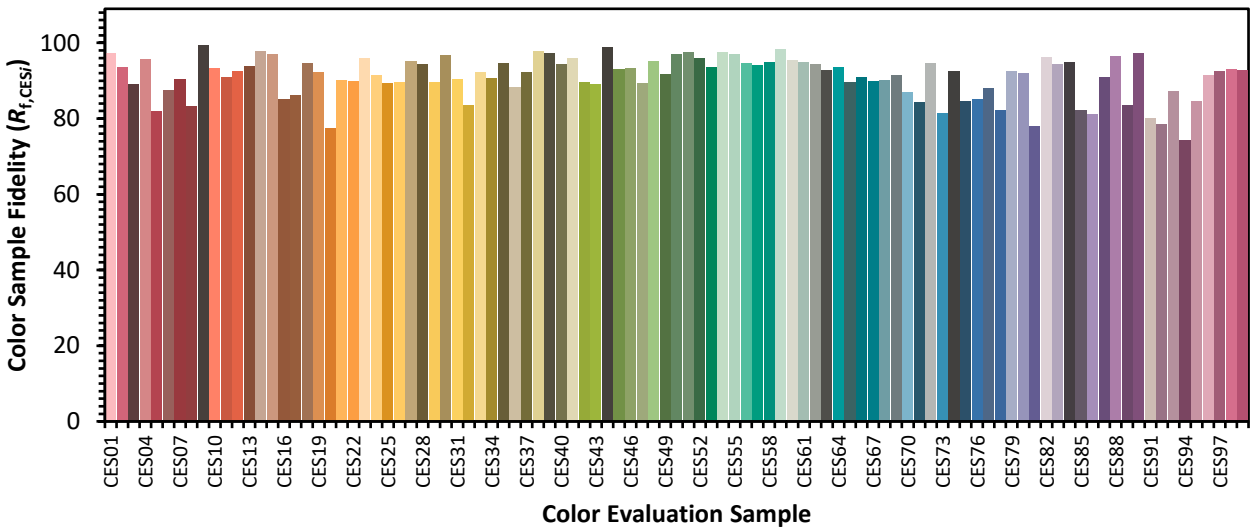



REPORT NUMBER: SP1-2512-631-36-R2

TM-30-18

Color Rendition by Hue-Angle Bin

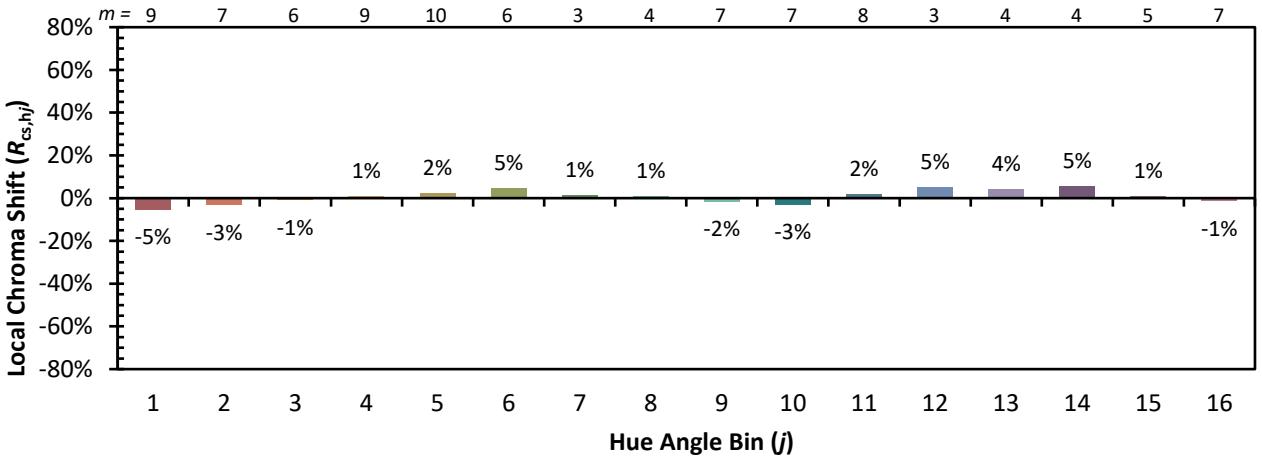

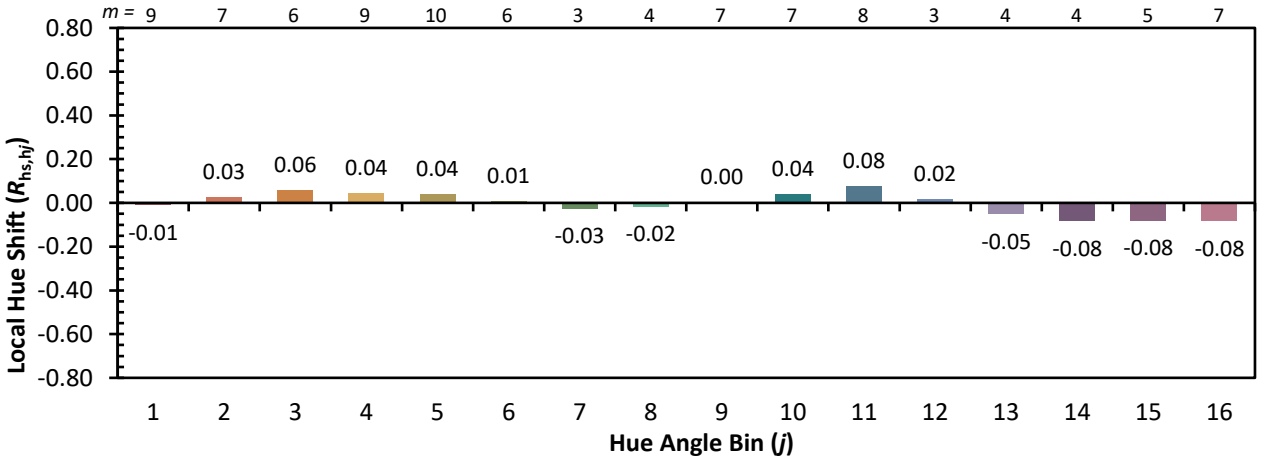


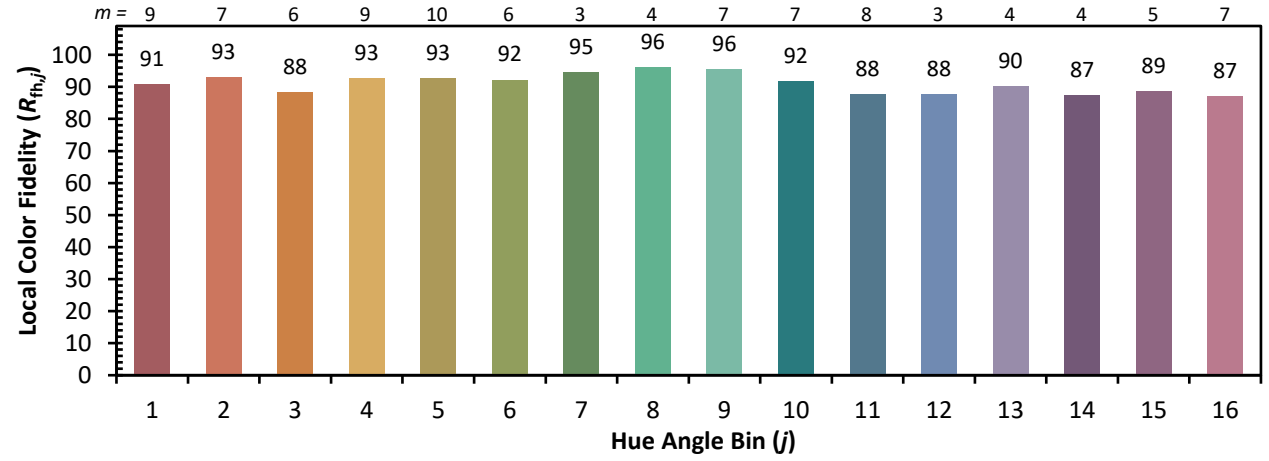


REPORT NUMBER: SP1-2512-631-36-R2

TM-30-18

Measure Comparisons

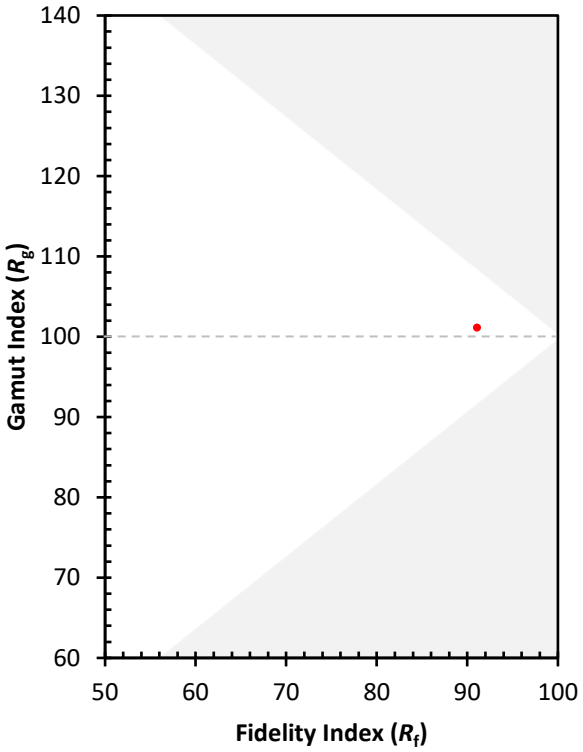

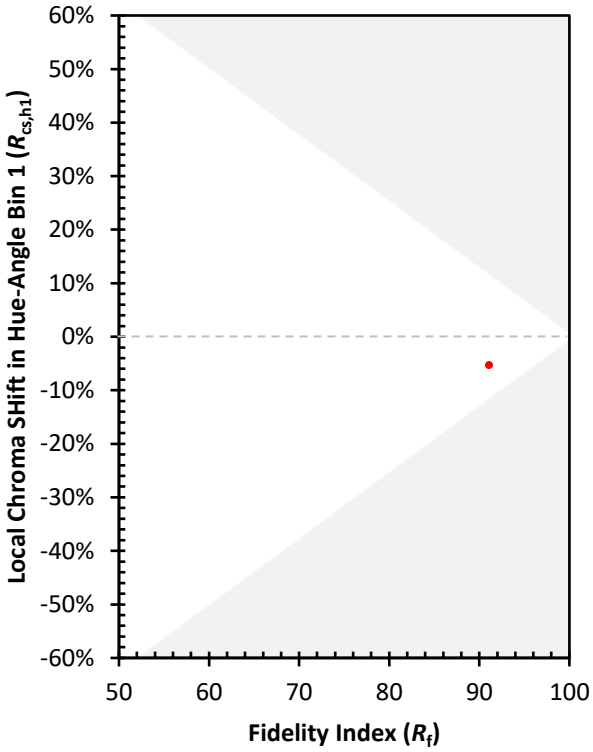

(END OF REPORT)